

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P749987

Luminaire Tested: LD4D55D010-EU4DR3555659035-4LBDP1LI

Issue Date: 1/30/2024

Test Information

Test Method: LM-79-2019
Report Number: P749987
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-20)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 1/30/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LD4D55D010-EU4DR3555659035-4LBDP1LI
Description: 4 INCH ROUND DEEP 45° CUTOFF SPECULAR CLEAR TRIM, WITH 35° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 3500K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 5545.3 lumens
Efficiency: N/A
Efficacy: 95.3 lumens/watt
Spacing Criteria (0/90/45): 0.6 / 0.6 / 0.54
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct


Input Watts (W): 58.2
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT



Downlight

TEST NUMBER: P749987
CATALOG NUMBER: LD4D55D010-EU4DR3555659035-4LBDP1LI

Luminous Intensity Polar Plot

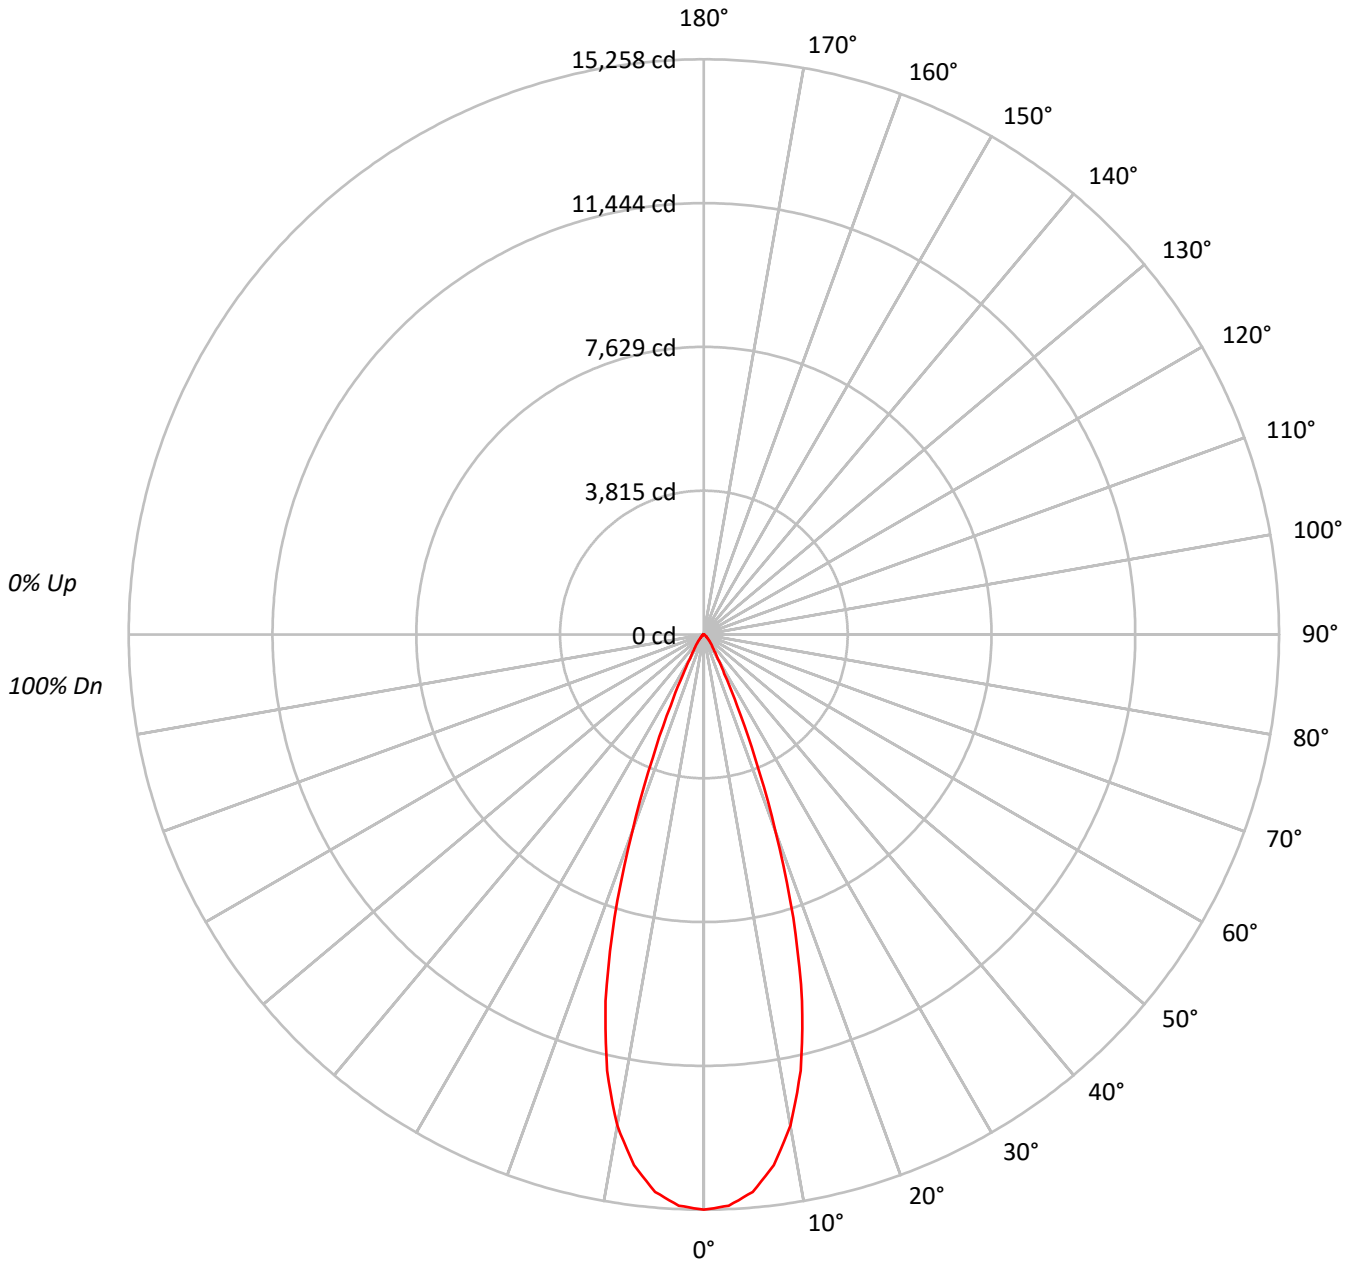



TEST NUMBER: P749987

CATALOG NUMBER: LD4D55D010-EU4DR3555659035-4LBDP1LI

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20	
RC	80				70				50				30				10	0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																		
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100
1	115	112	110	108	112	110	108	107	106	105	103	103	101	100	99	98	98	96
2	110	106	103	101	108	105	102	99	102	99	97	99	97	95	96	95	93	92
3	106	101	97	94	105	100	96	93	97	95	92	95	93	91	93	91	89	88
4	103	97	92	89	101	96	92	89	94	90	88	92	89	87	90	88	86	84
5	99	93	88	85	98	92	87	84	90	86	84	89	85	83	87	84	82	81
6	96	89	84	81	94	88	84	81	87	83	80	85	82	80	84	81	79	78
7	93	85	81	78	91	85	80	77	84	80	77	83	79	77	82	79	76	75
8	90	82	78	74	88	82	77	74	81	77	74	80	76	74	79	76	73	72
9	87	79	75	72	86	79	75	72	78	74	71	77	74	71	77	73	71	70
10	84	77	72	69	83	76	72	69	76	72	69	75	71	69	74	71	69	68

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	1667079
5°	1627908
10°	1467176
15°	1138763
20°	645884
25°	251287
30°	93739
35°	51392
40°	33589
45°	20443
50°	13020
55°	9201
60°	6730
65°	3645
70°	256
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 20443 cd/sqm



TEST NUMBER: P749987

CATALOG NUMBER: LD4D55D010-EU4DR3555659035-4LBDP1LI

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	1365.1	24.6
10°-20°	2665.2	48.1
20°-30°	1087.0	19.6
30°-40°	260.1	4.7
40°-50°	108.4	2.0
50°-60°	44.9	0.8
60°-70°	14.0	0.3
70°-80°	0.3	0.0
80°-90°	0.2	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	5117.3	92.3
0°-40°	5377.4	97.0
0°-60°	5530.7	99.7
0°-90°	5545.3	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	5545.3	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	15258	
5°	14843	###
15°	10067	2665
25°	2084	1087
35°	385	260
45°	132	108
55°	48	45
65°	14	14
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P749987

CATALOG NUMBER: LD4D55D010-EU4DR3555659035-4LBDP1LI

CANDELA DISTRIBUTION (FULL):

0°	
0°	15257.8
2.5°	15166.3
5°	14842.6
7.5°	14196.9
10°	13224.2
12.5°	11854.6
15°	10067.3
17.5°	7881.4
20°	5554.9
22.5°	3542.1
25°	2084.4
27.5°	1178.2
30°	743.0
32.5°	521.7
35°	385.3
37.5°	297.9
40°	235.5
42.5°	181.4
45°	132.3
47.5°	99.0
50°	76.6
52.5°	60.7
55°	48.3
57.5°	39.1
60°	30.8
62.5°	22.5
65°	14.1
67.5°	5.0
70°	0.8
72.5°	0.8
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.8
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)