

Scaled data based on original data using  
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-  
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P750154

Luminaire Tested: LD4D55D010-EU4DR4555659040-4LBDP1B

Issue Date: 1/30/2024

**Test Information**

Test Method: LM-79-2019  
Report Number: P750154  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-36)  
Test Lab: COOPER LIGHTING SOLUTIONS  
Issue Date: 1/30/2024  
Manufacturer: COOPER LIGHTING SOLUTIONS  
Product Line: PORTFOLIO  
Catalog Number: LD4D55D010-EU4DR4555659040-4LBDP1B  
Description: 4 INCH ROUND DEEP 45° CUTOFF SPECULAR BLACK TRIM, WITH 45° OPTIC  
Light Source: (1) HIGH LUMEN LED 90CRI / 4000K CCT  
Ballast/Driver: -

**Summary**

Lumens per Lamp: N/A  
Luminaire Lumens: 5225.4 lumens  
Efficiency: N/A  
Efficacy: 89.8 lumens/watt  
Spacing Criteria (0/90/45): 0.75 / 0.75 / 0.69  
Luminous Opening: Circular (Dia: 0.35' x H: 0')  
CIE Type: Direct


Input Watts (W): 58.2  
Input Voltage (V): NR  
Input Current (A<sub>in</sub>): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 24 FT



Downlight

TEST NUMBER: P750154  
CATALOG NUMBER: LD4D55D010-EU4DR4555659040-4LBDP1B

### Luminous Intensity Polar Plot

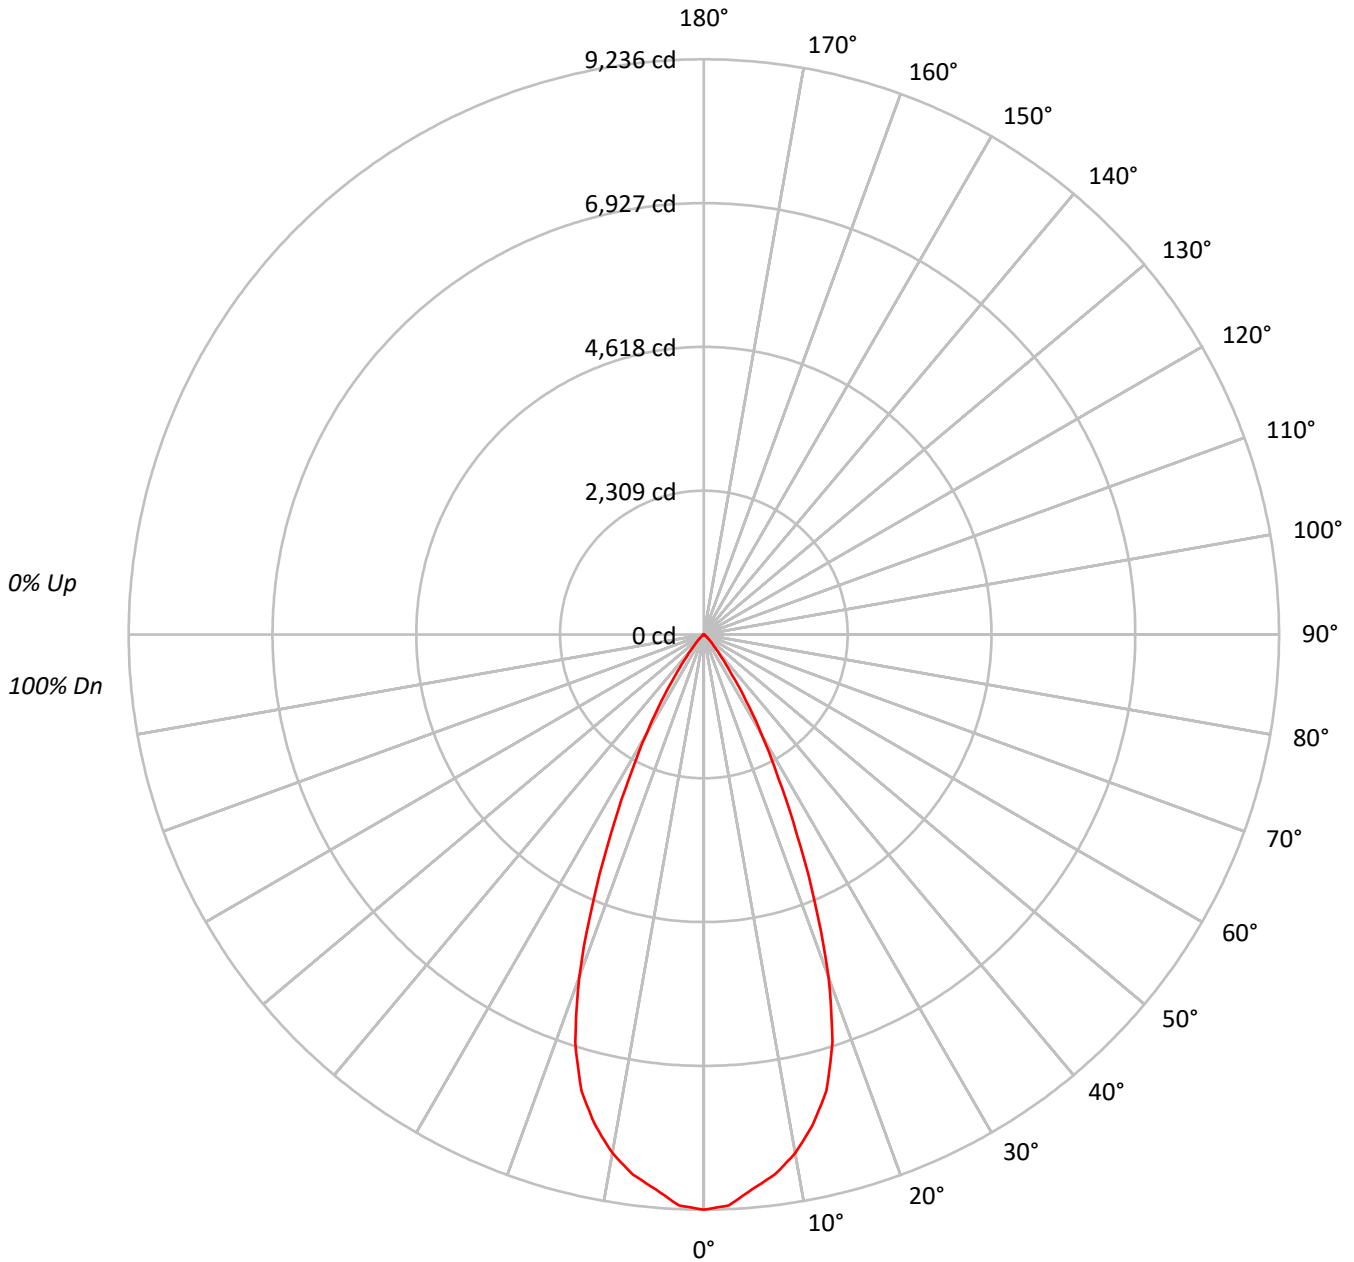



TEST NUMBER: P750154

CATALOG NUMBER: LD4D55D010-EU4DR4555659040-4LBDP1B

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20				20				20				20				20				
RC	80				70				50				30				10		0		
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			
1	114	112	110	108	112	110	108	106	106	104	103	102	101	100	98	98	97	95			
2	109	105	102	99	107	103	100	98	100	98	95	97	95	93	95	93	91	90			
3	105	99	95	91	103	98	94	91	95	92	89	93	90	88	91	89	87	85			
4	100	94	89	85	99	93	88	85	91	87	84	89	86	83	87	84	82	81			
5	96	89	84	80	95	88	83	80	86	82	79	85	81	79	83	80	78	77			
6	92	85	80	76	91	84	79	76	83	78	75	81	77	75	80	77	74	73			
7	89	81	75	72	87	80	75	72	79	74	71	78	74	71	77	73	71	69			
8	85	77	72	68	84	76	71	68	75	71	68	74	70	67	73	70	67	66			
9	82	73	68	65	81	73	68	65	72	68	65	71	67	64	71	67	64	63			
10	79	70	65	62	78	70	65	62	69	65	62	68	64	61	68	64	61	60			

**AVERAGE LUMINANCE (cd/sqm):**

	0°
0°	1009121
5°	980391
10°	937973
15°	858441
20°	681045
25°	425177
30°	234349
35°	105226
40°	41448
45°	19531
50°	9264
55°	4838
60°	2382
65°	569
70°	224
75°	0
80°	0
85°	0

**MAXIMUM LUMINANCE 45°-90°:**

Horizontal Angle: 0°  
 Vertical Angle: 45°  
 Luminance: 19531 cd/sqm



TEST NUMBER: P750154

CATALOG NUMBER: LD4D55D010-EU4DR4555659040-4LBDP1B

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	839.9	16.1
10°-20°	2067.1	39.6
20°-30°	1636.9	31.3
30°-40°	545.1	10.4
40°-50°	108.2	2.1
50°-60°	24.6	0.5
60°-70°	3.5	0.1
70°-80°	0.1	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	4543.9	87.0
0°-40°	5089.0	97.4
0°-60°	5221.7	99.9
0°-90°	5225.4	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	5225.4	100.0

**CANDELA DISTRIBUTION:**

	0°	Flux
0°	9236	
5°	8939	840
15°	7589	2067
25°	3527	1637
35°	789	545
45°	126	108
55°	25	25
65°	2	4
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P750154

CATALOG NUMBER: LD4D55D010-EU4DR4555659040-4LBDP1B

**CANDELA DISTRIBUTION (FULL):**

	0°
0°	9235.9
2.5°	9175.6
5°	8938.8
7.5°	8743.4
10°	8454.3
12.5°	8069.3
15°	7589.1
17.5°	6867.0
20°	5857.3
22.5°	4654.3
25°	3526.8
27.5°	2582.5
30°	1857.5
32.5°	1263.3
35°	788.9
37.5°	467.8
40°	290.6
42.5°	191.1
45°	126.4
47.5°	81.4
50°	54.5
52.5°	36.3
55°	25.4
57.5°	16.7
60°	10.9
62.5°	5.8
65°	2.2
67.5°	0.7
70°	0.7
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report





Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)