

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P750158

Luminaire Tested: LD4D55D010-EU4DR4555659040-4LBS1B

Issue Date: 1/30/2024

Test Information

Test Method: LM-79-2019
Report Number: P750158
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-36)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 1/30/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LD4D55D010-EU4DR4555659040-4LBS1B
Description: 4 INCH ROUND SHALLOW SPECULAR BLACK TRIM, WITH 45° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 4000K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 5843.6 lumens
Efficiency: N/A
Efficacy: 100.4 lumens/watt
Spacing Criteria (0/90/45): 0.75 / 0.75 / 0.69
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct


Input Watts (W): 58.2
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT



Downlight

TEST NUMBER: P750158
CATALOG NUMBER: LD4D55D010-EU4DR4555659040-4LBS1B

Luminous Intensity Polar Plot

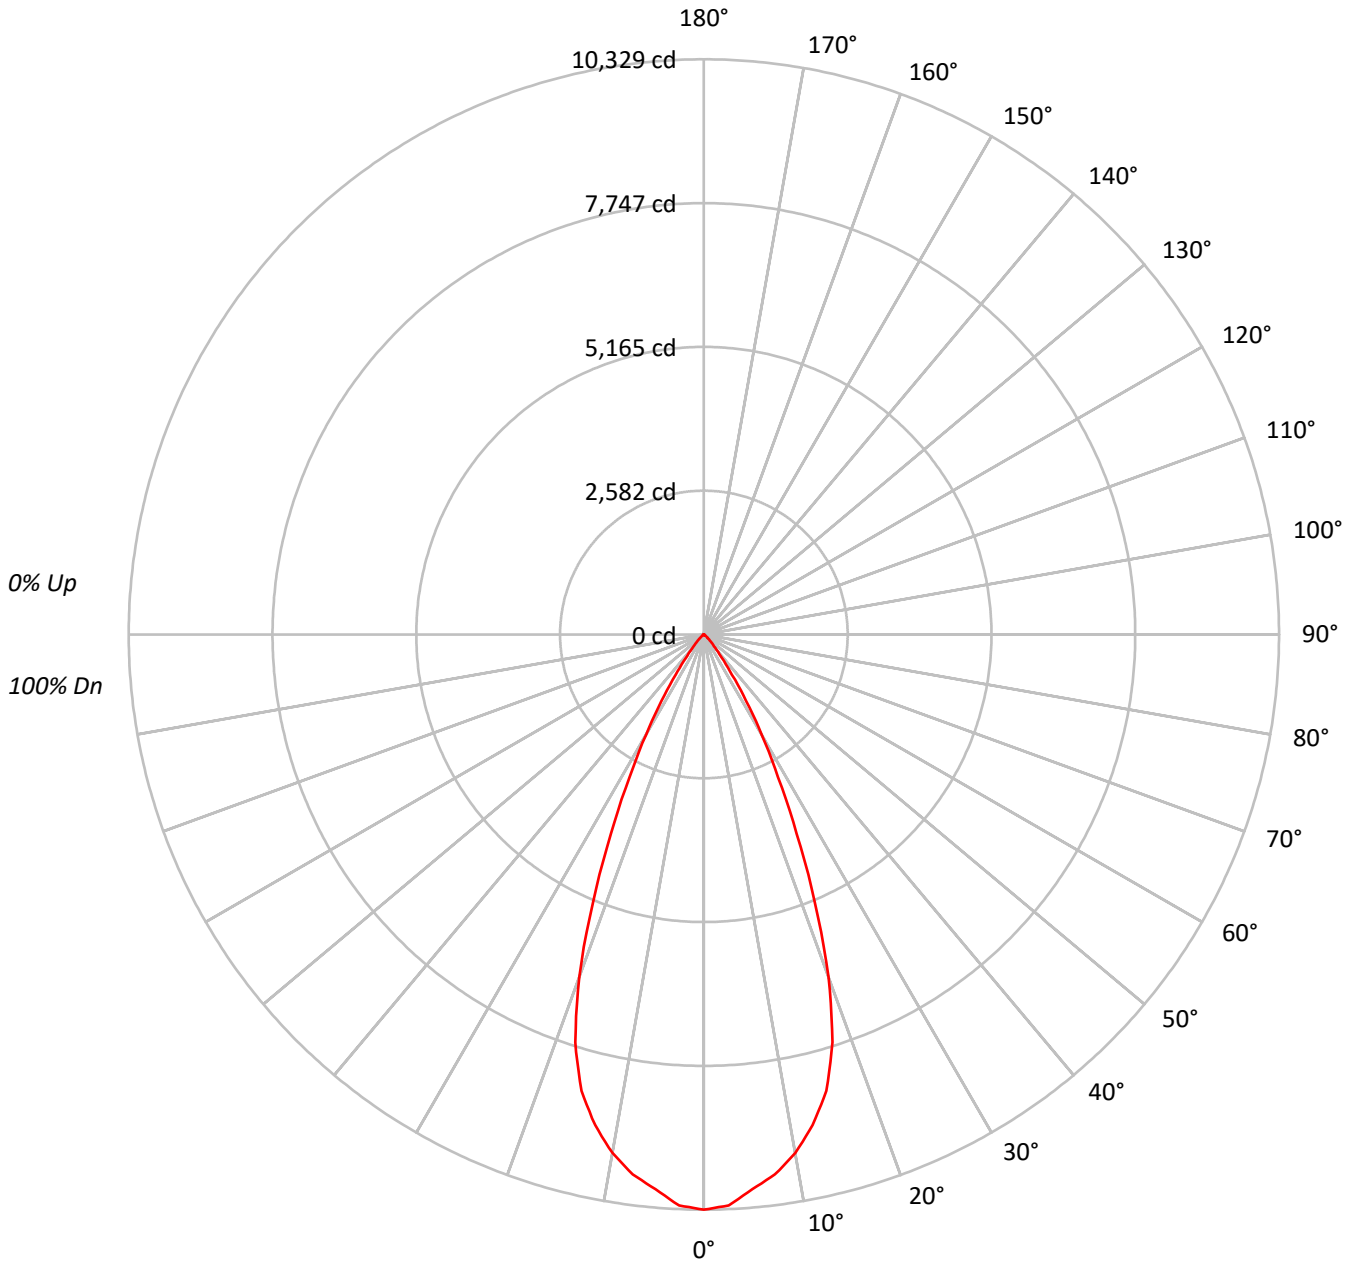



TEST NUMBER: P750158
 CATALOG NUMBER: LD4D55D010-EU4DR4555659040-4LBS1B

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10		0		
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			
1	114	112	110	108	112	110	108	106	106	104	103	102	101	100	98	98	97	95			
2	109	105	102	99	107	103	100	98	100	98	95	97	95	93	95	93	91	90			
3	105	99	95	91	103	98	94	91	95	92	89	93	90	88	91	89	87	85			
4	100	94	89	85	99	93	88	85	91	87	84	89	86	83	87	84	82	81			
5	96	89	84	80	95	88	83	80	86	82	79	85	81	79	83	80	78	77			
6	92	85	80	76	91	84	79	76	83	78	75	81	77	75	80	77	74	73			
7	89	81	75	72	87	80	75	72	79	74	71	78	74	71	77	73	71	69			
8	85	77	72	68	84	76	71	68	75	71	68	74	70	67	73	70	67	66			
9	82	73	68	65	81	73	68	65	72	68	65	71	67	64	71	67	64	63			
10	79	70	65	62	78	70	65	62	69	65	62	68	64	61	68	64	61	60			

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	1128522
5°	1096386
10°	1048942
15°	960007
20°	761622
25°	475485
30°	262079
35°	117670
40°	46355
45°	21849
50°	10352
55°	5410
60°	2666
65°	620
70°	256
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 21849 cd/sqm



TEST NUMBER: P750158

CATALOG NUMBER: LD4D55D010-EU4DR4555659040-4LBS1B

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	939.3	16.1
10°-20°	2311.6	39.6
20°-30°	1830.6	31.3
30°-40°	609.6	10.4
40°-50°	121.0	2.1
50°-60°	27.5	0.5
60°-70°	3.9	0.1
70°-80°	0.1	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	5081.5	87.0
0°-40°	5691.1	97.4
0°-60°	5839.5	99.9
0°-90°	5843.6	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	5843.6	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	10329	
5°	9996	939
15°	8487	2312
25°	3944	1831
35°	882	610
45°	141	121
55°	28	27
65°	2	4
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P750158

CATALOG NUMBER: LD4D55D010-EU4DR4555659040-4LBS1B

CANDELA DISTRIBUTION (FULL):

0°	
0°	10328.7
2.5°	10261.2
5°	9996.4
7.5°	9777.9
10°	9454.5
12.5°	9024.0
15°	8487.0
17.5°	7679.5
20°	6550.3
22.5°	5204.9
25°	3944.1
27.5°	2888.0
30°	2077.3
32.5°	1412.7
35°	882.2
37.5°	523.2
40°	325.0
42.5°	213.7
45°	141.4
47.5°	91.0
50°	60.9
52.5°	40.6
55°	28.4
57.5°	18.7
60°	12.2
62.5°	6.5
65°	2.4
67.5°	0.8
70°	0.8
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)