

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P751405

Luminaire Tested: LD4D65D010-EU4DR2555659040-4LBDP1MW

Issue Date: 1/30/2024

Test Information

Test Method: LM-79-2019
Report Number: P751405
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-4)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 1/30/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LD4D65D010-EU4DR2555659040-4LBDP1MW
Description: 4 INCH ROUND DEEP 45° CUTOFF MATTE WHITE TRIM, WITH 25° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 4000K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 5569.5 lumens
Efficiency: N/A
Efficacy: 76.5 lumens/watt
Spacing Criteria (0/90/45): 0.42 / 0.42 / 0.45
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct

Input Watts (W): 72.8
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT




Downlight

TEST NUMBER: P751405

CATALOG NUMBER: LD4D65D010-EU4DR2555659040-4LBDP1MW

Luminous Intensity Polar Plot

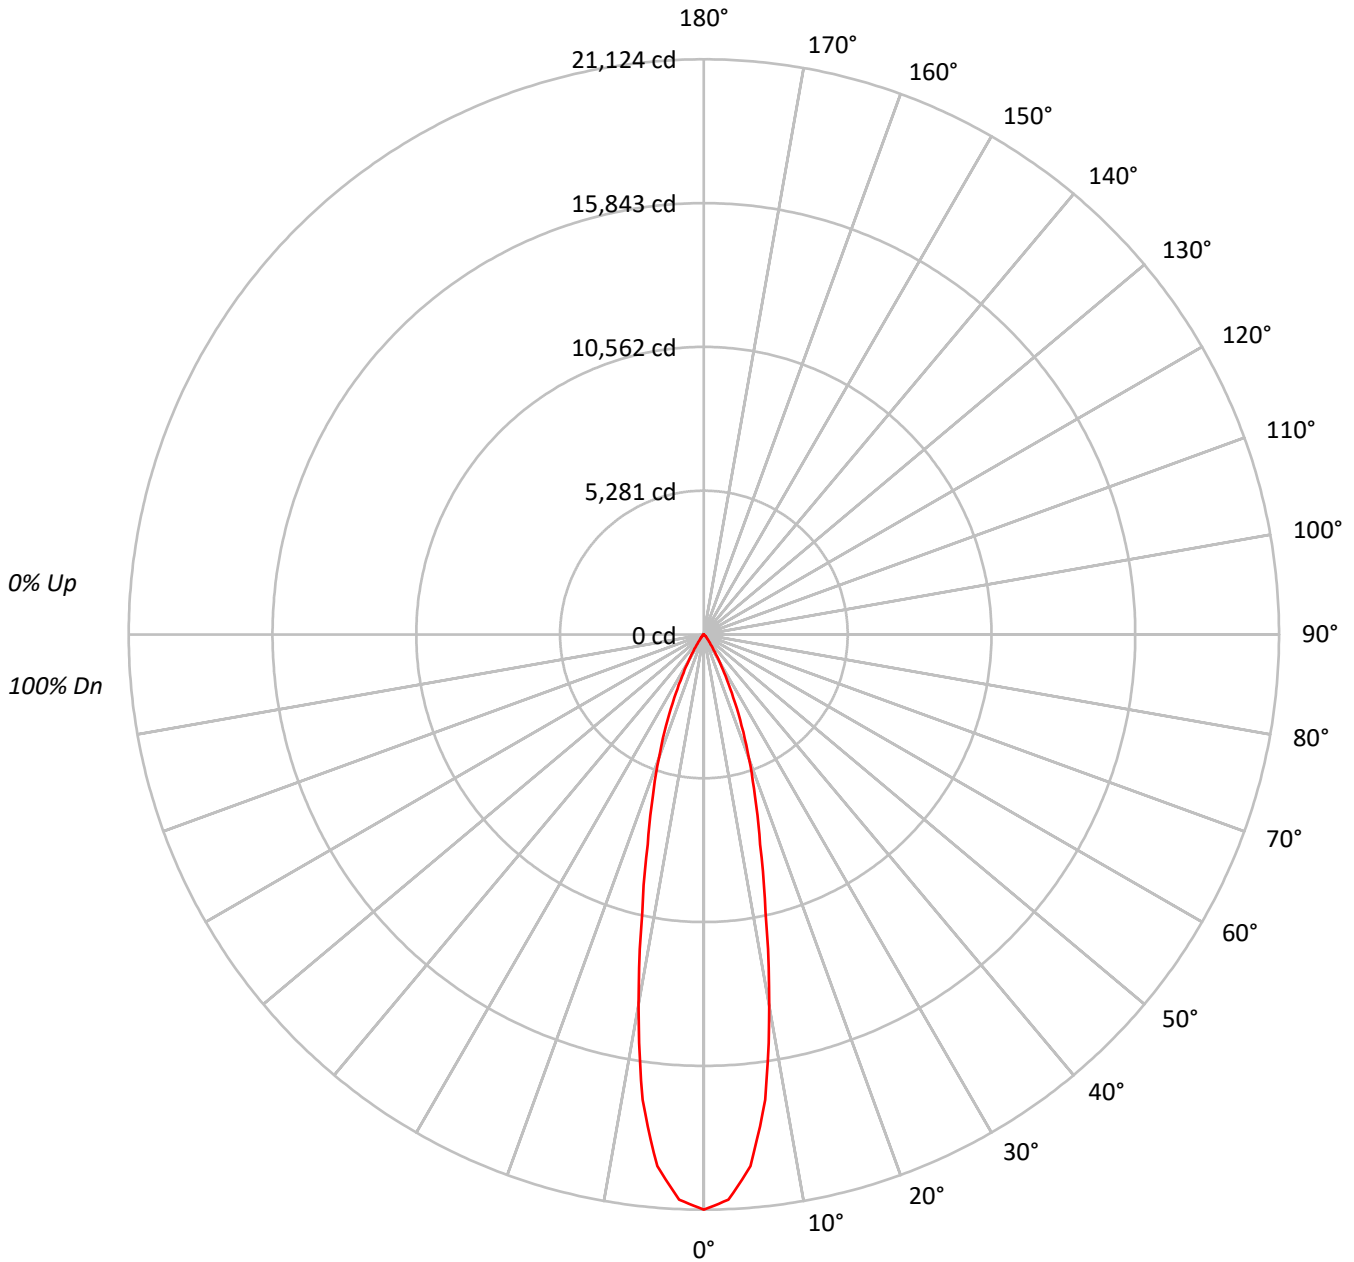



TEST NUMBER: P751405

CATALOG NUMBER: LD4D65D010-EU4DR2555659040-4LBDP1MW

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20			
RC	80				70				50				30				10		0	
RW	70	50	30	10	70	50	30	10	50	30	10		50	30	10		50	30	10	0
RCR																				
0	119	119	119	119	116	116	116	116	111	111	111		106	106	106		102	102	102	100
1	115	113	111	109	112	110	109	107	106	105	104		103	102	101		99	99	98	96
2	111	107	104	101	109	105	102	100	102	100	98		99	97	96		97	95	94	92
3	107	102	98	95	105	101	97	94	98	95	93		96	93	91		94	92	90	89
4	103	97	93	90	102	96	93	90	94	91	89		93	90	88		91	89	87	85
5	100	93	89	86	98	93	89	86	91	87	85		89	86	84		88	85	83	82
6	97	90	85	82	95	89	85	82	88	84	81		87	83	81		85	83	80	79
7	93	87	82	79	92	86	82	79	85	81	78		84	80	78		83	80	78	77
8	91	84	79	76	90	83	79	76	82	78	76		81	78	75		80	77	75	74
9	88	81	76	73	87	80	76	73	80	76	73		79	75	73		78	75	73	72
10	85	78	74	71	85	78	74	71	77	73	71		76	73	71		76	73	70	69

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	2308013
5°	2149625
10°	1533389
15°	903099
20°	561924
25°	308382
30°	141038
35°	53406
40°	24190
45°	14540
50°	6034
55°	3886
60°	2710
65°	1836
70°	288
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 14540 cd/sqm



TEST NUMBER: P751405

CATALOG NUMBER: LD4D65D010-EU4DR2555659040-4LBDP1MW

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	1684.4	30.2
10°-20°	2281.4	41.0
20°-30°	1207.3	21.7
30°-40°	298.0	5.4
40°-50°	72.7	1.3
50°-60°	19.1	0.3
60°-70°	6.4	0.1
70°-80°	0.1	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	5173.1	92.9
0°-40°	5471.1	98.2
0°-60°	5562.9	99.9
0°-90°	5569.5	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	5569.5	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	21124	
5°	19599	###
15°	7984	2281
25°	2558	1207
35°	400	298
45°	94	73
55°	20	19
65°	7	6
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P751405

CATALOG NUMBER: LD4D65D010-EU4DR2555659040-4LBDP1MW

CANDELA DISTRIBUTION (FULL):

0°	
0°	21123.9
2.5°	20776.7
5°	19599.4
7.5°	17234.0
10°	13821.0
12.5°	10447.8
15°	7983.9
17.5°	6222.4
20°	4832.8
22.5°	3624.4
25°	2558.0
27.5°	1715.4
30°	1117.9
32.5°	680.1
35°	400.4
37.5°	245.1
40°	169.6
42.5°	129.6
45°	94.1
47.5°	56.8
50°	35.5
52.5°	25.7
55°	20.4
57.5°	16.0
60°	12.4
62.5°	9.8
65°	7.1
67.5°	2.7
70°	0.9
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)