

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P751798

Luminaire Tested: LD4D65D010-EU4DR5055659040-4LBS1LI

Issue Date: 1/30/2024

Test Information

Test Method: LM-79-2019
Report Number: P751798
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-44)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 1/30/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LD4D65D010-EU4DR5055659040-4LBS1LI
Description: 4 INCH ROUND SHALLOW SPECULAR CLEAR TRIM, WITH 50° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 4000K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 8070.4 lumens
Efficiency: N/A
Efficacy: 110.9 lumens/watt
Spacing Criteria (0/90/45): 0.8 / 0.8 / 0.73
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct


Input Watts (W): 72.8
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT



Downlight

TEST NUMBER: P751798
CATALOG NUMBER: LD4D65D010-EU4DR5055659040-4LBS1LI

Luminous Intensity Polar Plot

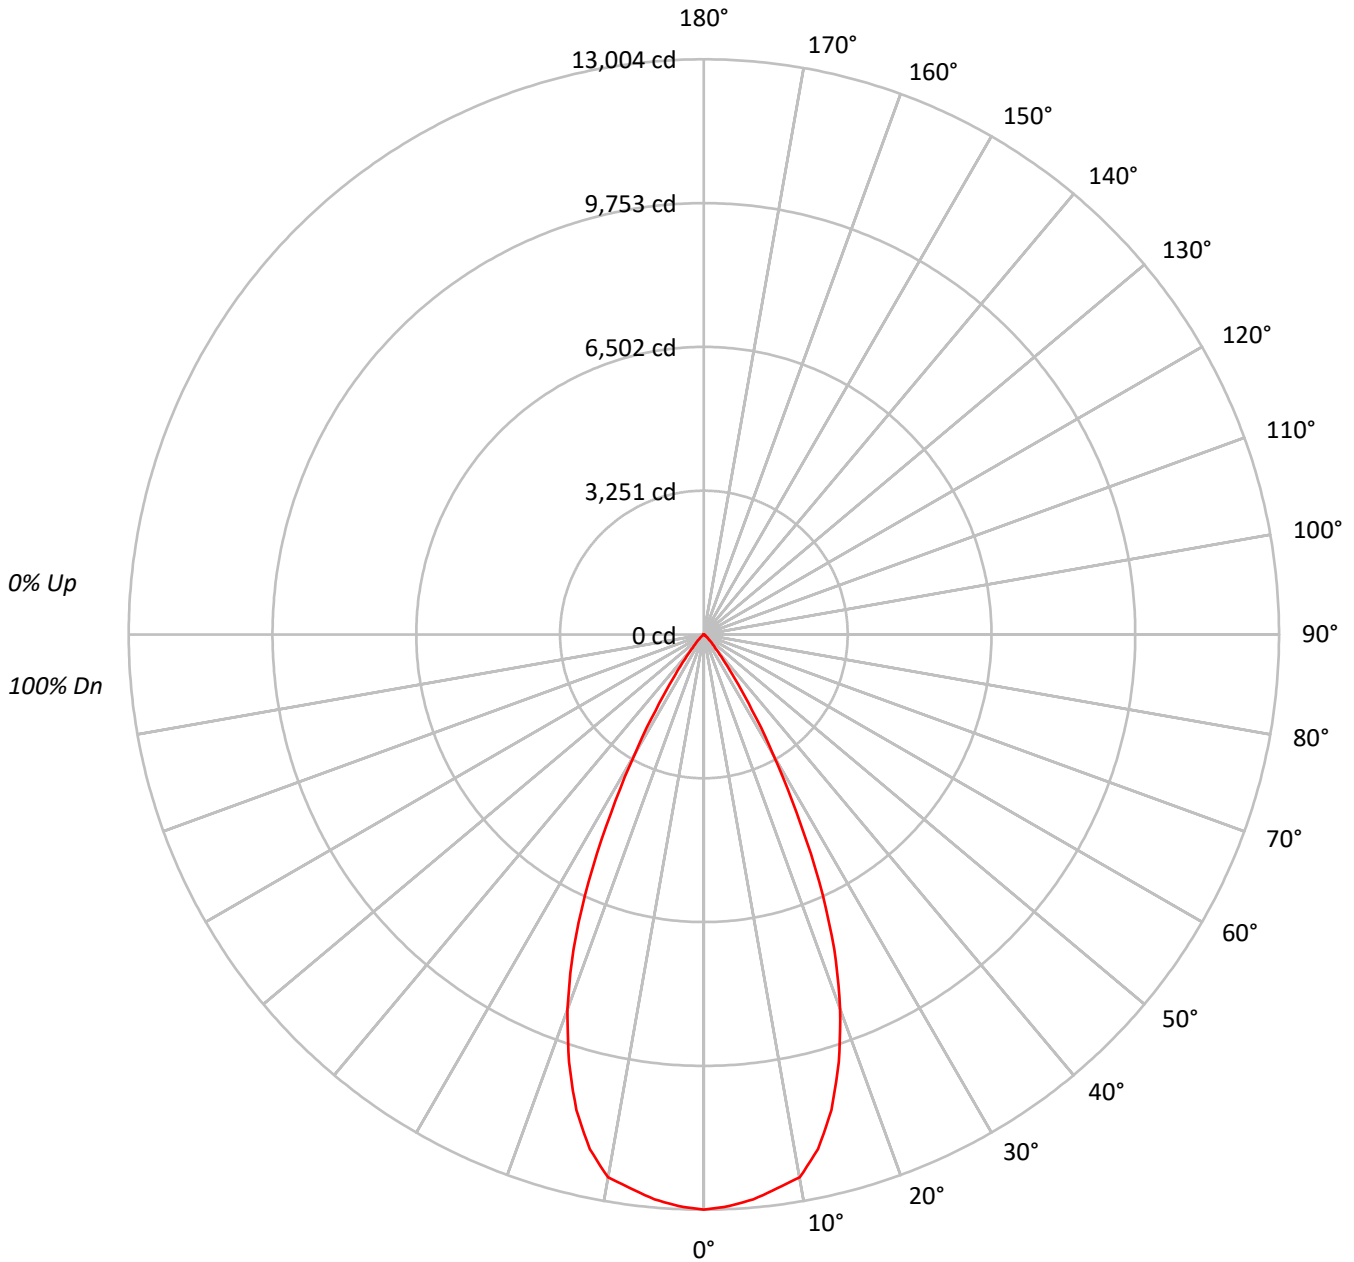



TEST NUMBER: P751798

CATALOG NUMBER: LD4D65D010-EU4DR5055659040-4LBS1LI

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			
1	114	112	109	107	112	110	108	106	106	104	102	102	101	99	98	97	97	95			
2	109	105	101	98	107	103	100	97	100	98	95	97	95	93	95	93	91	90			
3	105	99	95	91	103	98	94	90	95	92	89	93	90	88	91	88	86	85			
4	100	94	89	85	99	93	88	85	90	87	84	89	85	83	87	84	82	80			
5	96	89	84	80	95	88	83	79	86	82	79	85	81	78	83	80	77	76			
6	92	84	79	75	91	83	79	75	82	78	74	81	77	74	79	76	74	72			
7	88	80	75	71	87	79	74	71	78	74	71	77	73	70	76	73	70	69			
8	85	76	71	67	84	76	71	67	75	70	67	74	70	67	73	69	66	65			
9	81	73	68	64	80	72	67	64	71	67	64	71	67	64	70	66	63	62			
10	78	70	64	61	77	69	64	61	68	64	61	68	64	61	67	63	60	59			

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	1420772
5°	1405876
10°	1382723
15°	1259084
20°	1047700
25°	743709
30°	393643
35°	160419
40°	59576
45°	27272
50°	11185
55°	5848
60°	2884
65°	853
70°	0
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 27272 cd/sqm



TEST NUMBER: P751798

CATALOG NUMBER: LD4D65D010-EU4DR5055659040-4LBS1LI

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	1211.6	15.0
10°-20°	3061.9	37.9
20°-30°	2750.4	34.1
30°-40°	861.2	10.7
40°-50°	150.8	1.9
50°-60°	30.0	0.4
60°-70°	4.6	0.1
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	7023.9	87.0
0°-40°	7885.0	97.7
0°-60°	8065.9	99.9
0°-90°	8070.4	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	8070.4	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	13004	
5°	12818	###
15°	11131	3062
25°	6169	2750
35°	1203	861
45°	176	151
55°	31	30
65°	3	5
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P751798

CATALOG NUMBER: LD4D65D010-EU4DR5055659040-4LBS1LI

CANDELA DISTRIBUTION (FULL):

0°	
0°	13003.5
2.5°	12938.8
5°	12818.2
7.5°	12634.0
10°	12463.0
12.5°	11914.8
15°	11131.0
17.5°	10135.5
20°	9010.7
22.5°	7709.3
25°	6169.0
27.5°	4535.5
30°	3120.1
32.5°	2031.5
35°	1202.7
37.5°	690.7
40°	417.7
42.5°	271.9
45°	176.5
47.5°	107.4
50°	65.8
52.5°	44.9
55°	30.7
57.5°	20.8
60°	13.2
62.5°	7.7
65°	3.3
67.5°	1.1
70°	0.0
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)