

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P753106

Luminaire Tested: LD4D75BD010-EU4DR3570959035-4LBDP1H

Issue Date: 1/30/2024

Test Information

Test Method: LM-79-2019
Report Number: P753106
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-20)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 1/30/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LD4D75BD010-EU4DR3570959035-4LBDP1H
Description: 4 INCH ROUND DEEP 45° CUTOFF SEMI-SPECULAR CLEAR TRIM, WITH 35° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 3500K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 6919.7 lumens
Efficiency: N/A
Efficacy: 95.6 lumens/watt
Spacing Criteria (0/90/45): 0.6 / 0.6 / 0.54
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct

Input Watts (W): 72.4
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT




Downlight

TEST NUMBER: P753106

CATALOG NUMBER: LD4D75BD010-EU4DR3570959035-4LBDP1H

Luminous Intensity Polar Plot

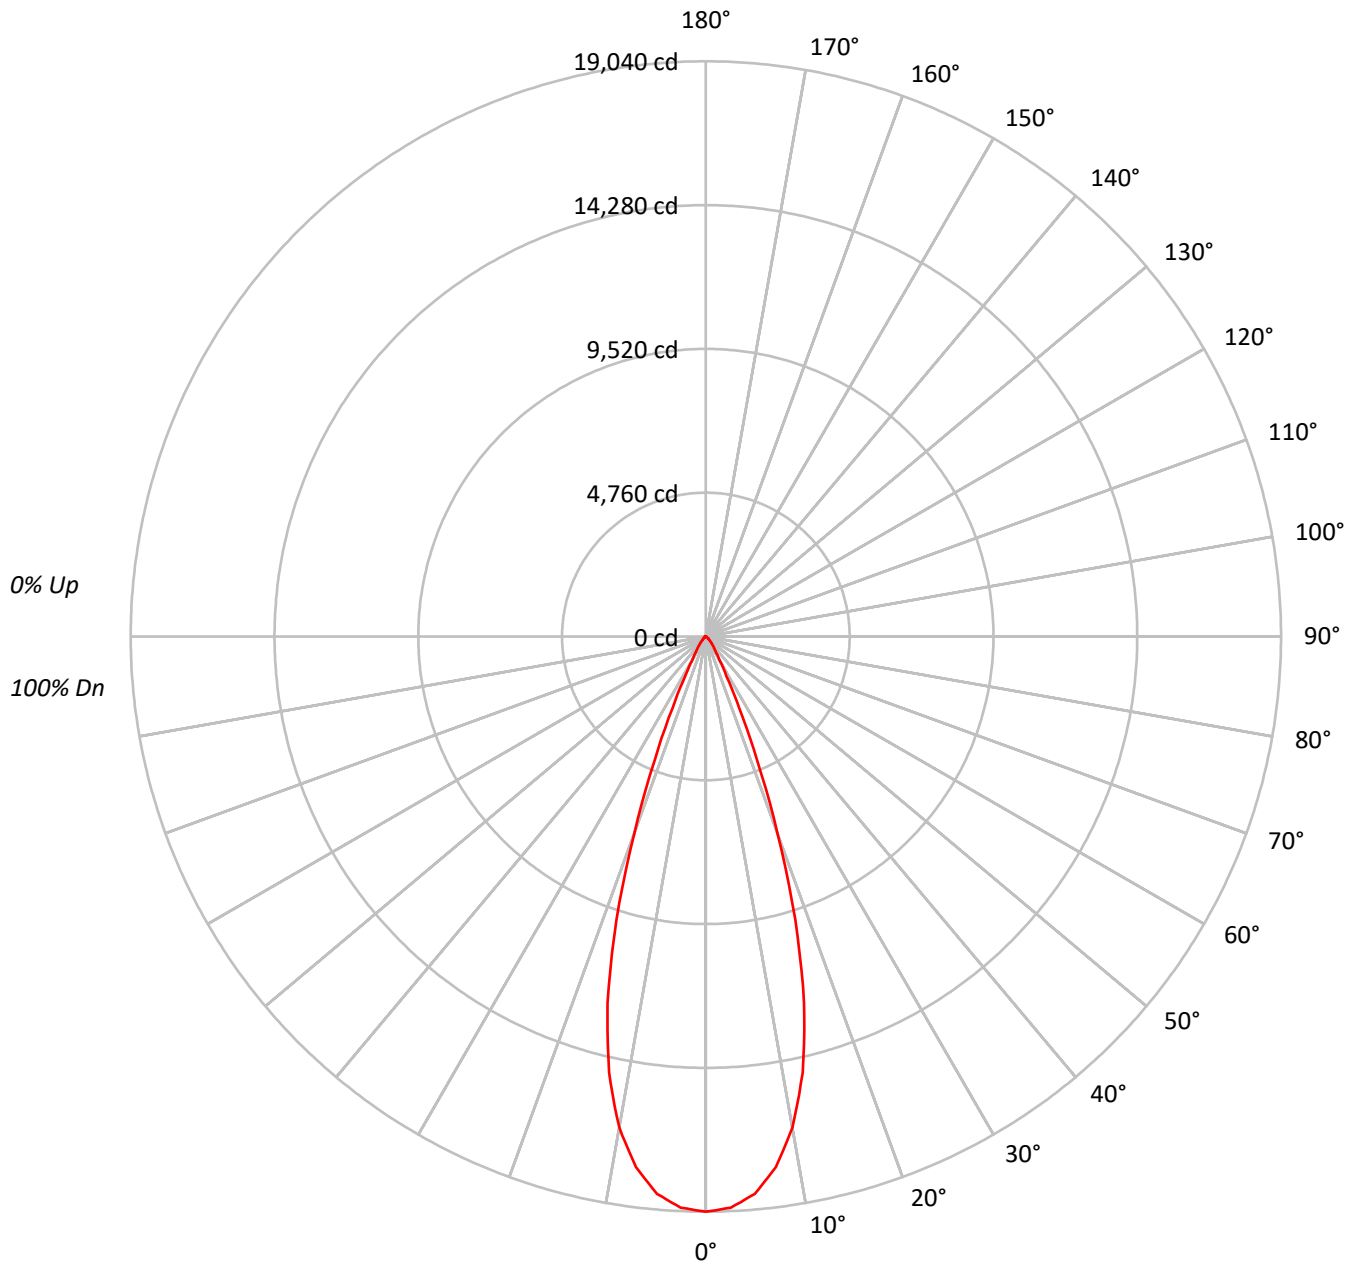



TEST NUMBER: P753106

CATALOG NUMBER: LD4D75BD010-EU4DR3570959035-4LBDP1H

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20					20					20					20					20
RC	80					70					50					30					10
RW	70	50	30	10		70	50	30	10		50	30	10		50	30	10		50	30	10
RCR																					
0	119	119	119	119		116	116	116	116		111	111	111		106	106	106		102	102	102
1	115	112	110	108		112	110	108	107		106	105	103		103	101	100		99	98	98
2	110	106	103	101		108	105	102	99		102	99	97		99	97	95		96	95	93
3	106	101	97	94		105	100	96	93		97	95	92		95	93	91		93	91	89
4	103	97	92	89		101	96	92	89		94	90	88		92	89	87		90	88	86
5	99	93	88	85		98	92	87	84		90	86	84		89	85	83		87	84	82
6	96	89	84	81		94	88	84	81		87	83	80		85	82	80		84	81	79
7	93	85	81	78		91	85	80	77		84	80	77		83	79	77		82	79	76
8	90	82	78	74		88	82	77	74		81	77	74		80	76	74		79	76	73
9	87	79	75	72		86	79	75	72		78	74	71		77	74	71		77	73	71
10	84	77	72	69		83	76	72	69		76	72	69		75	71	69		74	71	69

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	2080292
5°	2031414
10°	1830835
15°	1421019
20°	805980
25°	313566
30°	116979
35°	64117
40°	41905
45°	25511
50°	16233
55°	11468
60°	8391
65°	4576
70°	319
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 25511 cd/sqm



TEST NUMBER: P753106

CATALOG NUMBER: LD4D75BD010-EU4DR3570959035-4LBDP1H

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	1703.4	24.6
10°-20°	3325.8	48.1
20°-30°	1356.4	19.6
30°-40°	324.6	4.7
40°-50°	135.3	2.0
50°-60°	56.0	0.8
60°-70°	17.5	0.3
70°-80°	0.4	0.0
80°-90°	0.3	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	6385.7	92.3
0°-40°	6710.3	97.0
0°-60°	6901.5	99.7
0°-90°	6919.7	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	6919.7	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	19040	
5°	18522	###
15°	12563	3326
25°	2601	1356
35°	481	325
45°	165	135
55°	60	56
65°	18	18
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P753106

CATALOG NUMBER: LD4D75BD010-EU4DR3570959035-4LBDP1H

CANDELA DISTRIBUTION (FULL):

0°	
0°	19039.7
2.5°	18925.5
5°	18521.6
7.5°	17715.8
10°	16502.0
12.5°	14793.0
15°	12562.6
17.5°	9835.0
20°	6931.8
22.5°	4420.1
25°	2601.0
27.5°	1470.3
30°	927.2
32.5°	651.0
35°	480.7
37.5°	371.7
40°	293.8
42.5°	226.4
45°	165.1
47.5°	123.6
50°	95.5
52.5°	75.8
55°	60.2
57.5°	48.8
60°	38.4
62.5°	28.0
65°	17.7
67.5°	6.2
70°	1.0
72.5°	1.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	1.0
85°	0.0
87.5°	0.0
90°	0.0



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report





— 0°-180°







(END OF REPORT)