

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P753268

Luminaire Tested: LD4D75BD010-EU4DR4570959035-4LBS1MW

Issue Date: 1/30/2024

Test Information

Test Method: LM-79-2019
Report Number: P753268
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-36)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 1/30/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LD4D75BD010-EU4DR4570959035-4LBS1MW
Description: 4 INCH ROUND SHALLOW MATTE WHITE TRIM, WITH 45° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 3500K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 7416.3 lumens
Efficiency: N/A
Efficacy: 102.4 lumens/watt
Spacing Criteria (0/90/45): 0.75 / 0.75 / 0.69
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct

Input Watts (W): 72.4
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT




Downlight

TEST NUMBER: P753268

CATALOG NUMBER: LD4D75BD010-EU4DR4570959035-4LBS1MW

Luminous Intensity Polar Plot

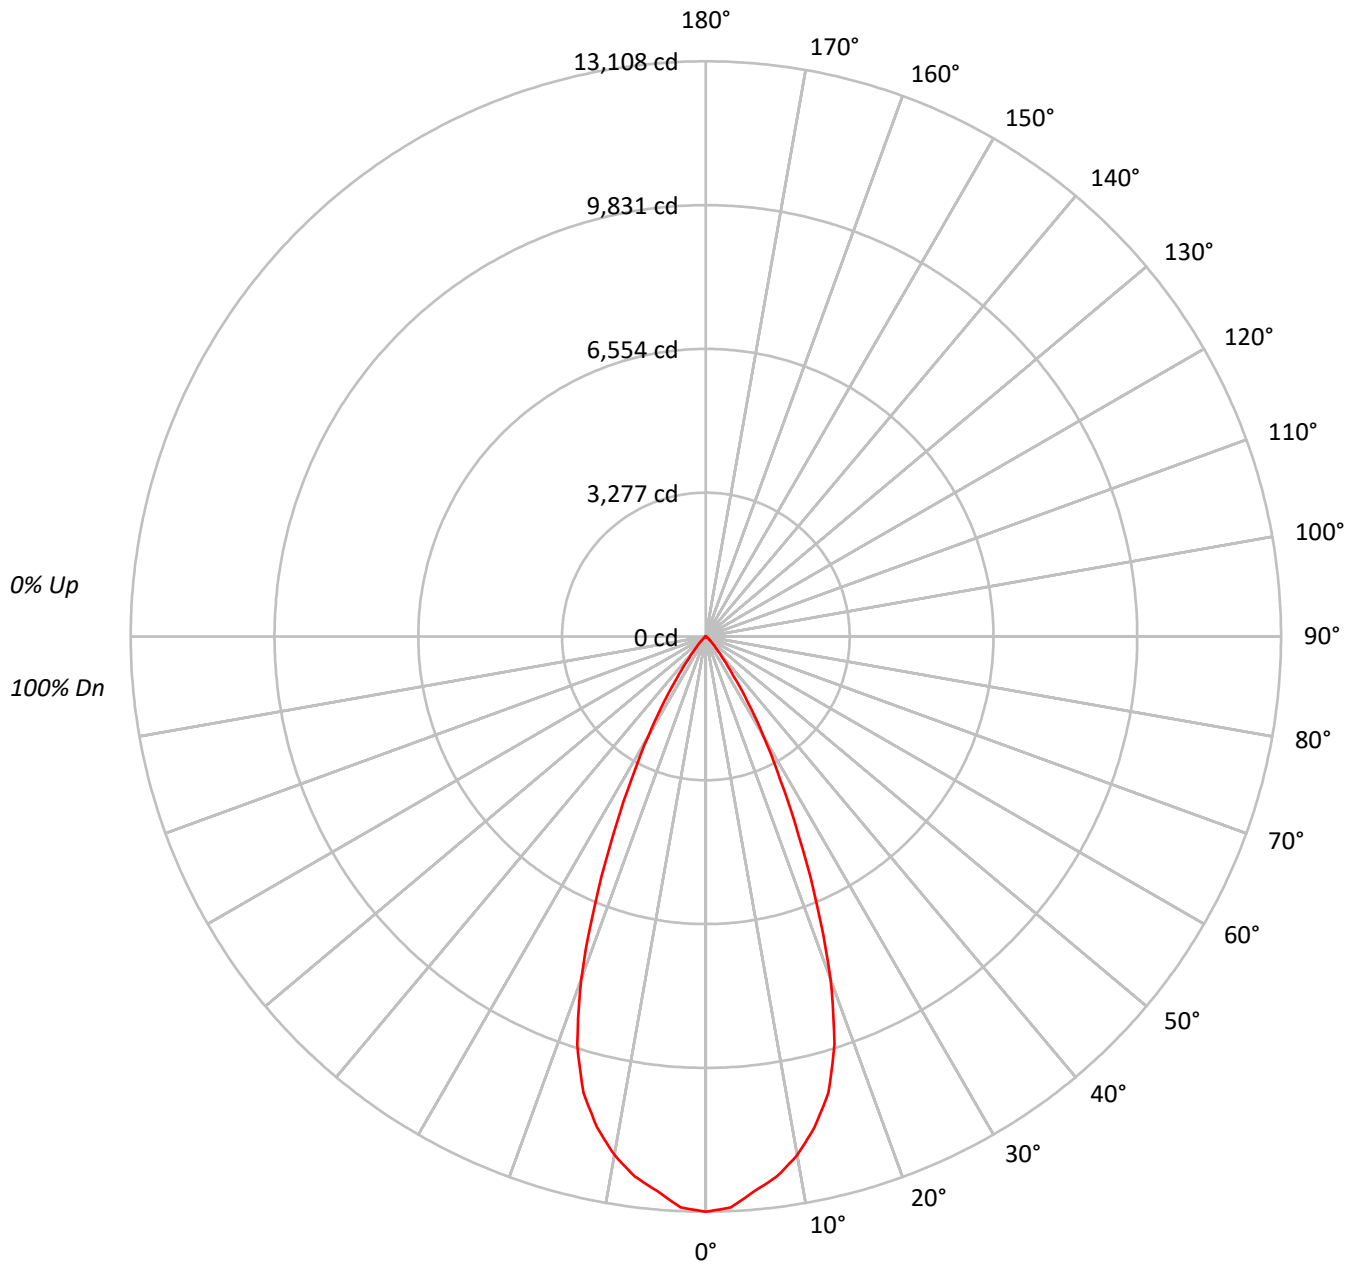



TEST NUMBER: P753268

CATALOG NUMBER: LD4D75BD010-EU4DR4570959035-4LBS1MW

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20					20					20					20
RC	80				70					50					30					10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10
RCR																				
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100		
1	114	112	110	108	112	110	108	106	106	104	103	102	101	100	98	98	97	95		
2	109	105	102	99	107	103	100	98	100	98	95	97	95	93	95	93	91	90		
3	105	99	95	91	103	98	94	91	95	92	89	93	90	88	91	89	87	85		
4	100	94	89	85	99	93	88	85	91	87	84	89	86	83	87	84	82	81		
5	96	89	84	80	95	88	83	80	86	82	79	85	81	79	83	80	78	77		
6	92	85	80	76	91	84	79	76	83	78	75	81	77	75	80	77	74	73		
7	89	81	75	72	87	80	75	72	79	74	71	78	74	71	77	73	71	69		
8	85	77	72	68	84	76	71	68	75	71	68	74	70	67	73	70	67	66		
9	82	73	68	65	81	73	68	65	72	68	65	71	67	64	71	67	64	63		
10	79	70	65	62	78	70	65	62	69	65	62	68	64	61	68	64	61	60		

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	1432245
5°	1391464
10°	1331255
15°	1218385
20°	966600
25°	603467
30°	332605
35°	149349
40°	58821
45°	27721
50°	13139
55°	6877
60°	3387
65°	801
70°	319
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 27721 cd/sqm



TEST NUMBER: P753268

CATALOG NUMBER: LD4D75BD010-EU4DR4570959035-4LBS1MW

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	1192.0	16.1
10°-20°	2933.8	39.6
20°-30°	2323.3	31.3
30°-40°	773.7	10.4
40°-50°	153.6	2.1
50°-60°	34.9	0.5
60°-70°	5.0	0.1
70°-80°	0.1	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	6449.1	87.0
0°-40°	7222.7	97.4
0°-60°	7411.2	99.9
0°-90°	7416.3	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	7416.3	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	13108	
5°	12687	###
15°	10771	2934
25°	5006	2323
35°	1120	774
45°	179	154
55°	36	35
65°	3	5
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P753268

CATALOG NUMBER: LD4D75BD010-EU4DR4570959035-4LBS1MW

CANDELA DISTRIBUTION (FULL):

	0°
0°	13108.5
2.5°	13022.9
5°	12686.8
7.5°	12409.5
10°	11999.1
12.5°	11452.7
15°	10771.2
17.5°	9746.3
20°	8313.2
22.5°	6605.8
25°	5005.7
27.5°	3665.3
30°	2636.3
32.5°	1793.0
35°	1119.7
37.5°	664.0
40°	412.4
42.5°	271.2
45°	179.4
47.5°	115.5
50°	77.3
52.5°	51.6
55°	36.1
57.5°	23.7
60°	15.5
62.5°	8.2
65°	3.1
67.5°	1.0
70°	1.0
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report





— 0°-180°







(END OF REPORT)