

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P753132

Luminaire Tested: LD4D75BD010-EU4DR3570959050-4LBDP1H

Issue Date: 1/30/2024

Test Information

Test Method: LM-79-2019
Report Number: P753132
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-20)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 1/30/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LD4D75BD010-EU4DR3570959050-4LBDP1H
Description: 4 INCH ROUND DEEP 45° CUTOFF SEMI-SPECULAR CLEAR TRIM, WITH 35° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 5000K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 7295.0 lumens
Efficiency: N/A
Efficacy: 100.8 lumens/watt
Spacing Criteria (0/90/45): 0.6 / 0.6 / 0.54
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct

Input Watts (W): 72.4
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT




Downlight

TEST NUMBER: P753132

CATALOG NUMBER: LD4D75BD010-EU4DR3570959050-4LBDP1H

Luminous Intensity Polar Plot

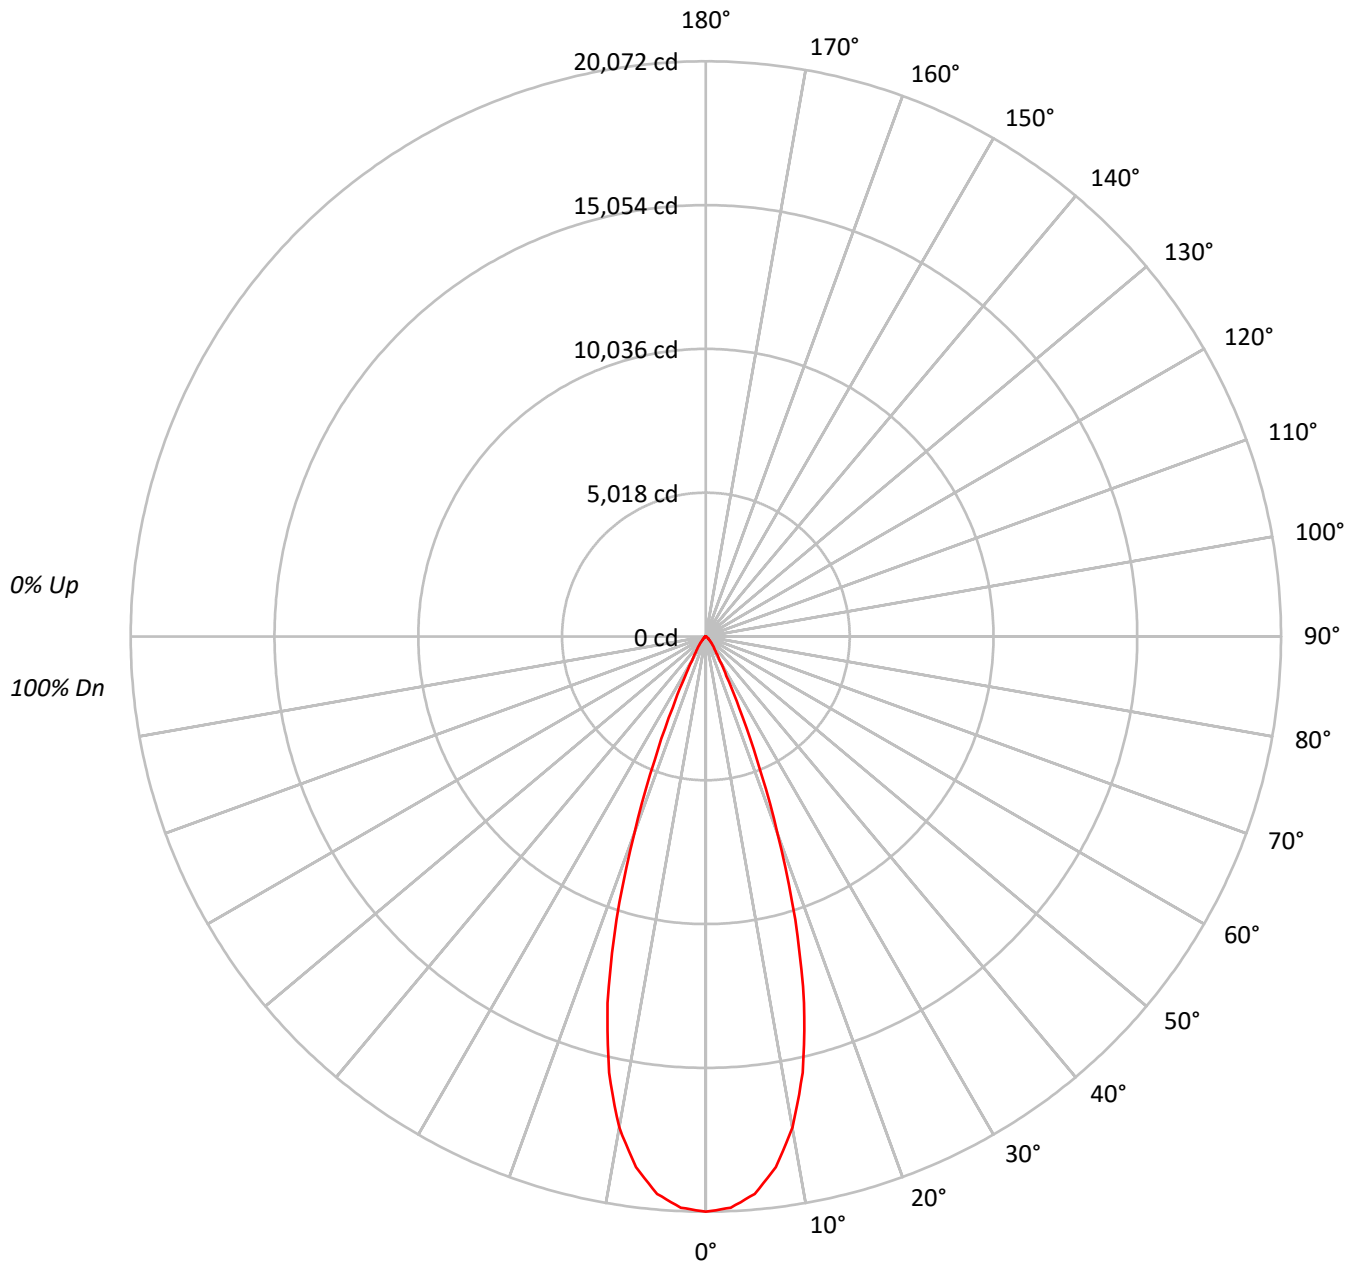



TEST NUMBER: P753132

CATALOG NUMBER: LD4D75BD010-EU4DR3570959050-4LBDP1H

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20					20					20					20					20
RC	80					70					50					30					10
RW	70	50	30	10		70	50	30	10		50	30	10		50	30	10		50	30	10
RCR																					
0	119	119	119	119		116	116	116	116		111	111	111		106	106	106		102	102	102
1	115	112	110	108		112	110	108	107		106	105	103		103	101	100		99	98	98
2	110	106	103	101		108	105	102	99		102	99	97		99	97	95		96	95	93
3	106	101	97	94		105	100	96	93		97	95	92		95	93	91		93	91	89
4	103	97	92	89		101	96	92	89		94	90	88		92	89	87		90	88	86
5	99	93	88	85		98	92	87	84		90	86	84		89	85	83		87	84	82
6	96	89	84	81		94	88	84	81		87	83	80		85	82	80		84	81	79
7	93	85	81	78		91	85	80	77		84	80	77		83	79	77		82	79	76
8	90	82	78	74		88	82	77	74		81	77	74		80	76	74		79	76	73
9	87	79	75	72		86	79	75	72		78	74	71		77	74	71		77	73	71
10	84	77	72	69		83	76	72	69		76	72	69		75	71	69		74	71	69

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	2193104
5°	2141575
10°	1930121
15°	1498084
20°	849687
25°	330564
30°	123325
35°	67598
40°	44187
45°	26886
50°	17117
55°	12096
60°	8850
65°	4809
70°	351
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 26886 cd/sqm



TEST NUMBER: P753132

CATALOG NUMBER: LD4D75BD010-EU4DR3570959050-4LBDP1H

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	1795.8	24.6
10°-20°	3506.2	48.1
20°-30°	1430.0	19.6
30°-40°	342.2	4.7
40°-50°	142.6	2.0
50°-60°	59.0	0.8
60°-70°	18.5	0.3
70°-80°	0.4	0.0
80°-90°	0.3	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	6732.0	92.3
0°-40°	7074.2	97.0
0°-60°	7275.8	99.7
0°-90°	7295.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	7295.0	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	20072	
5°	19526	###
15°	13244	3506
25°	2742	1430
35°	507	342
45°	174	143
55°	64	59
65°	19	18
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P753132

CATALOG NUMBER: LD4D75BD010-EU4DR3570959050-4LBDP1H

CANDELA DISTRIBUTION (FULL):

	0°
0°	20072.2
2.5°	19951.8
5°	19526.0
7.5°	18676.5
10°	17396.9
12.5°	15595.2
15°	13243.9
17.5°	10368.3
20°	7307.7
22.5°	4659.8
25°	2742.0
27.5°	1550.0
30°	977.5
32.5°	686.3
35°	506.8
37.5°	391.9
40°	309.8
42.5°	238.6
45°	174.0
47.5°	130.3
50°	100.7
52.5°	79.9
55°	63.5
57.5°	51.4
60°	40.5
62.5°	29.6
65°	18.6
67.5°	6.6
70°	1.1
72.5°	1.1
75°	0.0
77.5°	0.0
80°	0.0
82.5°	1.1
85°	0.0
87.5°	0.0
90°	0.0



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report





— 0°-180°







(END OF REPORT)