

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P753212

Luminaire Tested: LD4D75BD010-EU4DR4070959050-4LBDP1MW

Issue Date: 1/30/2024

Test Information

Test Method: LM-79-2019
Report Number: P753212
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-28)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 1/30/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LD4D75BD010-EU4DR4070959050-4LBDP1MW
Description: 4 INCH ROUND DEEP 45° CUTOFF MATTE WHITE TRIM, WITH 40° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 5000K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 7564.4 lumens
Efficiency: N/A
Efficacy: 104.5 lumens/watt
Spacing Criteria (0/90/45): 0.68 / 0.68 / 0.6
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct

Input Watts (W): 72.4
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT




Downlight

TEST NUMBER: P753212

CATALOG NUMBER: LD4D75BD010-EU4DR4070959050-4LBDP1MW

Luminous Intensity Polar Plot

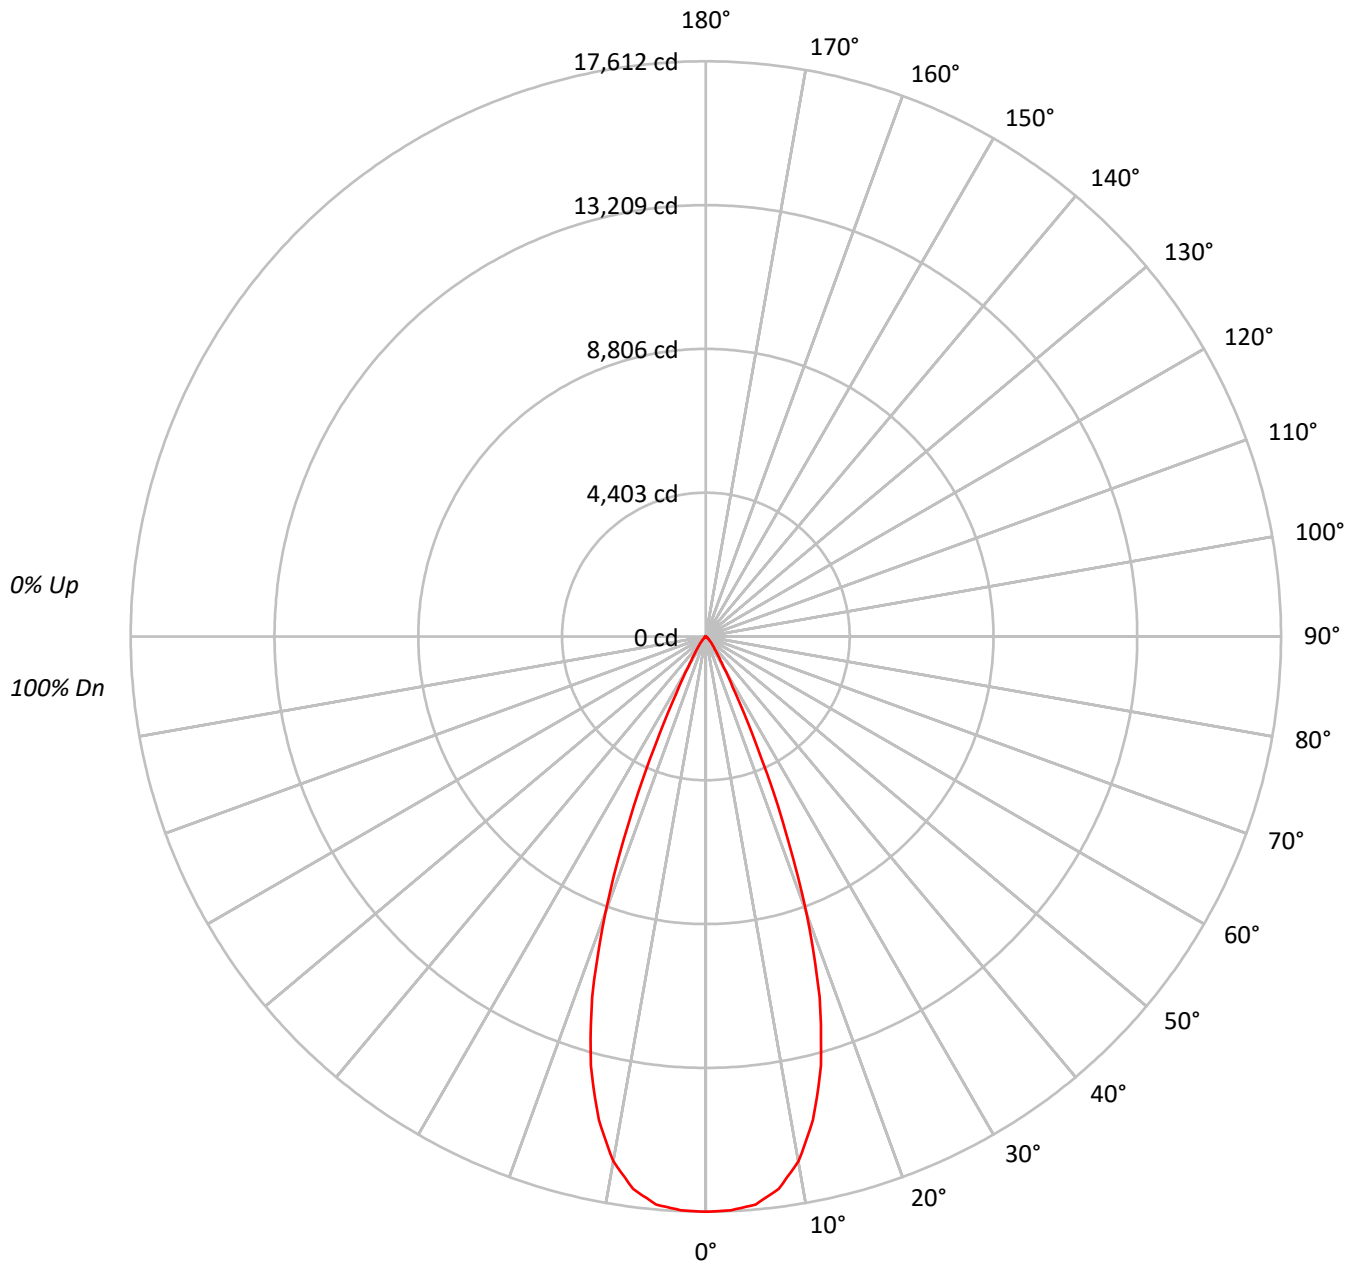

TEST NUMBER: P753212

CATALOG NUMBER: LD4D75BD010-EU4DR4070959050-4LBDP1MW

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10		50	30	10		50
RCR																	
0	119	119	119	119	116	116	116	116	111	111	111		106	106	106		102
1	115	112	110	108	112	110	108	107	106	105	103		103	101	100		99
2	110	106	103	100	108	105	102	99	102	99	97		99	97	95		96
3	106	101	97	94	104	100	96	93	97	94	92		95	93	90		93
4	102	97	92	89	101	95	91	88	93	90	87		92	89	86		90
5	99	92	88	84	97	91	87	84	90	86	83		88	85	83		87
6	95	88	84	80	94	88	83	80	86	82	80		85	82	79		84
7	92	85	80	77	91	84	80	77	83	79	76		82	79	76		81
8	89	82	77	74	88	81	77	74	80	76	73		79	76	73		78
9	86	79	74	71	85	78	74	71	77	73	71		76	73	70		76
10	83	76	71	68	82	75	71	68	75	71	68		74	70	68		73

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	1924300
5°	1914947
10°	1810044
15°	1538761
20°	1048781
25°	437594
30°	137594
35°	63944
40°	35372
45°	16209
50°	7870
55°	4305
60°	2251
65°	801
70°	319
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 16209 cd/sqm

TEST NUMBER: P753212

CATALOG NUMBER: LD4D75BD010-EU4DR4070959050-4LBDP1MW

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	1630.3	21.6
10°-20°	3652.3	48.3
20°-30°	1828.2	24.2
30°-40°	335.1	4.4
40°-50°	92.5	1.2
50°-60°	21.7	0.3
60°-70°	4.2	0.1
70°-80°	0.1	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	7110.8	94.0
0°-40°	7445.9	98.4
0°-60°	7560.1	99.9
0°-90°	7564.4	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	7564.4	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	17612	
5°	17460	###
15°	13604	3652
25°	3630	1828
35°	479	335
45°	105	92
55°	23	22
65°	3	4
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P753212

CATALOG NUMBER: LD4D75BD010-EU4DR4070959050-4LBDP1MW

CANDELA DISTRIBUTION (FULL):

0°	
0°	17612.0
2.5°	17586.3
5°	17459.7
7.5°	17056.4
10°	16314.6
12.5°	15158.2
15°	13603.5
17.5°	11581.8
20°	9020.0
22.5°	6149.5
25°	3629.8
27.5°	1918.8
30°	1090.6
32.5°	704.8
35°	479.4
37.5°	342.6
40°	248.0
42.5°	169.8
45°	104.9
47.5°	66.9
50°	46.3
52.5°	32.9
55°	22.6
57.5°	14.4
60°	10.3
62.5°	6.2
65°	3.1
67.5°	2.1
70°	1.0
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report





— 0°-180°







(END OF REPORT)