

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P741726

Luminaire Tested: LD4D08D010-EU4DR700210IC9027-4LBDP1MW

Issue Date: 2/5/2024

Test Information

Test Method: LM-79-2019
Report Number: P741726
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-73)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/5/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LD4D08D010-EU4DR700210IC9027-4LBDP1MW
Description: 4 INCH ROUND DEEP 45° CUTOFF MATTE WHITE TRIM, WITH 70° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 2700K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 570.8 lumens
Efficiency: N/A
Efficacy: 64.1 lumens/watt
Spacing Criteria (0/90/45): 0.88 / 0.88 / 0.82
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct

Input Watts (W): 8.9
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT




Downlight



TEST NUMBER: P741726

CATALOG NUMBER: LD4D08D010-EU4DR700210IC9027-4LBDP1MW

Luminous Intensity Polar Plot

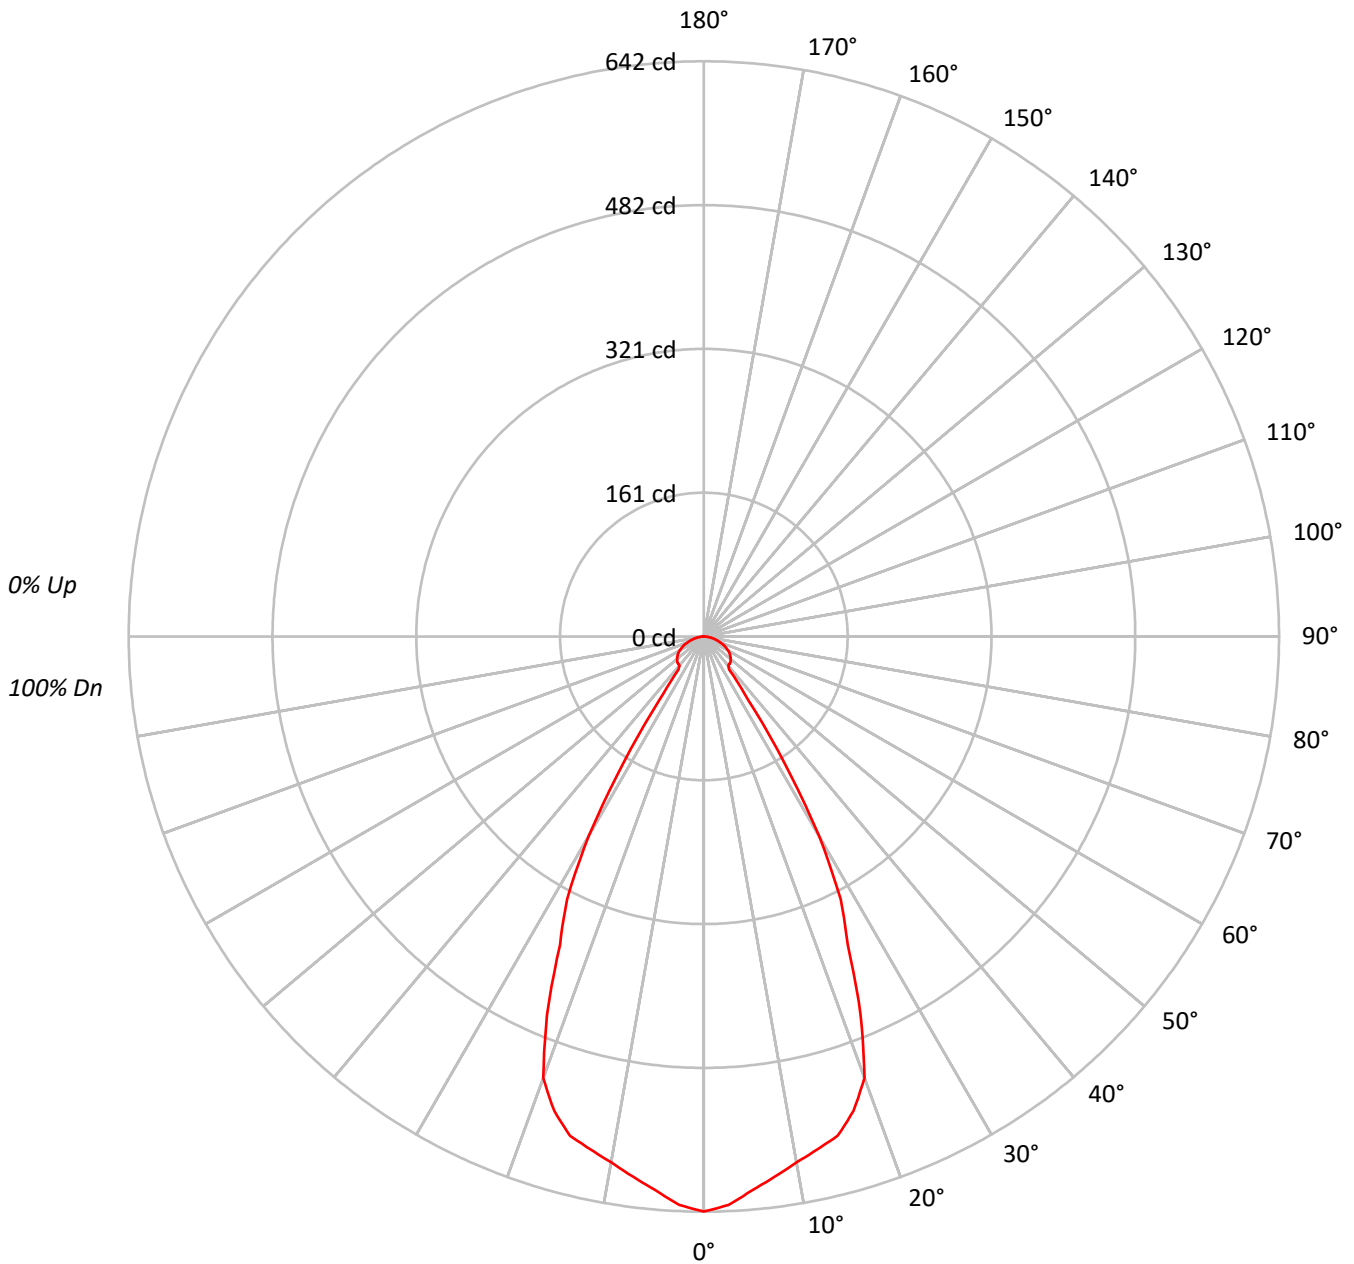



TEST NUMBER: P741726
 CATALOG NUMBER: LD4D08D010-EU4DR700210IC9027-4LBDP1MW

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			100
1	112	109	106	103	110	107	104	102	103	101	99	99	97	96	95	94	93	91			91
2	106	100	95	91	103	98	94	90	95	91	88	92	89	86	89	87	85	83			83
3	100	92	87	82	98	91	86	81	88	84	80	86	82	79	83	80	78	76			76
4	94	86	80	75	92	85	79	74	82	77	73	80	76	73	78	75	72	70			70
5	89	80	74	69	87	79	73	69	77	72	68	75	71	67	74	70	67	65			65
6	85	75	68	64	83	74	68	64	73	67	63	71	66	63	70	66	62	61			61
7	80	70	64	59	79	70	64	59	68	63	59	67	62	59	66	62	58	57			57
8	77	66	60	56	75	66	60	56	65	59	55	64	59	55	63	58	55	53			53
9	73	63	57	52	72	62	56	52	61	56	52	60	55	52	60	55	52	50			50
10	70	59	53	49	69	59	53	49	58	53	49	57	52	49	57	52	49	48			48

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	70124
5°	68033
10°	66135
15°	65267
20°	60950
25°	45787
30°	32374
35°	11458
40°	6033
45°	6412
50°	6646
55°	6781
60°	6818
65°	6670
70°	6293
75°	5826
80°	5222
85°	4262

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 60°
 Luminance: 6818 cd/sqm



TEST NUMBER: P741726

CATALOG NUMBER: LD4D08D010-EU4DR700210IC9027-4LBDP1MW

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	58.5	10.3
10°-20°	160.5	28.1
20°-30°	176.7	31.0
30°-40°	67.5	11.8
40°-50°	31.9	5.6
50°-60°	31.7	5.6
60°-70°	25.4	4.4
70°-80°	14.6	2.6
80°-90°	4.0	0.7
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	395.7	69.3
0°-40°	463.3	81.2
0°-60°	526.8	92.3
0°-90°	570.8	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	570.8	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	642	
5°	620	59
15°	577	160
25°	380	177
35°	86	68
45°	42	32
55°	36	32
65°	26	25
75°	14	15
85°	3	4
90°	0	



TEST NUMBER: P741726

CATALOG NUMBER: LD4D08D010-EU4DR700210IC9027-4LBDP1MW

CANDELA DISTRIBUTION (FULL):

	0°
0°	641.8
2.5°	635.1
5°	620.3
7.5°	608.0
10°	596.1
12.5°	586.1
15°	577.0
17.5°	555.2
20°	524.2
22.5°	457.3
25°	379.8
27.5°	330.6
30°	256.6
32.5°	165.7
35°	85.9
37.5°	46.4
40°	42.3
42.5°	41.9
45°	41.5
47.5°	40.6
50°	39.1
52.5°	37.4
55°	35.6
57.5°	33.5
60°	31.2
62.5°	28.5
65°	25.8
67.5°	22.7
70°	19.7
72.5°	16.7
75°	13.8
77.5°	10.9
80°	8.3
82.5°	5.8
85°	3.4
87.5°	1.3
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)