

Scaled data based on original data using  
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-  
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P741600

Luminaire Tested: LD4D08D010-EU4DR600210IC9035-4LBS1MW

Issue Date: 1/30/2024

**Test Information**

Test Method: LM-79-2019  
Report Number: P741600  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-60)  
Test Lab: COOPER LIGHTING SOLUTIONS  
Issue Date: 1/30/2024  
Manufacturer: COOPER LIGHTING SOLUTIONS  
Product Line: PORTFOLIO  
Catalog Number: LD4D08D010-EU4DR600210IC9035-4LBS1MW  
Description: 4 INCH ROUND SHALLOW MATTE WHITE TRIM, WITH 60° OPTIC  
Light Source: (1) HIGH LUMEN LED 90CRI / 3500K CCT  
Ballast/Driver: -

**Summary**

Lumens per Lamp: N/A  
Luminaire Lumens: 791.7 lumens  
Efficiency: N/A  
Efficacy: 89.0 lumens/watt  
Spacing Criteria (0/90/45): 0.98 / 0.98 / 0.92  
Luminous Opening: Circular (Dia: 0.35' x H: 0')  
CIE Type: Direct

Input Watts (W): 8.9  
Input Voltage (V): NR  
Input Current (A<sub>in</sub>): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 24 FT




Downlight



TEST NUMBER: P741600  
CATALOG NUMBER: LD4D08D010-EU4DR600210IC9035-4LBS1MW

### Luminous Intensity Polar Plot

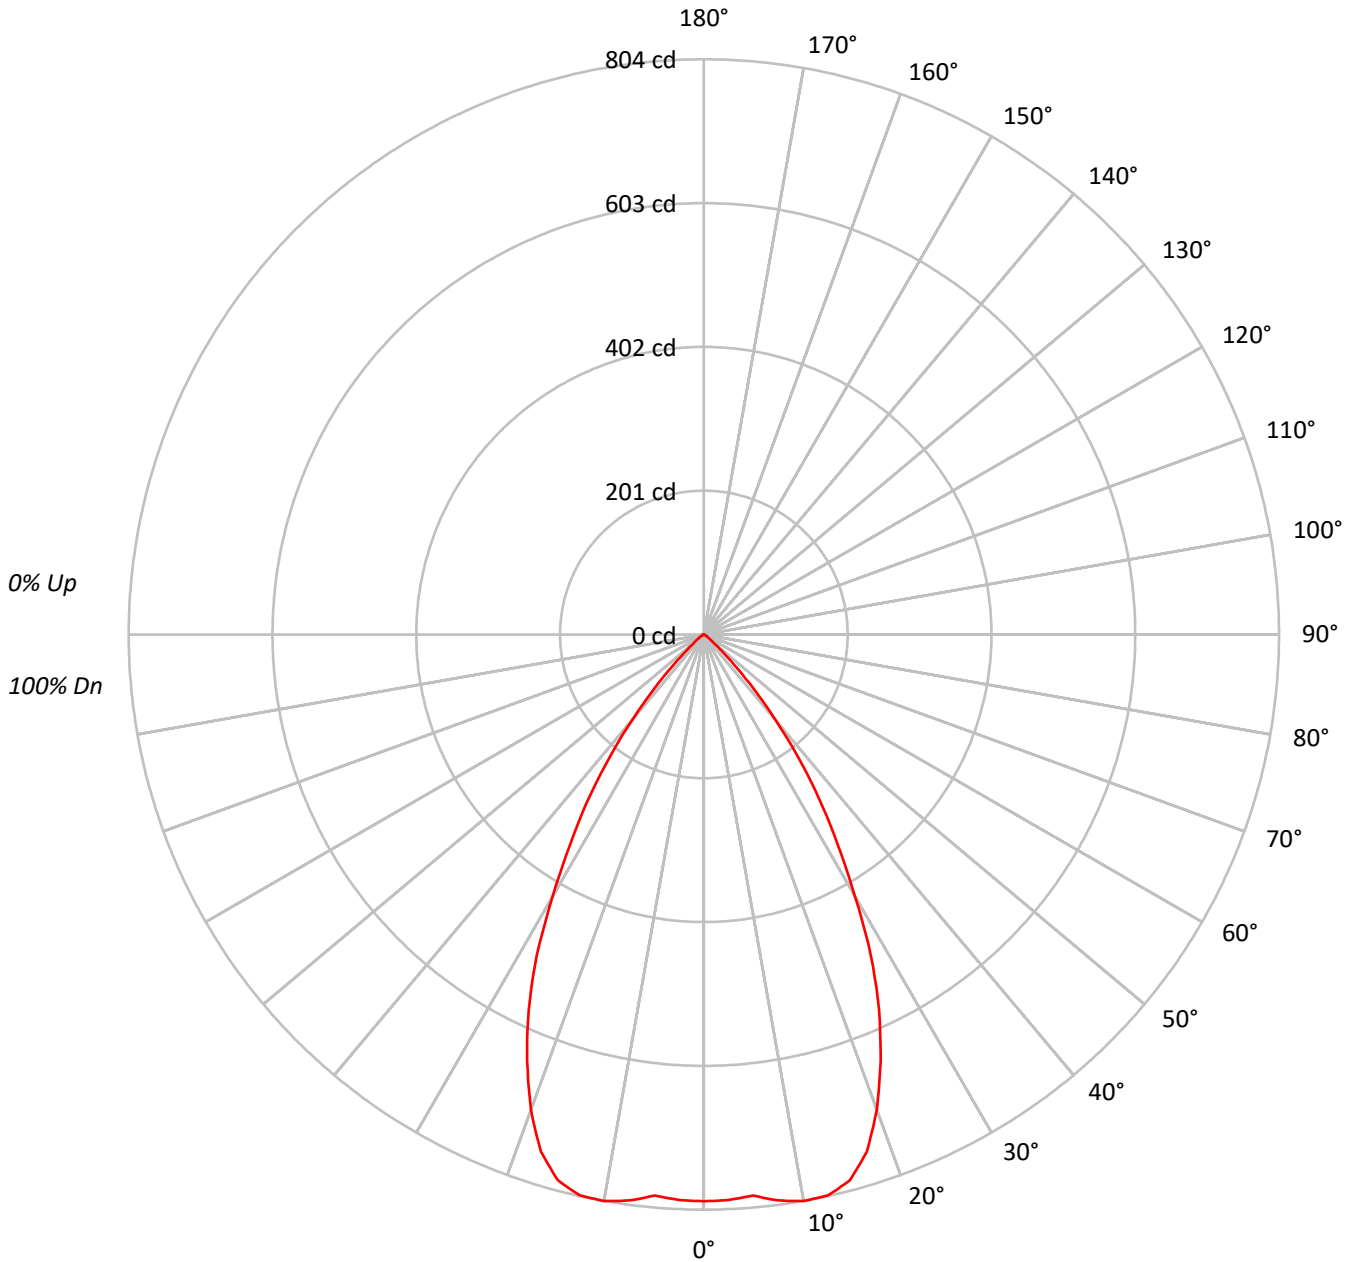



TEST NUMBER: P741600

CATALOG NUMBER: LD4D08D010-EU4DR600210IC9035-4LBS1MW

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20				20				20				20				20	
RC	80				70				50				30				10	0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																		
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100
1	114	111	108	106	111	109	106	104	105	103	101	101	99	98	97	96	95	94
2	108	103	99	96	106	101	98	95	98	95	92	95	93	90	92	90	89	87
3	102	96	91	87	100	95	90	86	92	88	85	90	86	84	87	85	82	81
4	97	90	84	80	95	88	83	79	86	82	78	84	81	78	82	79	77	75
5	92	84	78	74	91	83	77	73	81	76	73	79	75	72	78	74	71	70
6	88	79	73	68	86	78	72	68	76	71	68	75	70	67	74	70	67	65
7	83	74	68	63	82	73	67	63	72	67	63	71	66	63	69	65	62	61
8	79	69	63	59	78	69	63	59	68	63	59	67	62	59	66	61	58	57
9	75	65	59	55	74	65	59	55	64	59	55	63	58	55	62	58	55	53
10	72	62	56	52	71	61	56	52	61	55	52	60	55	52	59	55	52	50

**AVERAGE LUMINANCE (cd/sqm):**

	0°
0°	86567
5°	86350
10°	89223
15°	89316
20°	82170
25°	69898
30°	53266
35°	37667
40°	22108
45°	8931
50°	2975
55°	1429
60°	590
65°	78
70°	0
75°	0
80°	0
85°	0

**MAXIMUM LUMINANCE 45°-90°:**

Horizontal Angle: 0°  
 Vertical Angle: 45°  
 Luminance: 8931 cd/sqm



TEST NUMBER: P741600

CATALOG NUMBER: LD4D08D010-EU4DR600210IC9035-4LBS1MW

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	75.9	9.6
10°-20°	218.7	27.6
20°-30°	261.8	33.1
30°-40°	175.1	22.1
40°-50°	51.9	6.6
50°-60°	7.4	0.9
60°-70°	0.7	0.1
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	556.5	70.3
0°-40°	731.6	92.4
0°-60°	791.0	99.9
0°-90°	791.7	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	791.7	100.0

**CANDELA DISTRIBUTION:**

	0°	Flux
0°	792	
5°	787	76
15°	790	219
25°	580	262
35°	282	175
45°	58	52
55°	8	7
65°	0	1
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P741600

CATALOG NUMBER: LD4D08D010-EU4DR600210IC9035-4LBS1MW

**CANDELA DISTRIBUTION (FULL):**

	0°
0°	792.3
2.5°	791.2
5°	787.3
7.5°	798.0
10°	804.2
12.5°	803.0
15°	789.6
17.5°	757.8
20°	706.7
22.5°	645.5
25°	579.8
27.5°	505.7
30°	422.2
32.5°	347.6
35°	282.4
37.5°	217.1
40°	155.0
42.5°	102.3
45°	57.8
47.5°	29.6
50°	17.5
52.5°	11.3
55°	7.5
57.5°	4.8
60°	2.7
62.5°	1.1
65°	0.3
67.5°	0.1
70°	0.0
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report





Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)