

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P754198

Luminaire Tested: LD4D80BD010-EU4DR5570959035-4LBDP1H

Issue Date: 1/30/2024

Test Information

Test Method: LM-79-2019
Report Number: P754198
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-52)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 1/30/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LD4D80BD010-EU4DR5570959035-4LBDP1H
Description: 4 INCH ROUND DEEP 45° CUTOFF SEMI-SPECULAR CLEAR TRIM, WITH 55° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 3500K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 7864.2 lumens
Efficiency: N/A
Efficacy: 99.7 lumens/watt
Spacing Criteria (0/90/45): 0.89 / 0.89 / 0.87
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct


Input Watts (W): 78.9
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT



Downlight

TEST NUMBER: P754198
CATALOG NUMBER: LD4D80BD010-EU4DR5570959035-4LBDP1H

Luminous Intensity Polar Plot

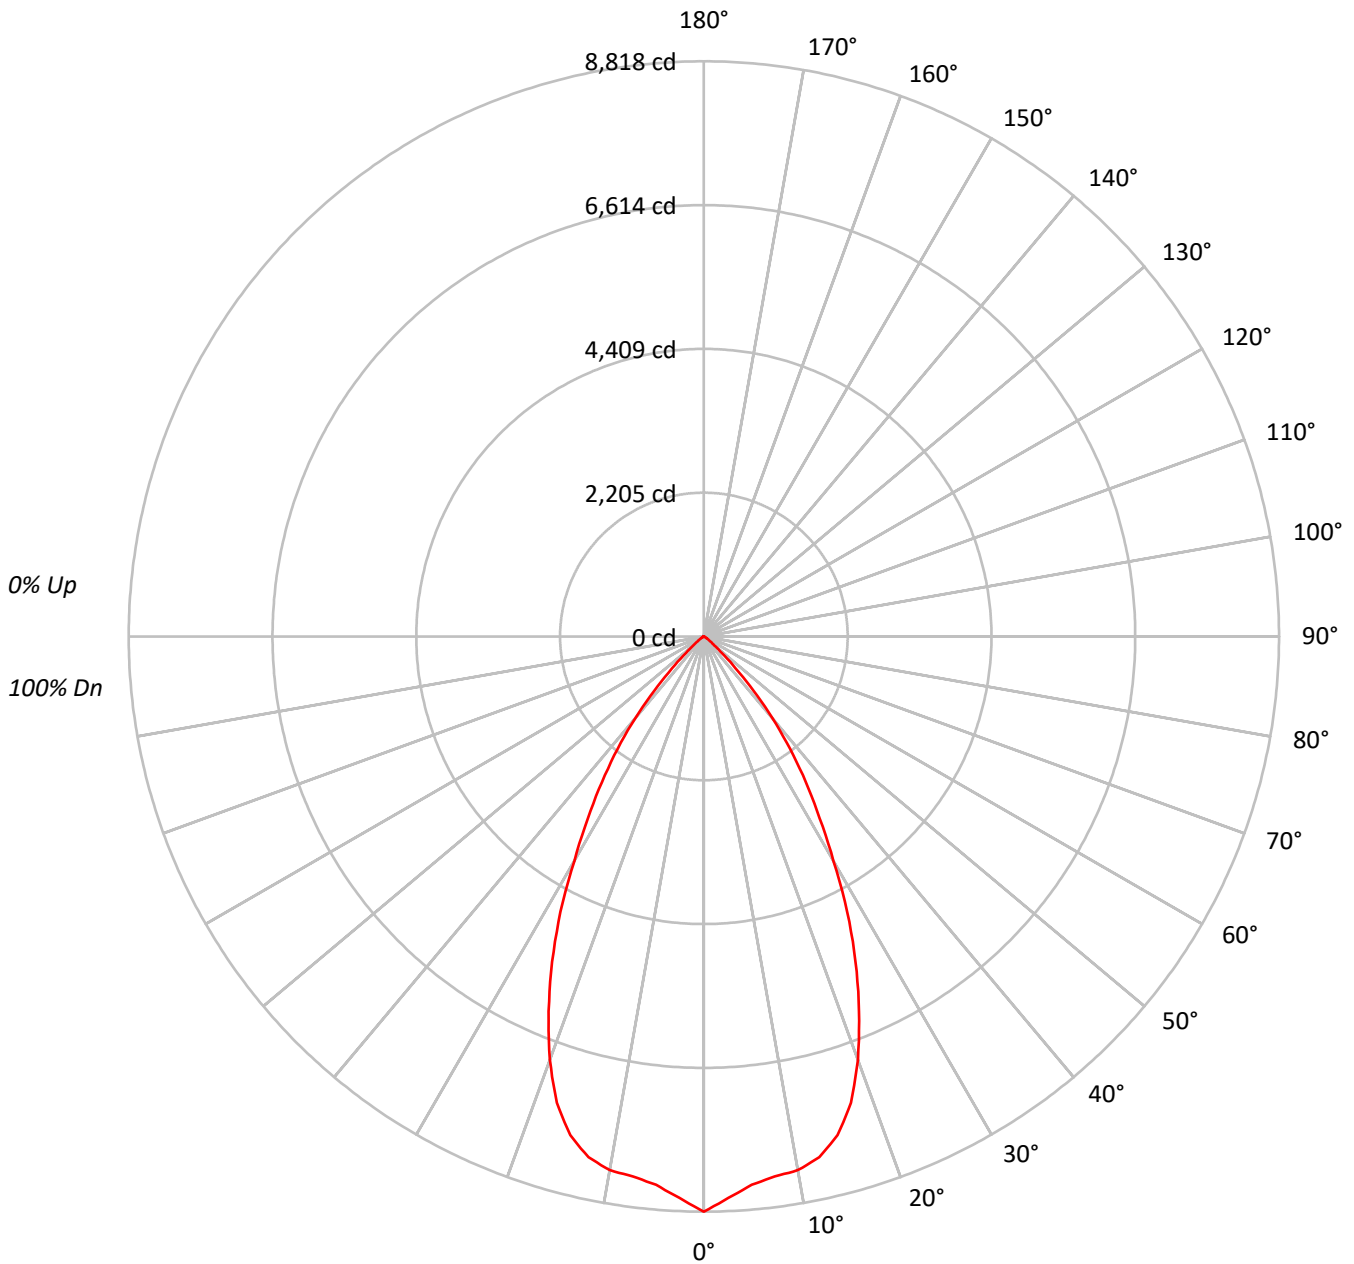



TEST NUMBER: P754198

CATALOG NUMBER: LD4D80BD010-EU4DR5570959035-4LBDP1H

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			
1	114	111	108	106	111	109	106	104	105	103	101	101	99	98	97	96	95	94			
2	108	103	99	96	106	101	98	95	98	95	92	95	93	90	92	90	89	87			
3	102	96	91	87	100	95	90	86	92	88	85	90	86	84	87	85	82	81			
4	97	90	84	80	95	88	83	79	86	82	78	84	81	78	82	79	77	75			
5	92	84	78	74	91	83	77	73	81	76	73	79	75	72	78	74	71	70			
6	88	79	73	68	86	78	72	68	76	71	68	75	70	67	74	70	67	65			
7	83	74	68	64	82	73	67	63	72	67	63	71	66	63	70	65	62	61			
8	79	69	63	59	78	69	63	59	68	63	59	67	62	59	66	62	58	57			
9	75	66	60	56	74	65	59	55	64	59	55	63	58	55	62	58	55	54			
10	72	62	56	52	71	61	56	52	61	56	52	60	55	52	59	55	52	50			

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	963505
5°	925245
10°	921753
15°	895272
20°	802748
25°	663431
30°	501134
35°	363361
40°	232544
45°	106200
50°	34727
55°	14992
60°	6446
65°	853
70°	0
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 106200 cd/sqm



TEST NUMBER: P754198

CATALOG NUMBER: LD4D80BD010-EU4DR5570959035-4LBDP1H

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	802.7	10.2
10°-20°	2190.8	27.9
20°-30°	2496.6	31.7
30°-40°	1699.6	21.6
40°-50°	585.7	7.4
50°-60°	81.0	1.0
60°-70°	7.8	0.1
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	5490.1	69.8
0°-40°	7189.7	91.4
0°-60°	7856.4	99.9
0°-90°	7864.2	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	7864.2	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	8818	
5°	8436	803
15°	7915	2191
25°	5503	2497
35°	2724	1700
45°	687	586
55°	79	81
65°	3	8
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P754198

CATALOG NUMBER: LD4D80BD010-EU4DR5570959035-4LBDP1H

CANDELA DISTRIBUTION (FULL):

0°	
0°	8818.4
2.5°	8616.3
5°	8436.0
7.5°	8347.5
10°	8308.1
12.5°	8177.0
15°	7914.7
17.5°	7498.4
20°	6904.0
22.5°	6217.7
25°	5503.1
27.5°	4758.9
30°	3972.1
32.5°	3305.6
35°	2724.2
37.5°	2171.3
40°	1630.4
42.5°	1129.9
45°	687.3
47.5°	370.4
50°	204.3
52.5°	121.3
55°	78.7
57.5°	50.3
60°	29.5
62.5°	13.1
65°	3.3
67.5°	1.1
70°	0.0
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)