

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P755068

Luminaire Tested: LD4D85BD010-EU4DR6070959040-4LBDP1B

Issue Date: 2/5/2024

Test Information

Test Method: LM-79-2019
Report Number: P755068
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-57)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/5/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LD4D85BD010-EU4DR6070959040-4LBDP1B
Description: 4 INCH ROUND DEEP 45° CUTOFF SPECULAR BLACK TRIM, WITH 60° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 4000K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 6767.9 lumens
Efficiency: N/A
Efficacy: 77.2 lumens/watt
Spacing Criteria (0/90/45): 0.91 / 0.91 / 0.83
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct


Input Watts (W): 87.7
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT



Downlight

TEST NUMBER: P755068
CATALOG NUMBER: LD4D85BD010-EU4DR6070959040-4LBDP1B

Luminous Intensity Polar Plot

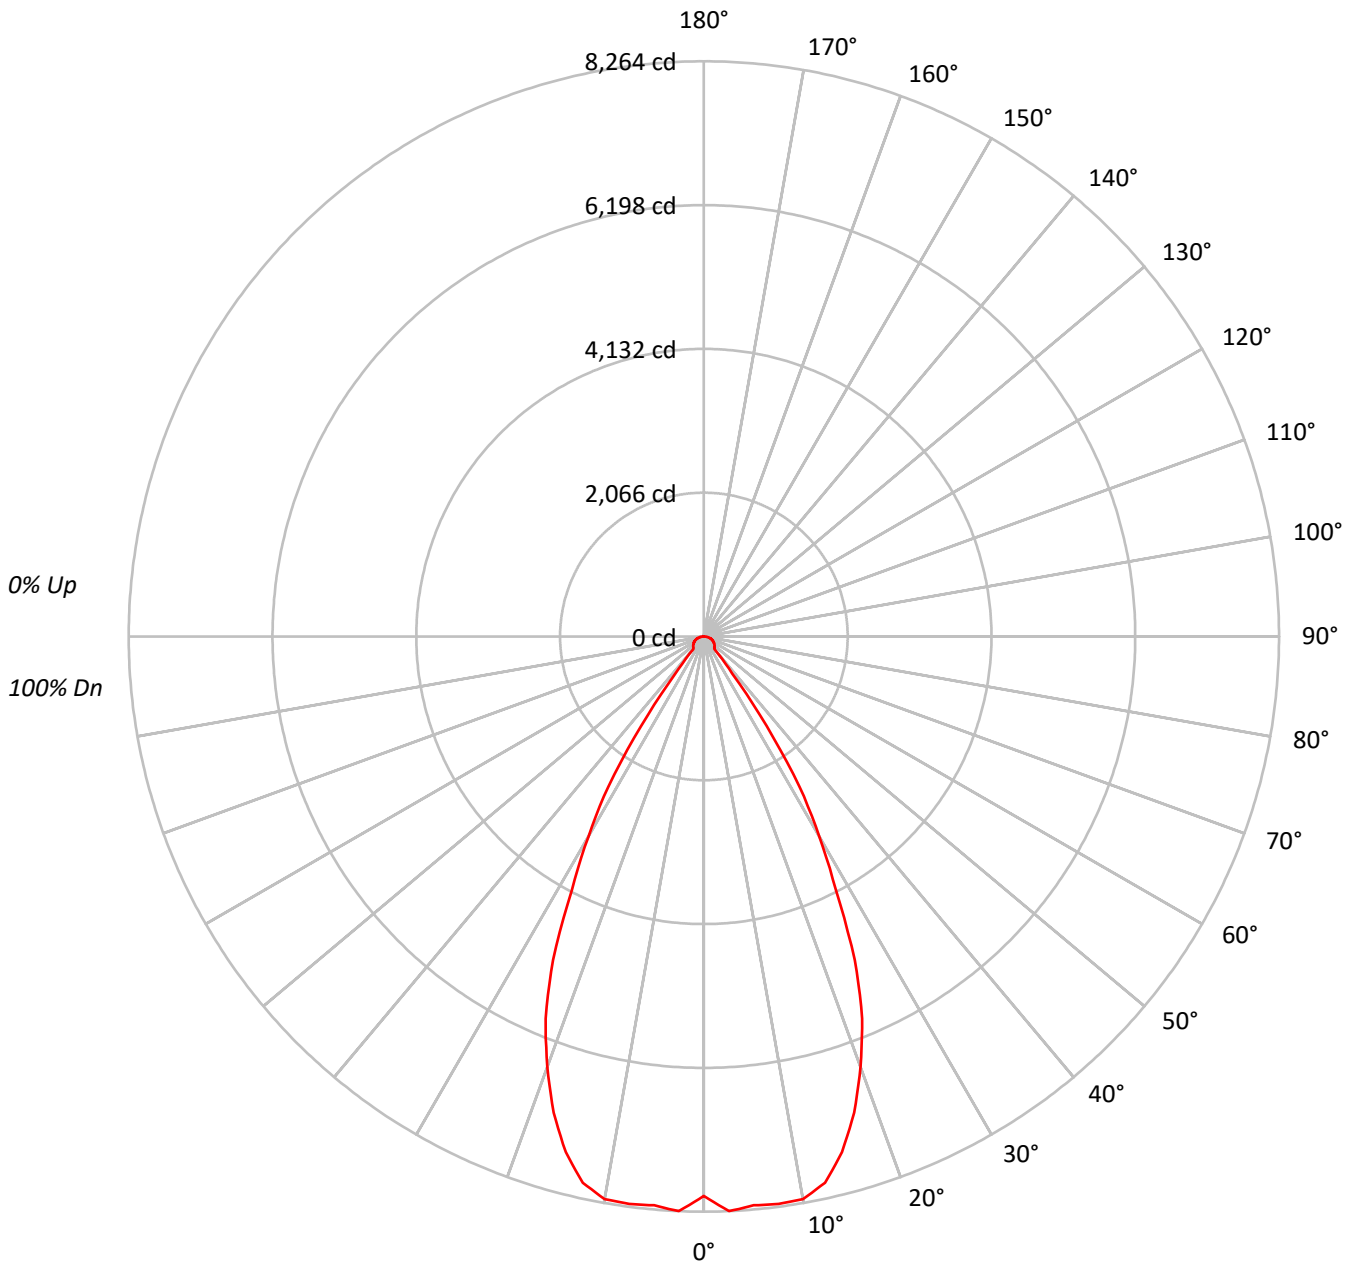



TEST NUMBER: P755068

CATALOG NUMBER: LD4D85BD010-EU4DR6070959040-4LBDP1B

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			100
1	113	110	108	105	111	108	106	104	104	102	100	100	99	97	97	96	95	93			93
2	107	102	98	95	105	101	97	94	97	94	92	94	92	90	92	90	88	86			86
3	102	96	90	86	100	94	89	86	91	88	84	89	86	83	87	84	82	80			80
4	97	89	84	80	95	88	83	79	86	82	78	84	80	77	82	79	76	75			75
5	92	84	78	74	91	83	78	74	81	77	73	80	76	72	78	75	72	70			70
6	88	79	73	69	87	78	73	69	77	72	68	75	71	68	74	70	67	66			66
7	84	75	69	65	83	74	68	64	73	68	64	72	67	64	71	67	63	62			62
8	80	71	65	61	79	70	65	61	69	64	60	68	64	60	67	63	60	59			59
9	77	67	61	57	75	67	61	57	66	61	57	65	60	57	64	60	57	55			55
10	73	64	58	54	72	63	58	54	62	58	54	62	57	54	61	57	54	53			53

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	878194
5°	899799
10°	910658
15°	867525
20°	764889
25°	618669
30°	418472
35°	209704
40°	34017
45°	33299
50°	33962
55°	34479
60°	35422
65°	36246
70°	37089
75°	37529
80°	36179
85°	30212

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 75°
 Luminance: 37529 cd/sqm



TEST NUMBER: P755068

CATALOG NUMBER: LD4D85BD010-EU4DR6070959040-4LBDP1B

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	784.1	11.6
10°-20°	2121.4	31.3
20°-30°	2282.5	33.7
30°-40°	992.1	14.7
40°-50°	166.7	2.5
50°-60°	162.0	2.4
60°-70°	138.6	2.0
70°-80°	92.7	1.4
80°-90°	27.8	0.4
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	5188.0	76.7
0°-40°	6180.1	91.3
0°-60°	6508.8	96.2
0°-90°	6767.9	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	6767.9	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	8038	
5°	8204	784
15°	7669	2121
25°	5132	2282
35°	1572	992
45°	216	167
55°	181	162
65°	140	139
75°	89	93
85°	24	28
90°	0	



TEST NUMBER: P755068

CATALOG NUMBER: LD4D85BD010-EU4DR6070959040-4LBDP1B

CANDELA DISTRIBUTION (FULL):

	0°
0°	8037.6
2.5°	8263.6
5°	8204.0
7.5°	8222.8
10°	8208.1
12.5°	8038.7
15°	7669.4
17.5°	7173.6
20°	6578.4
22.5°	5941.4
25°	5131.8
27.5°	4104.6
30°	3316.9
32.5°	2556.5
35°	1572.2
37.5°	672.6
40°	238.5
42.5°	219.7
45°	215.5
47.5°	208.2
50°	199.8
52.5°	190.4
55°	181.0
57.5°	171.5
60°	162.1
62.5°	151.7
65°	140.2
67.5°	128.7
70°	116.1
72.5°	102.5
75°	88.9
77.5°	73.2
80°	57.5
82.5°	40.8
85°	24.1
87.5°	8.4
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)