

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P754616

Luminaire Tested: LD4D85BD010-EU4DR3070959050-4LBDP1MW

Issue Date: 1/30/2024

Test Information

Test Method: LM-79-2019
Report Number: P754616
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-16)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 1/30/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LD4D85BD010-EU4DR3070959050-4LBDP1MW
Description: 4 INCH ROUND DEEP 45° CUTOFF MATTE WHITE TRIM, WITH 30° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 5000K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 7518.9 lumens
Efficiency: N/A
Efficacy: 85.7 lumens/watt
Spacing Criteria (0/90/45): 0.52 / 0.52 / 0.49
Luminous Opening: Rectangular (W 0.38' x L: 0.38' x H: 0')
CIE Type: Direct

Input Watts (W): 87.7
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT




Downlight

TEST NUMBER: P754616

CATALOG NUMBER: LD4D85BD010-EU4DR3070959050-4LBDP1MW

Luminous Intensity Polar Plot

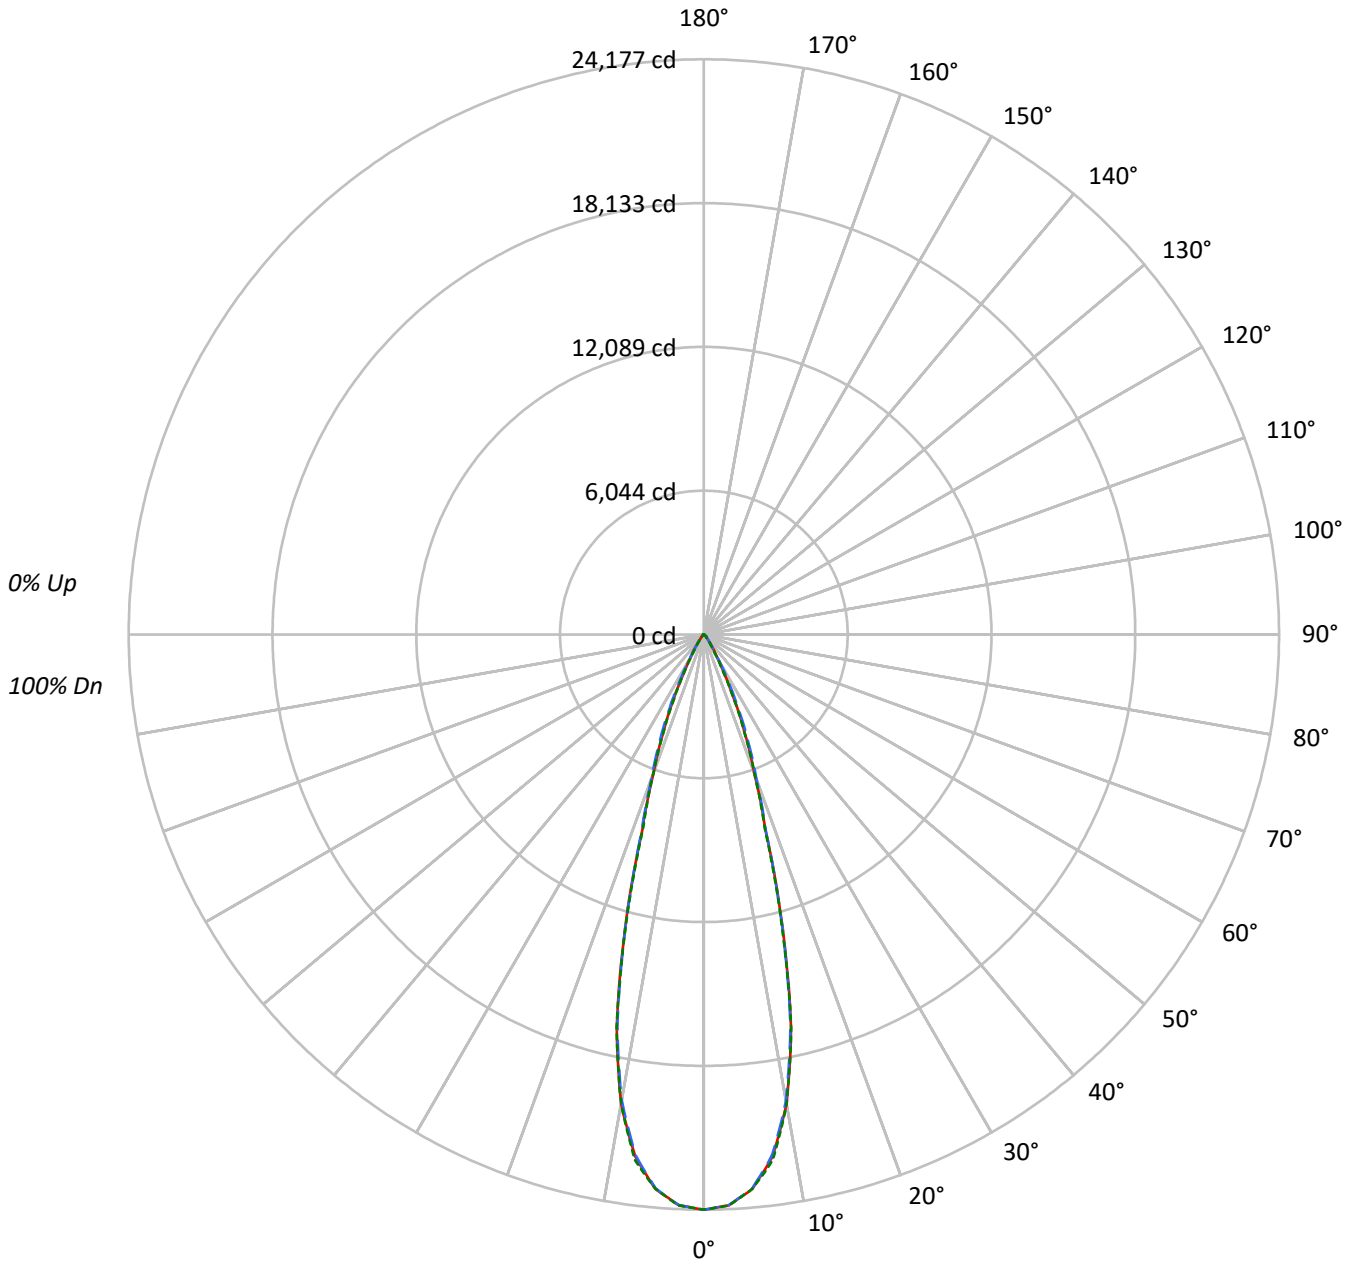



TEST NUMBER: P754616

CATALOG NUMBER: LD4D85BD010-EU4DR3070959050-4LBDP1MW

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0													
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100						100													
1	115	113	111	109	112	110	109	107	106	105	104	103	102	101	99	99	98	96						96													
2	111	107	104	101	109	105	102	100	102	100	98	99	97	96	97	95	94	92						92													
3	107	102	98	95	105	101	97	94	98	95	93	96	93	91	94	92	90	89						89													
4	103	98	93	90	102	96	93	90	94	91	89	93	90	88	91	89	87	85						85													
5	100	94	89	86	98	93	89	86	91	88	85	90	86	84	88	86	83	82						82													
6	97	90	85	82	95	89	85	82	88	84	81	87	83	81	85	83	80	79						79													
7	94	87	82	79	92	86	82	79	85	81	78	84	81	78	83	80	78	77						77													
8	91	84	79	76	90	83	79	76	82	78	76	81	78	75	80	77	75	74						74													
9	88	81	76	73	87	80	76	73	80	76	73	79	75	73	78	75	73	72						72													
10	85	78	74	71	85	78	74	71	77	73	71	76	73	71	76	73	70	69						69													

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1850574	1850574	1850574
5°	1797450	1795353	1797542
10°	1556862	1545880	1556497
15°	1015776	1010324	1005244
20°	505099	524046	504423
25°	254433	286915	249222
30°	101872	110994	88756
35°	47254	45254	37938
40°	20404	22652	19215
45°	14386	17861	14516
50°	4942	13004	5228
55°	2856	5391	3016
60°	2005	2358	2005
65°	1286	1286	1286
70°	806	537	806
75°	0	355	0
80°	0	0	0
85°	0	0	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 22.5°
 Vertical Angle: 45°
 Luminance: 17861 cd/sqm



TEST NUMBER: P754616

CATALOG NUMBER: LD4D85BD010-EU4DR3070959050-4LBDP1MW

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	2126.0	28.3
10°-20°	3423.9	45.5
20°-30°	1479.6	19.7
30°-40°	337.2	4.5
40°-50°	115.8	1.5
50°-60°	28.3	0.4
60°-70°	7.3	0.1
70°-80°	0.8	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	7029.5	93.5
0°-40°	7366.7	98.0
0°-60°	7510.8	99.9
0°-90°	7518.9	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	7518.9	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	24177	24177	24177	24177	24177	
5°	23393	23371	23366	23415	23395	2128
15°	12818	12664	12750	12708	12686	3432
25°	3013	3127	3397	3047	2951	1442
35°	506	516	484	481	406	343
45°	133	165	165	165	134	94
55°	21	23	40	24	23	21
65°	7	7	7	7	7	7
75°	0	0	1	0	0	1
85°	0	0	0	0	0	0
90°	0	0	0	0	0	0



TEST NUMBER: P754616

CATALOG NUMBER: LD4D85BD010-EU4DR3070959050-4LBDP1MW

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	24176.8	24176.8	24176.8	24176.8	24176.8
2.5°	24016.5	23999.9	24009.4	24021.3	24026.0
5°	23393.4	23370.8	23366.1	23414.7	23394.6
7.5°	22136.3	22104.3	22055.6	22166.0	22269.3
10°	20030.6	19995.0	19889.3	19941.6	20025.9
12.5°	16921.8	16806.7	16804.3	16970.5	16948.0
15°	12818.4	12664.1	12749.6	12708.0	12685.5
17.5°	8620.0	8560.6	8674.6	8640.2	8491.8
20°	6200.9	6216.3	6433.5	6324.3	6192.6
22.5°	4524.8	4580.6	4838.2	4556.9	4453.6
25°	3012.6	3126.6	3397.2	3047.0	2950.9
27.5°	1852.9	1905.1	2179.3	1829.2	1776.9
30°	1152.6	1126.5	1255.8	1077.8	1004.2
32.5°	756.1	722.9	764.4	686.1	626.7
35°	505.7	516.3	484.3	480.7	406.0
37.5°	315.7	363.2	320.5	341.9	261.1
40°	204.2	263.5	226.7	250.5	192.3
42.5°	167.4	203.0	186.4	198.2	170.9
45°	132.9	165.0	165.0	165.0	134.1
47.5°	73.6	110.4	141.3	112.8	78.3
50°	41.5	55.8	109.2	58.2	43.9
52.5°	28.5	32.0	74.8	33.2	29.7
55°	21.4	22.6	40.4	23.7	22.6
57.5°	16.6	17.8	21.4	17.8	16.6
60°	13.1	13.1	15.4	14.2	13.1
62.5°	9.5	9.5	10.7	9.5	9.5
65°	7.1	7.1	7.1	7.1	7.1
67.5°	3.6	4.7	4.7	4.7	4.7
70°	3.6	2.4	2.4	2.4	3.6
72.5°	2.4	1.2	1.2	1.2	1.2
75°	0.0	0.0	1.2	0.0	0.0
77.5°	0.0	0.0	0.0	0.0	0.0
80°	0.0	0.0	0.0	0.0	0.0
82.5°	0.0	0.0	0.0	0.0	0.0
85°	0.0	0.0	0.0	0.0	0.0
87.5°	0.0	0.0	0.0	0.0	0.0
90°	0.0	0.0	0.0	0.0	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report





— 0°-180° - - 45°-225° - - - - 90°-270°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)