

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P755084

Luminaire Tested: LD4D85BD010-EU4DR6070959050-4LBDP1MW

Issue Date: 2/5/2024

Test Information

Test Method: LM-79-2019
Report Number: P755084
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-57)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/5/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LD4D85BD010-EU4DR6070959050-4LBDP1MW
Description: 4 INCH ROUND DEEP 45° CUTOFF MATTE WHITE TRIM, WITH 60° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 5000K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 7838.7 lumens
Efficiency: N/A
Efficacy: 89.4 lumens/watt
Spacing Criteria (0/90/45): 0.91 / 0.91 / 0.83
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct


Input Watts (W): 87.7
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT



Downlight

TEST NUMBER: P755084
CATALOG NUMBER: LD4D85BD010-EU4DR6070959050-4LBDP1MW

Luminous Intensity Polar Plot

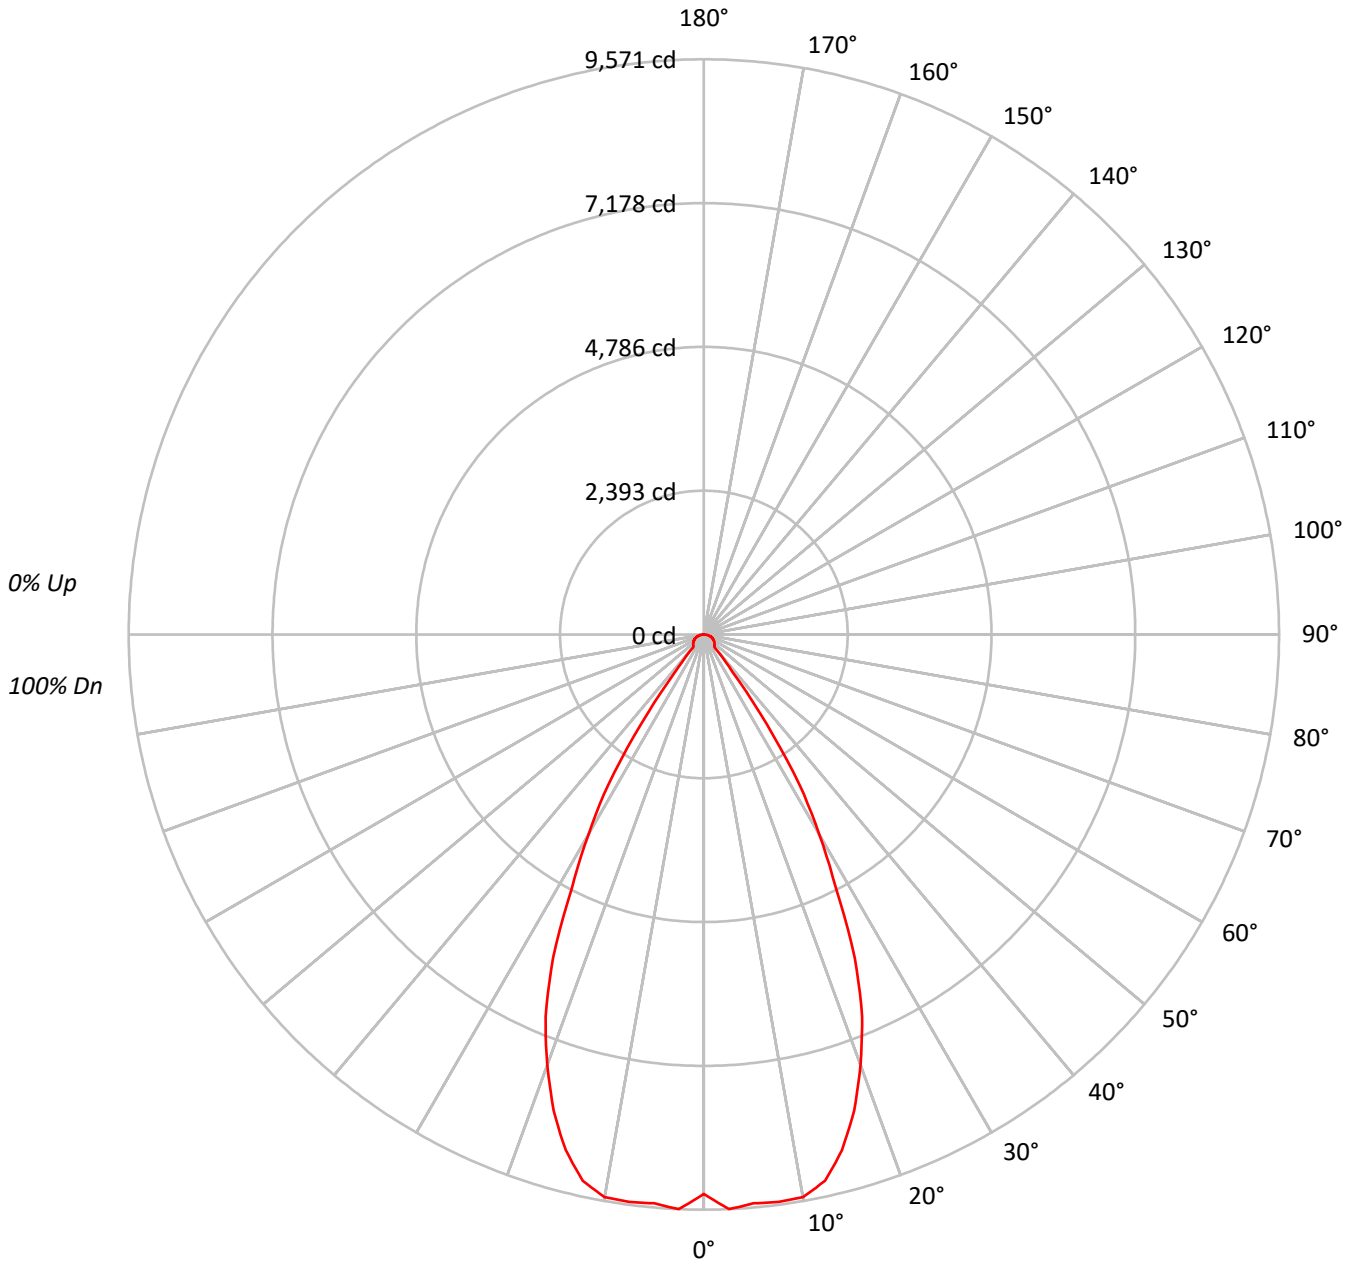



TEST NUMBER: P755084

CATALOG NUMBER: LD4D85BD010-EU4DR6070959050-4LBDP1MW

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10		0		
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			
1	113	110	108	105	111	108	106	104	104	102	100	100	99	97	97	96	95	93			
2	107	102	98	95	105	101	97	94	97	94	92	94	92	90	92	90	88	86			
3	102	96	90	86	100	94	89	86	91	88	84	89	86	83	87	84	82	80			
4	97	89	84	80	95	88	83	79	86	82	78	84	80	77	82	79	76	75			
5	92	84	78	74	91	83	78	74	81	77	73	80	76	72	78	75	72	70			
6	88	79	73	69	87	78	73	69	77	72	68	75	71	68	74	70	67	66			
7	84	75	69	65	83	74	68	64	73	68	64	72	67	64	71	67	63	62			
8	80	71	65	61	79	70	65	61	69	64	60	68	64	60	67	63	60	59			
9	77	67	61	57	75	67	61	57	66	61	57	65	60	57	64	60	57	55			
10	73	64	58	54	72	63	58	54	62	58	54	62	57	54	61	57	54	53			

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	1017163
5°	1042172
10°	1054755
15°	1004801
20°	885929
25°	716560
30°	484695
35°	242877
40°	39394
45°	38568
50°	39333
55°	39927
60°	41038
65°	41960
70°	42967
75°	43482
80°	41905
85°	34976

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 75°
 Luminance: 43482 cd/sqm



TEST NUMBER: P755084

CATALOG NUMBER: LD4D85BD010-EU4DR6070959050-4LBDP1MW

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	908.2	11.6
10°-20°	2457.1	31.3
20°-30°	2643.6	33.7
30°-40°	1149.1	14.7
40°-50°	193.0	2.5
50°-60°	187.7	2.4
60°-70°	160.5	2.0
70°-80°	107.4	1.4
80°-90°	32.1	0.4
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	6008.9	76.7
0°-40°	7158.0	91.3
0°-60°	7538.7	96.2
0°-90°	7838.7	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	7838.7	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	9310	
5°	9502	908
15°	8883	2457
25°	5944	2644
35°	1821	1149
45°	250	193
55°	210	188
65°	162	161
75°	103	107
85°	28	32
90°	0	



TEST NUMBER: P755084

CATALOG NUMBER: LD4D85BD010-EU4DR6070959050-4LBDP1MW

CANDELA DISTRIBUTION (FULL):

	0°
0°	9309.5
2.5°	9571.2
5°	9502.1
7.5°	9523.9
10°	9506.9
12.5°	9310.7
15°	8883.0
17.5°	8308.7
20°	7619.4
22.5°	6881.5
25°	5943.8
27.5°	4754.1
30°	3841.8
32.5°	2961.0
35°	1820.9
37.5°	779.0
40°	276.2
42.5°	254.4
45°	249.6
47.5°	241.1
50°	231.4
52.5°	220.5
55°	209.6
57.5°	198.7
60°	187.8
62.5°	175.7
65°	162.3
67.5°	149.0
70°	134.5
72.5°	118.7
75°	103.0
77.5°	84.8
80°	66.6
82.5°	47.2
85°	27.9
87.5°	9.7
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)