

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P755566

Luminaire Tested: LD4D90BD010-EU4DR4570959024-4LBS1B

Issue Date: 1/30/2024

Test Information

Test Method: LM-79-2019
Report Number: P755566
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-36)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 1/30/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LD4D90BD010-EU4DR4570959024-4LBS1B
Description: 4 INCH ROUND SHALLOW SPECULAR BLACK TRIM, WITH 45° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 2400K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 7436.2 lumens
Efficiency: N/A
Efficacy: 75.2 lumens/watt
Spacing Criteria (0/90/45): 0.75 / 0.75 / 0.69
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct

Input Watts (W): 98.9
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT




Downlight

TEST NUMBER: P755566

CATALOG NUMBER: LD4D90BD010-EU4DR4570959024-4LBS1B

Luminous Intensity Polar Plot

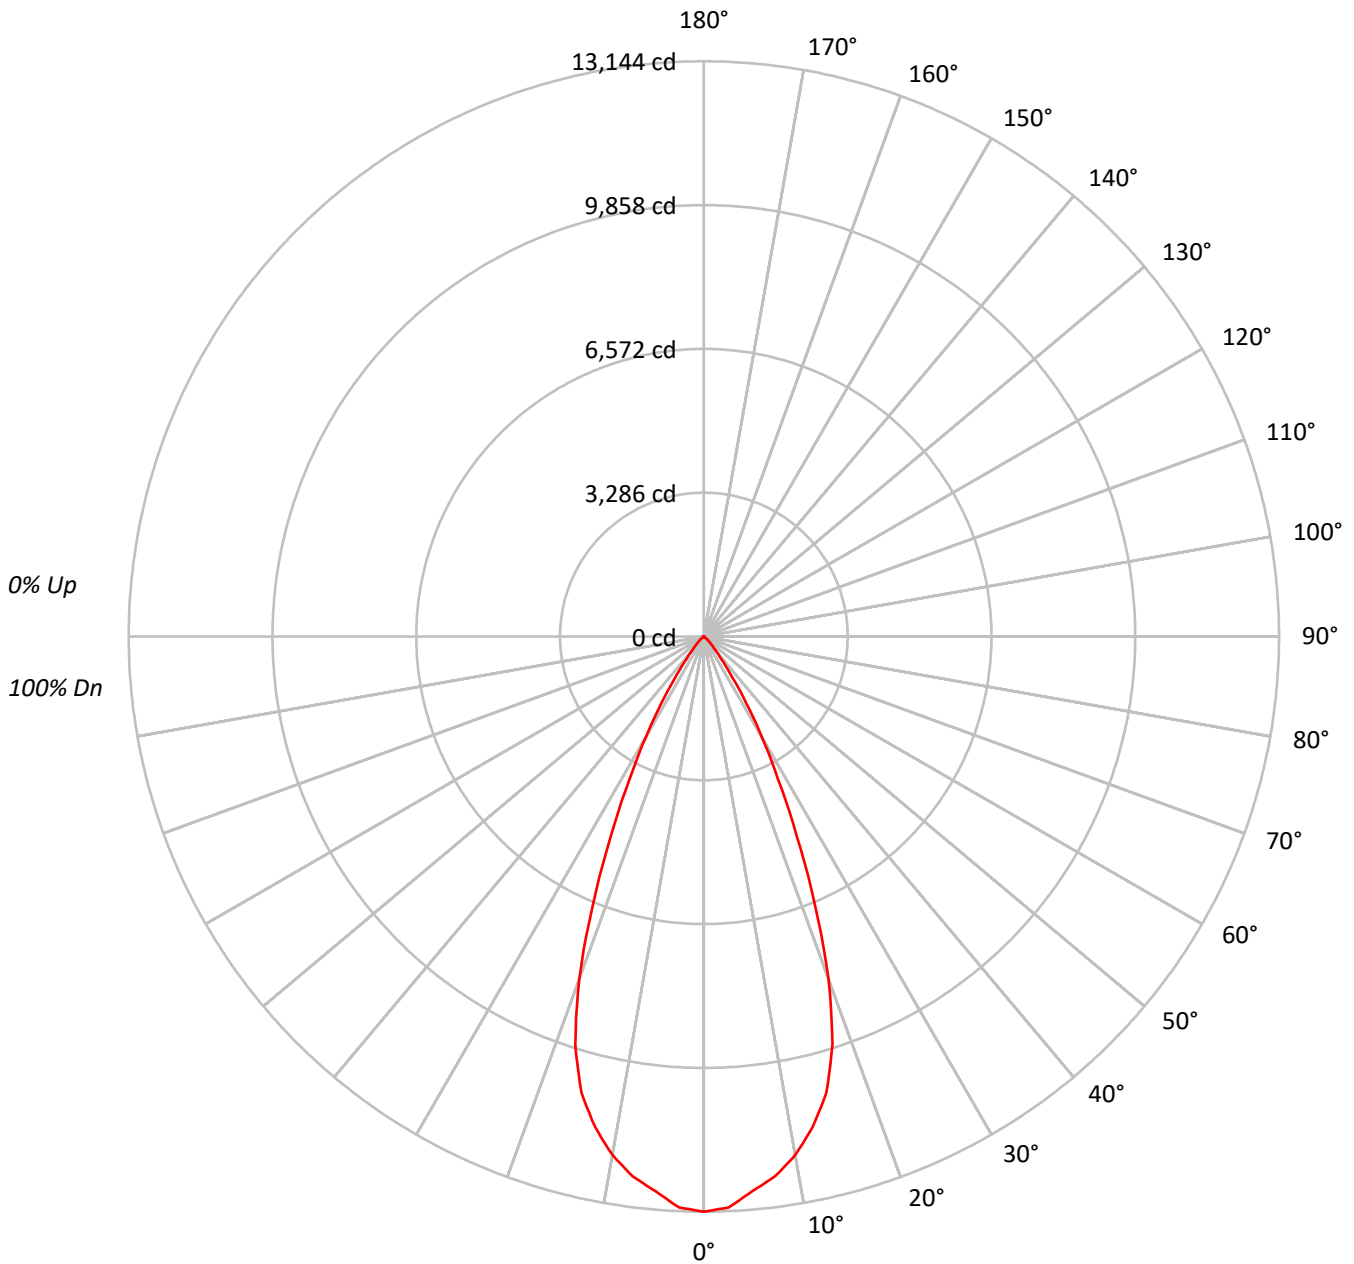



TEST NUMBER: P755566

CATALOG NUMBER: LD4D90BD010-EU4DR4570959024-4LBS1B

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100	100	100	100
1	114	112	110	108	112	110	108	106	106	104	103	102	101	100	98	98	97	95	95	95	95
2	109	105	102	99	107	103	100	98	100	98	95	97	95	93	95	93	91	90	90	90	90
3	105	99	95	91	103	98	94	91	95	92	89	93	90	88	91	89	87	85	85	85	85
4	100	94	89	85	99	93	88	85	91	87	84	89	86	83	87	84	82	81	81	81	81
5	96	89	84	80	95	88	83	80	86	82	79	85	81	79	83	80	78	77	77	77	77
6	92	85	80	76	91	84	79	76	83	78	75	81	77	75	80	77	74	73	73	73	73
7	89	81	75	72	87	80	75	72	79	74	71	78	74	71	77	73	71	69	69	69	69
8	85	77	72	68	84	76	71	68	75	71	68	74	70	67	73	70	67	66	66	66	66
9	82	73	68	65	81	73	68	65	72	68	65	71	67	64	71	67	64	63	63	63	63
10	79	70	65	62	78	70	65	62	69	65	62	68	64	61	68	64	61	60	60	60	60

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	1436080
5°	1395182
10°	1334817
15°	1221643
20°	969181
25°	605070
30°	333500
35°	149749
40°	58977
45°	27798
50°	13173
55°	6896
60°	3387
65°	801
70°	319
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 27798 cd/sqm



TEST NUMBER: P755566

CATALOG NUMBER: LD4D90BD010-EU4DR4570959024-4LBS1B

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	1195.2	16.1
10°-20°	2941.6	39.6
20°-30°	2329.5	31.3
30°-40°	775.7	10.4
40°-50°	154.0	2.1
50°-60°	35.0	0.5
60°-70°	5.0	0.1
70°-80°	0.1	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	6466.3	87.0
0°-40°	7242.1	97.4
0°-60°	7431.0	99.9
0°-90°	7436.2	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	7436.2	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	13144	
5°	12721	###
15°	10800	2942
25°	5019	2329
35°	1123	776
45°	180	154
55°	36	35
65°	3	5
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P755566

CATALOG NUMBER: LD4D90BD010-EU4DR4570959024-4LBS1B

CANDELA DISTRIBUTION (FULL):

	0°
0°	13143.6
2.5°	13057.8
5°	12720.7
7.5°	12442.7
10°	12031.2
12.5°	11483.3
15°	10800.0
17.5°	9772.4
20°	8335.4
22.5°	6623.5
25°	5019.0
27.5°	3675.1
30°	2643.4
32.5°	1797.8
35°	1122.7
37.5°	665.8
40°	413.5
42.5°	271.9
45°	179.9
47.5°	115.8
50°	77.5
52.5°	51.7
55°	36.2
57.5°	23.8
60°	15.5
62.5°	8.3
65°	3.1
67.5°	1.0
70°	1.0
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)