

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P755264

Luminaire Tested: LD4D90BD010-EU4DR2570959027-4LBDP1H

Issue Date: 1/30/2024

Test Information

Test Method: LM-79-2019
Report Number: P755264
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-4)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 1/30/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LD4D90BD010-EU4DR2570959027-4LBDP1H
Description: 4 INCH ROUND DEEP 45° CUTOFF SEMI-SPECULAR CLEAR TRIM, WITH 25° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 2700K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 7454.5 lumens
Efficiency: N/A
Efficacy: 75.4 lumens/watt
Spacing Criteria (0/90/45): 0.42 / 0.42 / 0.45
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct

Input Watts (W): 98.9
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT




Downlight

TEST NUMBER: P755264

CATALOG NUMBER: LD4D90BD010-EU4DR2570959027-4LBDP1H

Luminous Intensity Polar Plot

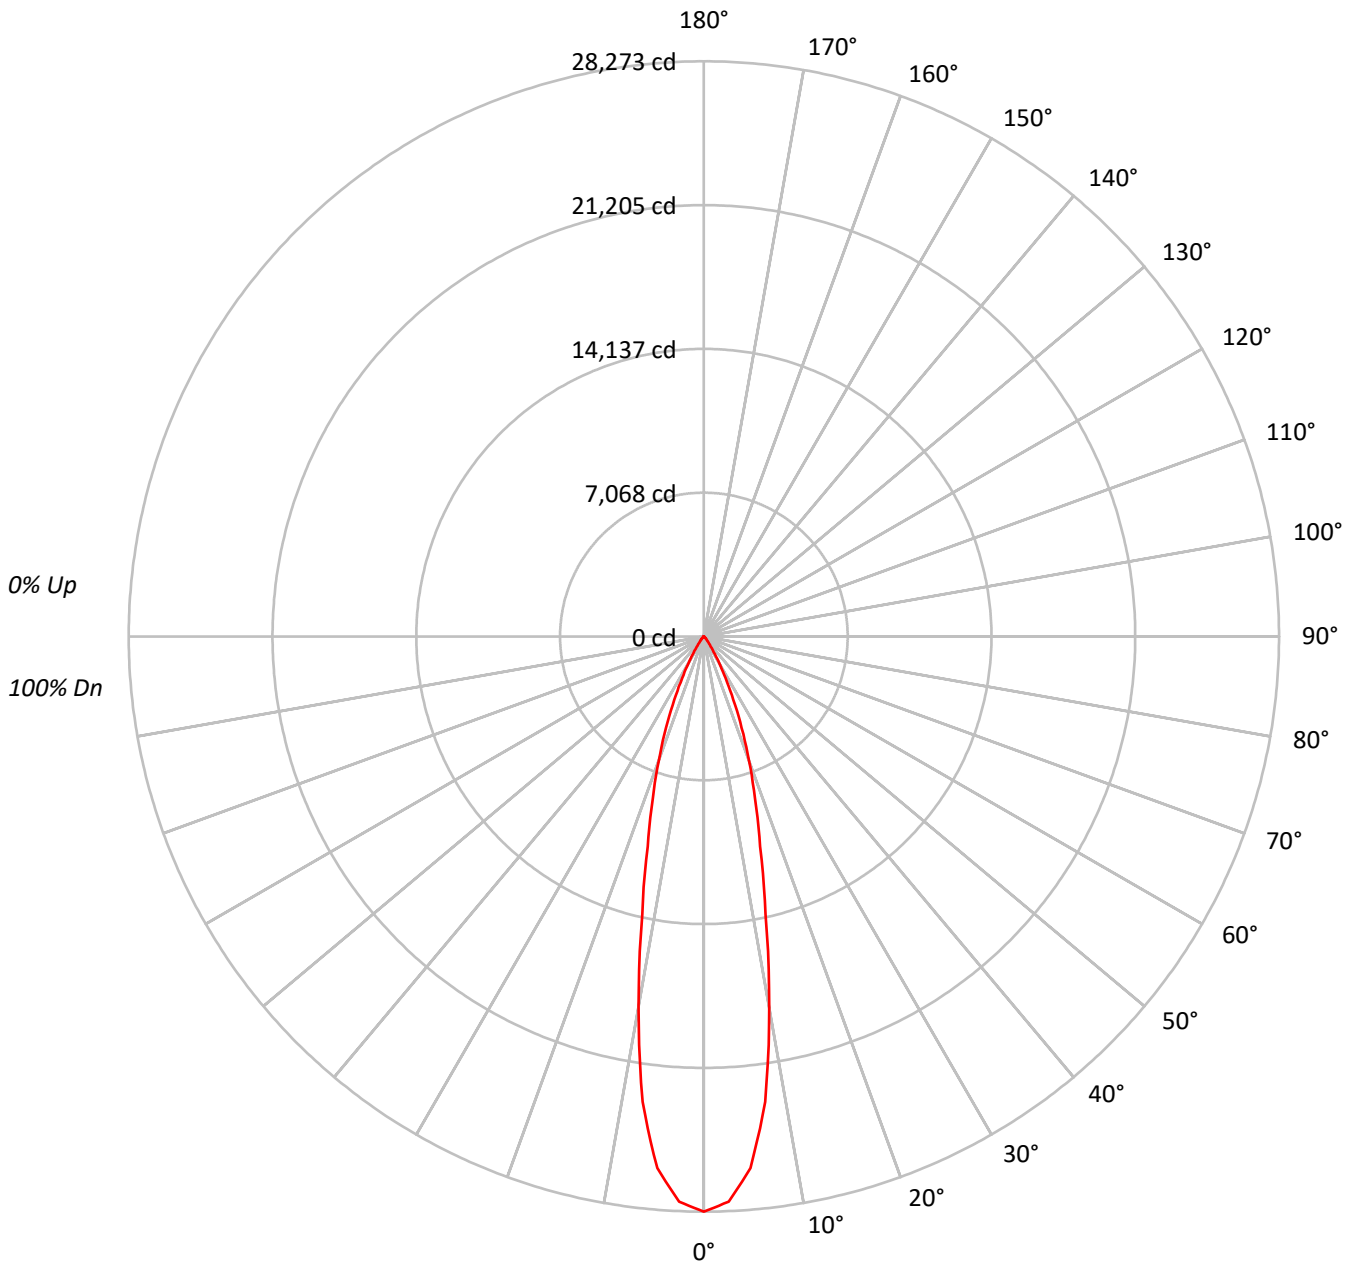



TEST NUMBER: P755264

CATALOG NUMBER: LD4D90BD010-EU4DR2570959027-4LBDP1H

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20			
RC	80				70				50				30				10		0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10
RCR																				
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100		
1	115	113	111	109	112	110	109	107	106	105	104	103	102	101	99	99	98	96		
2	111	107	104	101	109	105	102	100	102	100	98	99	97	96	97	95	94	92		
3	107	102	98	95	105	101	97	94	98	95	93	96	93	91	94	92	90	89		
4	103	97	93	90	102	96	93	90	94	91	89	93	90	88	91	89	87	85		
5	100	93	89	86	98	93	89	86	91	87	85	89	86	84	88	85	83	82		
6	97	90	85	82	95	89	85	82	88	84	81	87	83	81	85	83	80	79		
7	93	87	82	79	92	86	82	79	85	81	78	84	80	78	83	80	78	77		
8	91	84	79	76	90	83	79	76	82	78	76	81	78	75	80	77	75	74		
9	88	81	76	73	87	80	76	73	80	76	73	79	75	73	78	75	73	72		
10	85	78	74	71	85	78	74	71	77	73	71	76	73	71	76	73	70	69		

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	3089140
5°	2877153
10°	2052351
15°	1208759
20°	752099
25°	412759
30°	188766
35°	71493
40°	32377
45°	19469
50°	8074
55°	5200
60°	3627
65°	2456
70°	383
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 19469 cd/sqm



TEST NUMBER: P755264

CATALOG NUMBER: LD4D90BD010-EU4DR2570959027-4LBDP1H

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	2254.5	30.2
10°-20°	3053.5	41.0
20°-30°	1615.9	21.7
30°-40°	398.9	5.4
40°-50°	97.3	1.3
50°-60°	25.6	0.3
60°-70°	8.6	0.1
70°-80°	0.2	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	6923.9	92.9
0°-40°	7322.8	98.2
0°-60°	7445.7	99.9
0°-90°	7454.5	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	7454.5	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	28273	
5°	26233	###
15°	10686	3054
25°	3424	1616
35°	536	399
45°	126	97
55°	27	26
65°	10	9
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P755264

CATALOG NUMBER: LD4D90BD010-EU4DR2570959027-4LBDP1H

CANDELA DISTRIBUTION (FULL):

	0°
0°	28273.1
2.5°	27808.5
5°	26232.7
7.5°	23066.8
10°	18498.6
12.5°	13983.9
15°	10686.1
17.5°	8328.3
20°	6468.4
22.5°	4851.0
25°	3423.8
27.5°	2296.0
30°	1496.2
32.5°	910.3
35°	536.0
37.5°	328.0
40°	227.0
42.5°	173.5
45°	126.0
47.5°	76.1
50°	47.5
52.5°	34.5
55°	27.3
57.5°	21.4
60°	16.6
62.5°	13.1
65°	9.5
67.5°	3.6
70°	1.2
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)