

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P755920

Luminaire Tested: LD4D90BD010-EU4DR6570959035-4LBS1MW

Issue Date: 2/2/2024

Test Information

Test Method: LM-79-2019
Report Number: P755920
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-147)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/2/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LD4D90BD010-EU4DR6570959035-4LBS1MW
Description: 4 INCH ROUND SHALLOW MATTE WHITE TRIM, WITH 65° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 3500K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 7612.5 lumens
Efficiency: N/A
Efficacy: 77.0 lumens/watt
Spacing Criteria (0/90/45): 0.95 / 0.95 / 0.96
Luminous Opening: Circular (Dia: 0.48' x H: 0')
CIE Type: Direct

Input Watts (W): 98.9
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT




Downlight

TEST NUMBER: P755920

CATALOG NUMBER: LD4D90BD010-EU4DR6570959035-4LBS1MW

Luminous Intensity Polar Plot

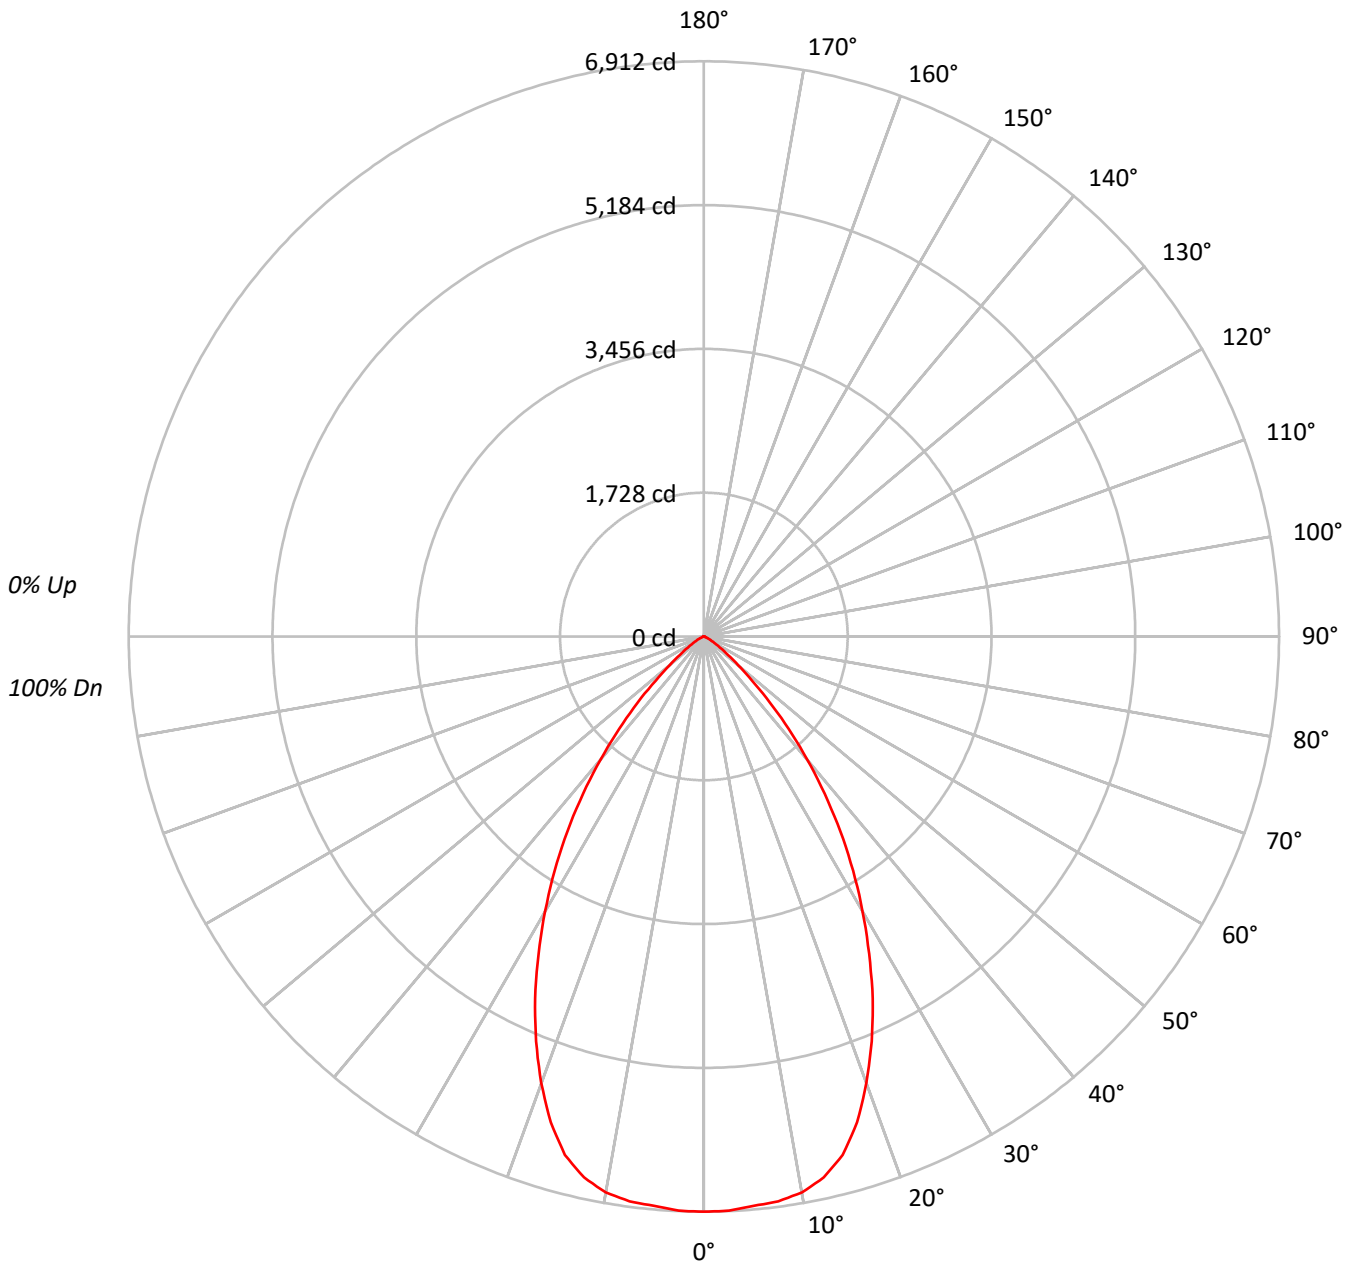



TEST NUMBER: P755920

CATALOG NUMBER: LD4D90BD010-EU4DR6570959035-4LBS1MW

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100	100	100	100
1	113	110	107	105	111	108	105	103	104	102	100	100	99	97	97	95	94	93	93	93	93
2	107	102	97	94	105	100	96	92	97	93	90	94	91	88	91	89	87	85	85	85	85
3	101	94	88	84	99	92	87	83	90	86	82	87	84	81	85	82	80	78	78	78	78
4	95	87	81	76	93	86	80	76	84	79	75	82	77	74	80	76	73	72	72	72	72
5	90	81	74	70	88	80	74	69	78	73	69	76	72	68	75	71	68	66	66	66	66
6	85	75	69	64	83	74	68	64	73	67	63	71	67	63	70	66	62	61	61	61	61
7	80	70	64	59	79	69	63	59	68	63	59	67	62	58	66	61	58	56	56	56	56
8	76	66	59	55	75	65	59	55	64	58	54	63	58	54	62	57	54	52	52	52	52
9	72	61	55	51	71	61	55	51	60	54	51	59	54	50	58	54	50	49	49	49	49
10	68	58	52	47	67	57	51	47	57	51	47	56	51	47	55	50	47	46	46	46	46

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	403682
5°	402668
10°	402324
15°	389921
20°	354976
25°	309339
30°	257280
35°	203855
40°	147137
45°	92953
50°	48456
55°	25751
60°	13526
65°	7435
70°	3125
75°	3430
80°	2388
85°	2010

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 92953 cd/sqm



TEST NUMBER: P755920

CATALOG NUMBER: LD4D90BD010-EU4DR6570959035-4LBS1MW

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	653.7	8.6
10°-20°	1789.9	23.5
20°-30°	2187.9	28.7
30°-40°	1775.2	23.3
40°-50°	884.6	11.6
50°-60°	246.7	3.2
60°-70°	56.1	0.7
70°-80°	14.6	0.2
80°-90°	3.7	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	4631.5	60.8
0°-40°	6406.7	84.2
0°-60°	7538.1	99.0
0°-90°	7612.5	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	7612.5	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	6912	
5°	6868	654
15°	6449	1790
25°	4800	2188
35°	2859	1775
45°	1125	885
55°	253	247
65°	54	56
75°	15	15
85°	3	4
90°	0	



TEST NUMBER: P755920

CATALOG NUMBER: LD4D90BD010-EU4DR6570959035-4LBS1MW

CANDELA DISTRIBUTION (FULL):

	0°
0°	6911.9
2.5°	6906.9
5°	6868.3
7.5°	6845.9
10°	6784.0
12.5°	6658.0
15°	6448.8
17.5°	6121.7
20°	5711.4
22.5°	5268.5
25°	4800.3
27.5°	4299.5
30°	3815.0
32.5°	3336.6
35°	2859.2
37.5°	2382.9
40°	1929.9
42.5°	1505.3
45°	1125.4
47.5°	784.1
50°	533.3
52.5°	367.7
55°	252.9
57.5°	170.6
60°	115.8
62.5°	80.2
65°	53.8
67.5°	27.4
70°	18.3
72.5°	17.3
75°	15.2
77.5°	10.2
80°	7.1
82.5°	5.1
85°	3.0
87.5°	2.0
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)