

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P741942

Luminaire Tested: LD4D10D010-EU4DR200210IC9024-4LBCSSQMMS

Issue Date: 2/2/2024

Test Information

Test Method: LM-79-2019
Report Number: P741942
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2310-195-36)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/2/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LD4D10D010-EU4DR200210IC9024-4LBCSSQMMS
Description: 4 INCH SQAURE SHALLOW CAST MATTE METALLIC SILVER TRIM, WITH 20° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 2400K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 863.5 lumens
Efficiency: N/A
Efficacy: 73.8 lumens/watt
Spacing Criteria (0/90/45): 0.34 / 0.34 / 0.36
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct

Input Watts (W): 11.7
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT




Downlight



TEST NUMBER: P741942
CATALOG NUMBER: LD4D10D010-EU4DR200210IC9024-4LBCSSQMMS

Luminous Intensity Polar Plot

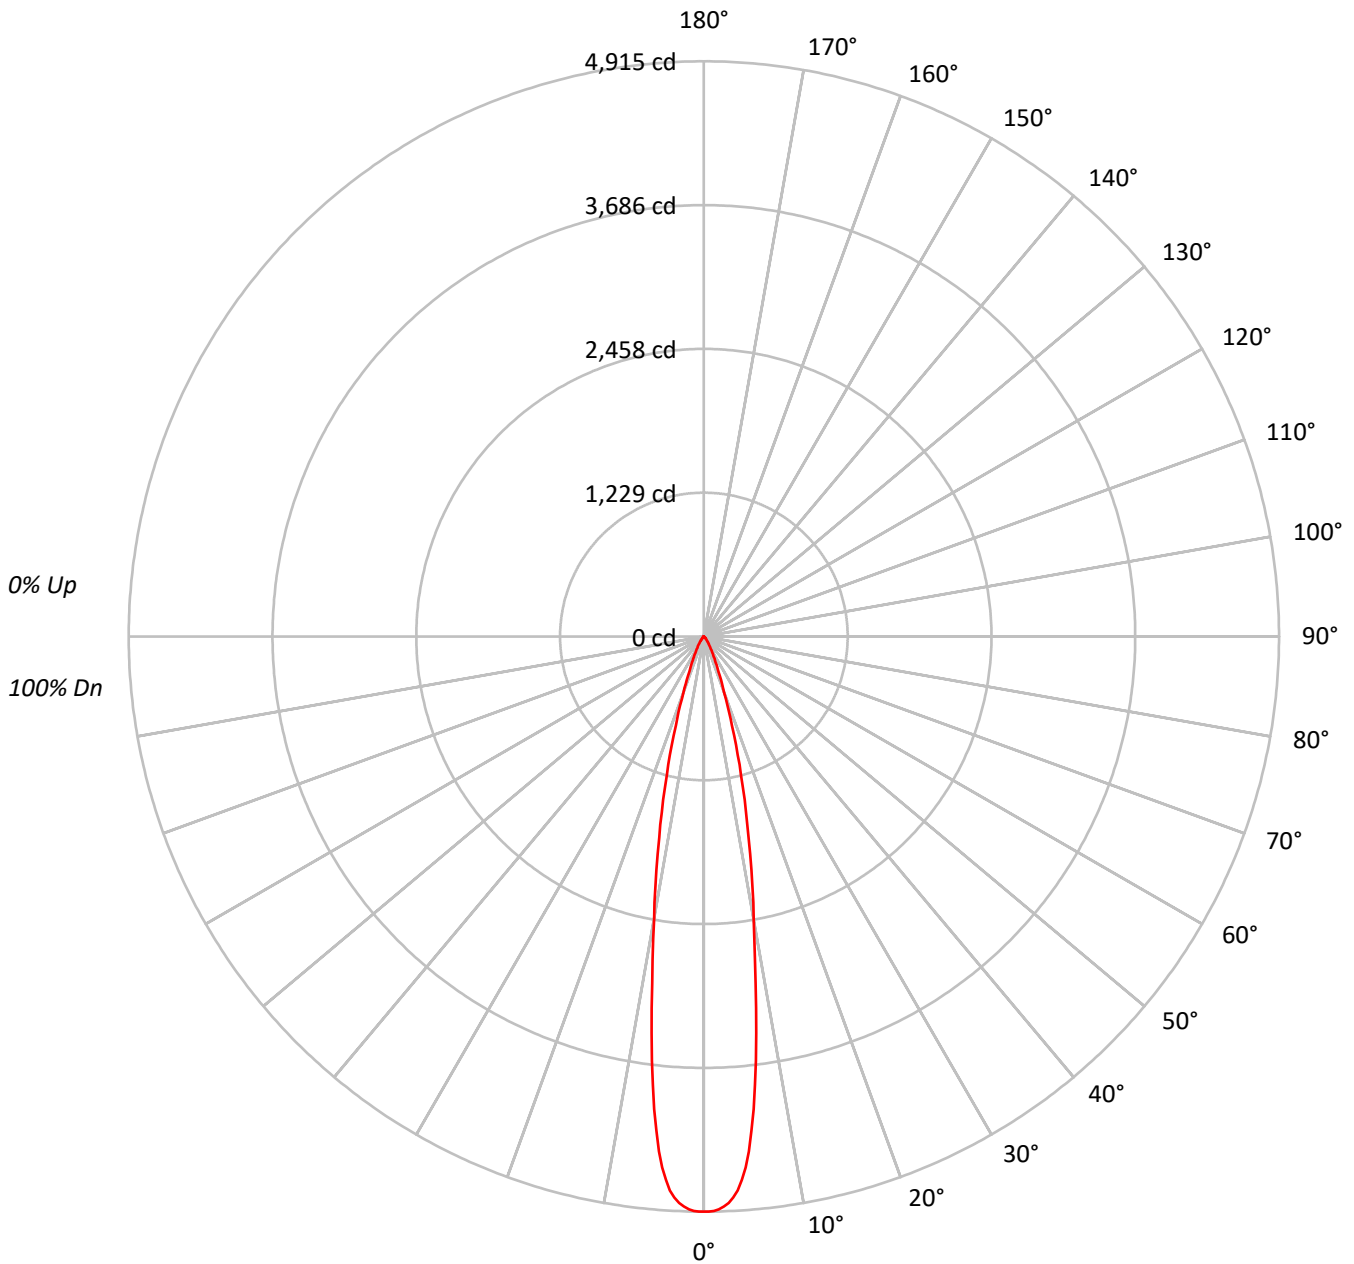



TEST NUMBER: P741942

CATALOG NUMBER: LD4D10D010-EU4DR200210IC9024-4LBCSSQMMS

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20									20									20									20									20								
RC	80									50									30									10									0								
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0															
RCR																																													
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100									100																		
1	115	113	111	109	113	111	109	108	107	106	104	103	102	101	100	99	98	97	98	96	95	94	93	92	91	90	89	88	87	86															
2	111	108	105	102	109	106	104	101	103	101	99	100	99	97	98	96	95	94	93	92	91	90	89	88	87	86	85	84	83	82															
3	108	103	100	97	106	102	99	96	100	97	95	97	95	93	95	93	92	91	90	89	88	87	86	85	84	83	82	81	80	79															
4	105	99	96	93	103	98	95	92	96	93	91	95	92	90	93	91	89	88	87	86	85	84	83	82	81	80	79	78	77	76															
5	102	96	92	89	100	95	91	89	94	90	88	92	89	87	91	88	86	85	84	83	82	81	80	79	78	77	76	75	74	73															
6	99	93	89	86	98	92	88	86	91	87	85	90	87	84	88	86	84	83	82	81	80	79	78	77	76	75	74	73	72	71															
7	96	90	86	83	95	89	86	83	88	85	82	87	84	82	86	84	82	81	80	79	78	77	76	75	74	73	72	71	70	69															
8	94	87	83	81	93	87	83	80	86	83	80	85	82	80	84	82	80	79	78	77	76	75	74	73	72	71	70	69	68	67															
9	91	85	81	78	91	85	81	78	84	80	78	83	80	78	82	80	78	77	76	75	74	73	72	71	70	69	68	67	66	65															
10	89	83	79	76	88	82	79	76	82	78	76	81	78	76	81	78	76	75	74	73	72	71	70	69	68	67	66	65	64	63															

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	536984
5°	484459
10°	271907
15°	138215
20°	58520
25°	27017
30°	14294
35°	7710
40°	4122
45°	2441
50°	1411
55°	743
60°	481
65°	336
70°	128
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 2441 cd/sqm



TEST NUMBER: P741942

CATALOG NUMBER: LD4D10D010-EU4DR200210IC9024-4LBCSSQMMS

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	349.9	40.5
10°-20°	344.6	39.9
20°-30°	112.6	13.0
30°-40°	38.3	4.4
40°-50°	12.9	1.5
50°-60°	3.9	0.5
60°-70°	1.3	0.2
70°-80°	0.1	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	807.1	93.5
0°-40°	845.4	97.9
0°-60°	862.2	99.8
0°-90°	863.5	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	863.5	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	4915	
5°	4417	350
15°	1222	345
25°	224	113
35°	58	38
45°	16	13
55°	4	4
65°	1	1
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P741942

CATALOG NUMBER: LD4D10D010-EU4DR200210IC9024-4LBCSSQMMS

CANDELA DISTRIBUTION (FULL):

	0°
0°	4914.7
0.5°	4914.7
1°	4908.6
1.5°	4896.3
2°	4874.0
2.5°	4844.3
3°	4802.2
3.5°	4743.6
4°	4656.5
4.5°	4550.6
5°	4417.1
5.5°	4241.6
6°	4061.8
6.5°	3855.6
7°	3653.9
7.5°	3417.5
8°	3206.6
8.5°	2994.3
9°	2798.3
9.5°	2618.4
10°	2450.8
12.5°	1759.8
15°	1221.9
17.5°	798.3
20°	503.3
22.5°	326.0
25°	224.1
27.5°	157.6
30°	113.3
32.5°	81.4
35°	57.8
37.5°	40.3
40°	28.9
42.5°	21.0
45°	15.8
47.5°	12.3
50°	8.3
52.5°	5.3
55°	3.9
57.5°	3.1
60°	2.2
62.5°	1.8
65°	1.3



TEST NUMBER: P741942
CATALOG NUMBER: LD4D10D010-EU4DR200210IC9024-4LBCSSQMMS

CANDELA DISTRIBUTION (continued):

	0°
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



67.5°		0.9
70°		0.4

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)