

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P742109

Luminaire Tested: LD4D10D010-EU4DR300210IC9024-4LBSQW1MW

Issue Date: 1/30/2024

Test Information

Test Method: LM-79-2019
Report Number: P742109
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-16)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 1/30/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LD4D10D010-EU4DR300210IC9024-4LBSQW1MW
Description: 4 INCH SQAURE DEEP 45° CUTOFF MATTE WHITE TRIM, WITH 30° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 2400K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 715.8 lumens
Efficiency: N/A
Efficacy: 61.2 lumens/watt
Spacing Criteria (0/90/45): 0.52 / 0.52 / 0.49
Luminous Opening: Rectangular (W 0.38' x L: 0.38' x H: 0')
CIE Type: Direct

Input Watts (W): 11.7
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT




Downlight



TEST NUMBER: P742109

CATALOG NUMBER: LD4D10D010-EU4DR300210IC9024-4LBSQW1MW

Luminous Intensity Polar Plot

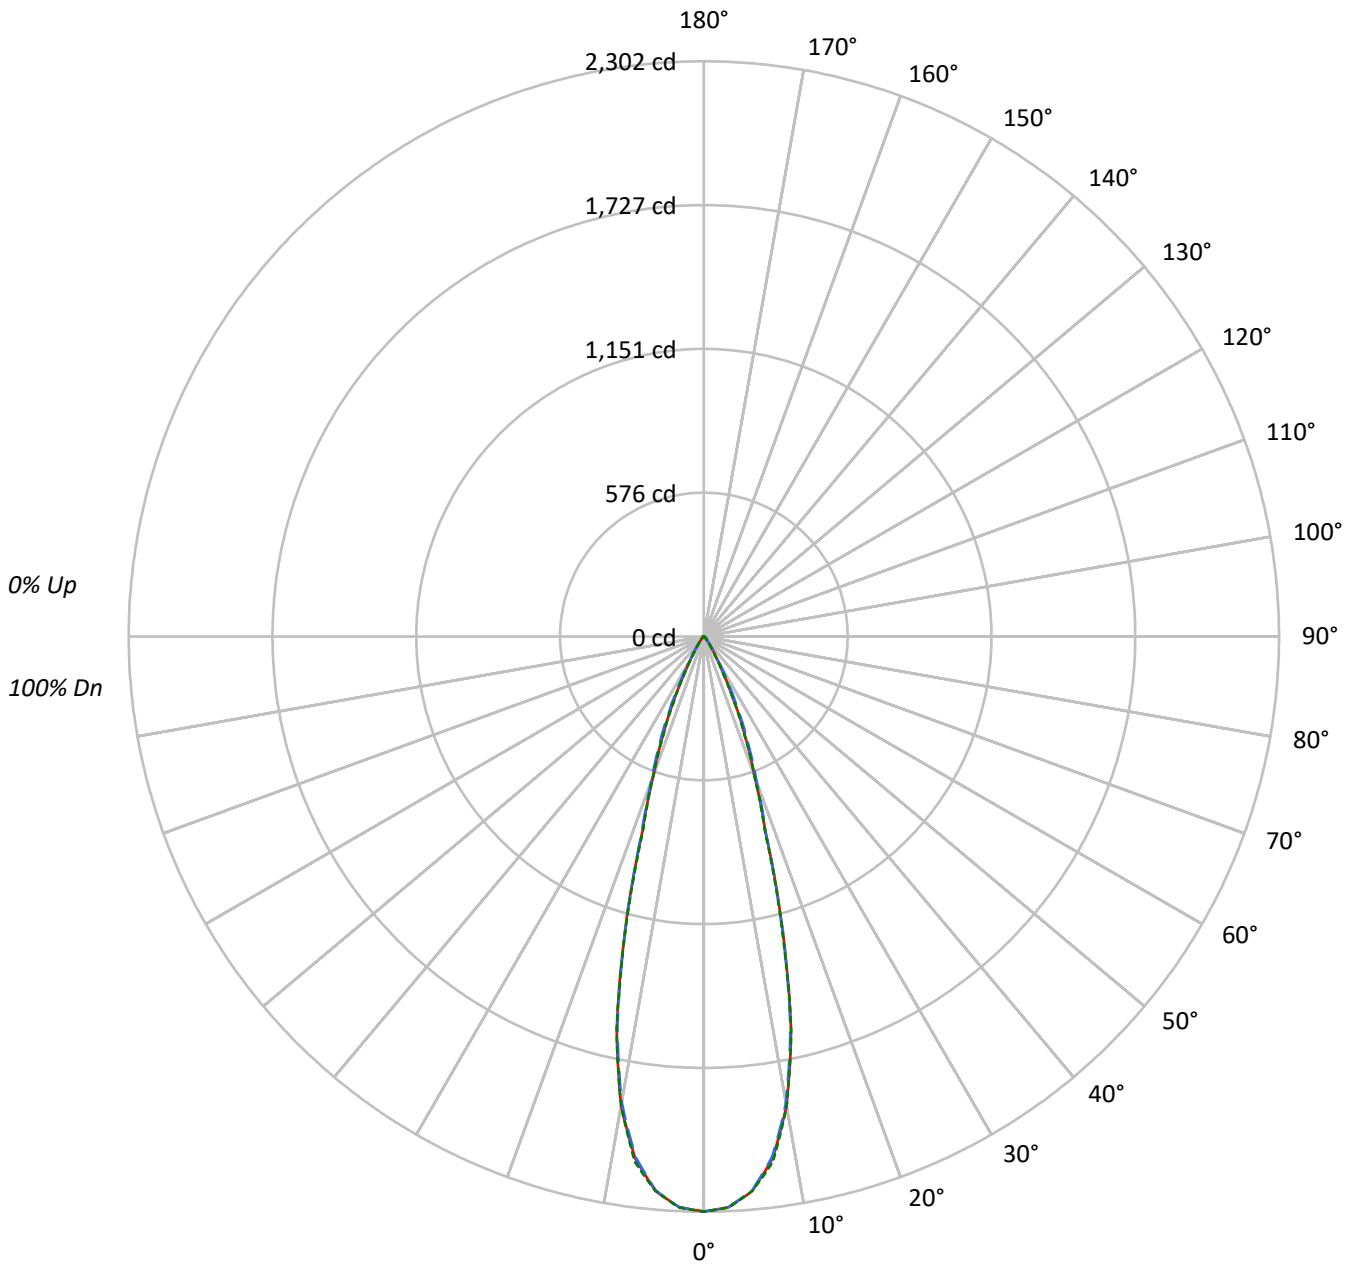



TEST NUMBER: P742109

CATALOG NUMBER: LD4D10D010-EU4DR300210IC9024-4LBSQW1MW

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0																
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100																			
1	115	113	111	109	112	110	109	107	106	105	104	103	102	101	99	99	98	96																			
2	111	107	104	101	109	105	102	100	102	100	98	99	97	96	97	95	94	92																			
3	107	102	98	95	105	101	97	94	98	95	93	96	93	91	94	92	90	89																			
4	103	98	93	90	102	96	93	90	94	91	89	93	90	88	91	89	87	85																			
5	100	94	89	86	98	93	89	86	91	88	85	90	86	84	88	86	83	82																			
6	97	90	85	82	95	89	85	82	88	84	81	87	83	81	85	83	80	79																			
7	94	87	82	79	92	86	82	79	85	81	78	84	81	78	83	80	78	77																			
8	91	84	79	76	90	83	79	76	82	78	76	81	78	75	80	77	75	74																			
9	88	81	76	73	87	80	76	73	80	76	73	79	75	73	78	75	73	72																			
10	85	78	74	71	85	78	74	71	77	73	71	76	73	71	76	73	70	69																			

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	176180	176180	176180
5°	171121	170921	171129
10°	148220	147171	148181
15°	96701	96186	95702
20°	48091	49892	48026
25°	24222	27313	23724
30°	9696	10571	8450
35°	4495	4308	3616
40°	1938	2158	1829
45°	1375	1700	1386
50°	476	1238	500
55°	280	507	280
60°	199	230	199
65°	127	127	127
70°	67	45	67
75°	0	30	0
80°	0	0	0
85°	0	0	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 22.5°
 Vertical Angle: 45°
 Luminance: 1700 cd/sqm



TEST NUMBER: P742109

CATALOG NUMBER: LD4D10D010-EU4DR300210IC9024-4LBSQW1MW

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	202.4	28.3
10°-20°	326.0	45.5
20°-30°	140.9	19.7
30°-40°	32.1	4.5
40°-50°	11.0	1.5
50°-60°	2.7	0.4
60°-70°	0.7	0.1
70°-80°	0.1	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	669.2	93.5
0°-40°	701.3	98.0
0°-60°	715.1	99.9
0°-90°	715.8	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	715.8	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2302	2302	2302	2302	2302	
5°	2227	2225	2224	2229	2227	203
15°	1220	1206	1214	1210	1208	327
25°	287	298	323	290	281	137
35°	48	49	46	46	39	33
45°	13	16	16	16	13	9
55°	2	2	4	2	2	2
65°	1	1	1	1	1	1
75°	0	0	0	0	0	0
85°	0	0	0	0	0	0
90°	0	0	0	0	0	



TEST NUMBER: P742109

CATALOG NUMBER: LD4D10D010-EU4DR300210IC9024-4LBSQW1MW

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2301.7	2301.7	2301.7	2301.7	2301.7
2.5°	2286.5	2284.9	2285.8	2286.9	2287.3
5°	2227.1	2225.0	2224.5	2229.2	2227.2
7.5°	2107.4	2104.4	2099.8	2110.3	2120.1
10°	1907.0	1903.6	1893.5	1898.5	1906.5
12.5°	1611.0	1600.0	1599.9	1615.7	1613.5
15°	1220.3	1205.7	1213.8	1209.8	1207.7
17.5°	820.6	815.0	825.9	822.6	808.4
20°	590.4	591.8	612.5	602.1	589.6
22.5°	430.8	436.1	460.6	433.8	424.0
25°	286.8	297.6	323.4	290.1	280.9
27.5°	176.4	181.4	207.5	174.1	169.2
30°	109.7	107.3	119.6	102.6	95.6
32.5°	72.0	68.8	72.8	65.3	59.6
35°	48.1	49.2	46.1	45.8	38.7
37.5°	30.1	34.6	30.5	32.5	24.9
40°	19.4	25.1	21.6	23.8	18.3
42.5°	15.9	19.3	17.8	18.9	16.3
45°	12.7	15.7	15.7	15.7	12.8
47.5°	7.0	10.5	13.5	10.7	7.4
50°	4.0	5.3	10.4	5.6	4.2
52.5°	2.7	3.0	7.1	3.2	2.8
55°	2.1	2.1	3.8	2.2	2.1
57.5°	1.6	1.7	2.1	1.7	1.6
60°	1.3	1.3	1.5	1.4	1.3
62.5°	0.9	0.9	1.0	0.9	0.9
65°	0.7	0.7	0.7	0.7	0.7
67.5°	0.3	0.5	0.5	0.5	0.5
70°	0.3	0.2	0.2	0.2	0.3
72.5°	0.2	0.1	0.1	0.1	0.1
75°	0.0	0.0	0.1	0.0	0.0
77.5°	0.0	0.0	0.0	0.0	0.0
80°	0.0	0.0	0.0	0.0	0.0
82.5°	0.0	0.0	0.0	0.0	0.0
85°	0.0	0.0	0.0	0.0	0.0
87.5°	0.0	0.0	0.0	0.0	0.0
90°	0.0	0.0	0.0	0.0	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report





— 0°-180° - - 45°-225° - - - 90°-270°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)