

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P742203

Luminaire Tested: LD4D10D010-EU4DR350210IC9030-4LBCSSQMW

Issue Date: 1/30/2024

Test Information

Test Method: LM-79-2019
Report Number: P742203
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-20)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 1/30/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LD4D10D010-EU4DR350210IC9030-4LBCSSQMW
Description: 4 INCH SQAURE SHALLOW CAST MATTE WHITE TRIM, WITH 35° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 3000K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 934.1 lumens
Efficiency: N/A
Efficacy: 79.8 lumens/watt
Spacing Criteria (0/90/45): 0.6 / 0.6 / 0.54
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct

Input Watts (W): 11.7
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT




Downlight



TEST NUMBER: P742203
CATALOG NUMBER: LD4D10D010-EU4DR350210IC9030-4LBCSSQMW

Luminous Intensity Polar Plot

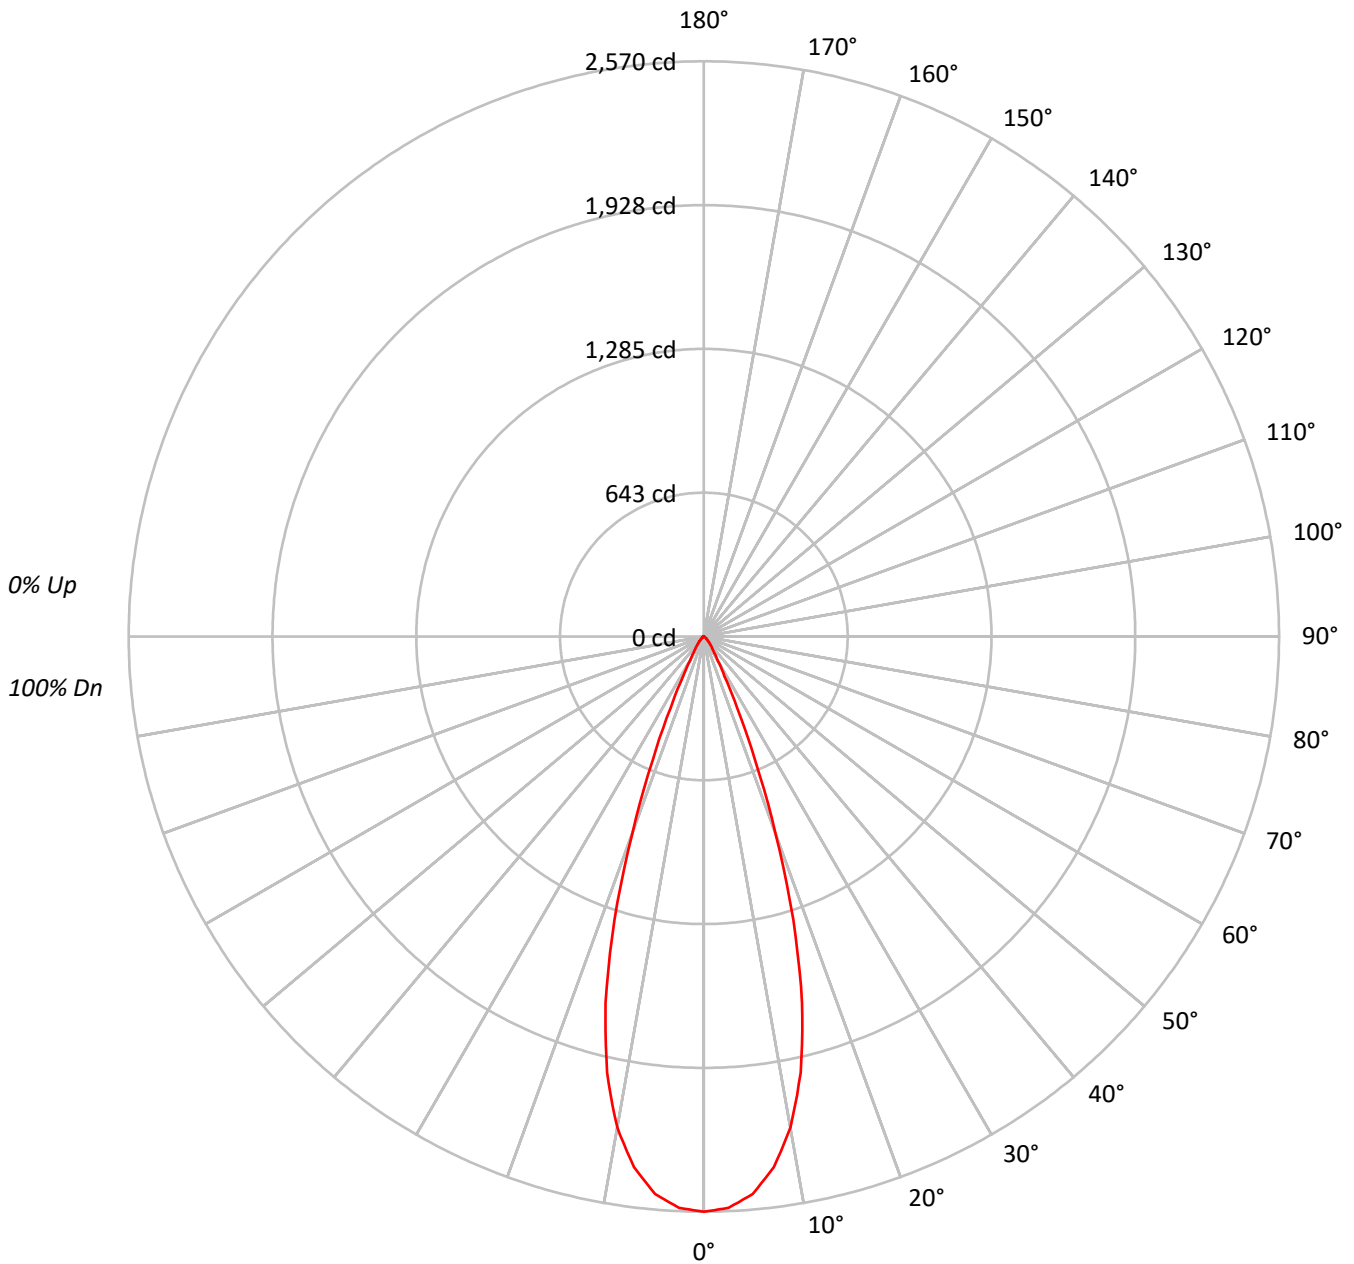



TEST NUMBER: P742203

CATALOG NUMBER: LD4D10D010-EU4DR350210IC9030-4LBCSSQMW

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0																
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100				100															
1	115	112	110	108	112	110	108	107	106	105	103	103	101	100	99	98	98	96				96															
2	110	106	103	101	108	105	102	99	102	99	97	99	97	95	96	95	93	92				92															
3	106	101	97	94	105	100	96	93	97	95	92	95	93	91	93	91	89	88				88															
4	103	97	92	89	101	96	92	89	94	90	88	92	89	87	90	88	86	84				84															
5	99	93	88	85	98	92	87	84	90	86	84	89	85	83	87	84	82	81				81															
6	96	89	84	81	94	88	84	81	87	83	80	85	82	80	84	81	79	78				78															
7	93	85	81	78	91	85	80	77	84	80	77	83	79	77	82	79	76	75				75															
8	90	82	78	74	88	82	77	74	81	77	74	80	76	74	79	76	73	72				72															
9	87	79	75	72	86	79	75	72	78	74	71	77	74	71	77	73	71	70				70															
10	84	77	72	69	83	76	72	69	76	72	69	75	71	69	74	71	69	68				68															

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	280822
5°	274217
10°	247144
15°	191832
20°	108797
25°	42327
30°	15796
35°	8657
40°	5648
45°	3446
50°	2193
55°	1543
60°	1136
65°	620
70°	32
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 3446 cd/sqm



TEST NUMBER: P742203

CATALOG NUMBER: LD4D10D010-EU4DR350210IC9030-4LBCSSQMW

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	229.9	24.6
10°-20°	449.0	48.1
20°-30°	183.1	19.6
30°-40°	43.8	4.7
40°-50°	18.3	2.0
50°-60°	7.6	0.8
60°-70°	2.4	0.3
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	862.0	92.3
0°-40°	905.8	97.0
0°-60°	931.7	99.7
0°-90°	934.1	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	934.1	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	2570	
5°	2500	230
15°	1696	449
25°	351	183
35°	65	44
45°	22	18
55°	8	8
65°	2	2
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P742203

CATALOG NUMBER: LD4D10D010-EU4DR350210IC9030-4LBCSSQMW

CANDELA DISTRIBUTION (FULL):

	0°
0°	2570.2
2.5°	2554.8
5°	2500.2
7.5°	2391.5
10°	2227.6
12.5°	1996.9
15°	1695.9
17.5°	1327.6
20°	935.7
22.5°	596.7
25°	351.1
27.5°	198.5
30°	125.2
32.5°	87.9
35°	64.9
37.5°	50.2
40°	39.6
42.5°	30.5
45°	22.3
47.5°	16.7
50°	12.9
52.5°	10.3
55°	8.1
57.5°	6.6
60°	5.2
62.5°	3.8
65°	2.4
67.5°	0.9
70°	0.1
72.5°	0.1
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.1
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)