

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P739625

Luminaire Tested: LD4D02D010-EU4DR650210IC9027-4LBSQW1B

Issue Date: 2/5/2024

Test Information

Test Method: LM-79-2019
Report Number: P739625
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-59)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/5/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LD4D02D010-EU4DR650210IC9027-4LBSQW1B
Description: 4 INCH SQAURE DEEP 45° CUTOFF SPECULAR BLACK TRIM, WITH 65° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 2700K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 226.3 lumens
Efficiency: N/A
Efficacy: 44.4 lumens/watt
Spacing Criteria (0/90/45): 0.98 / 0.98 / 0.92
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct

Input Watts (W): 5.1
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT




Downlight



TEST NUMBER: P739625
CATALOG NUMBER: LD4D02D010-EU4DR650210IC9027-4LBSQW1B

Luminous Intensity Polar Plot

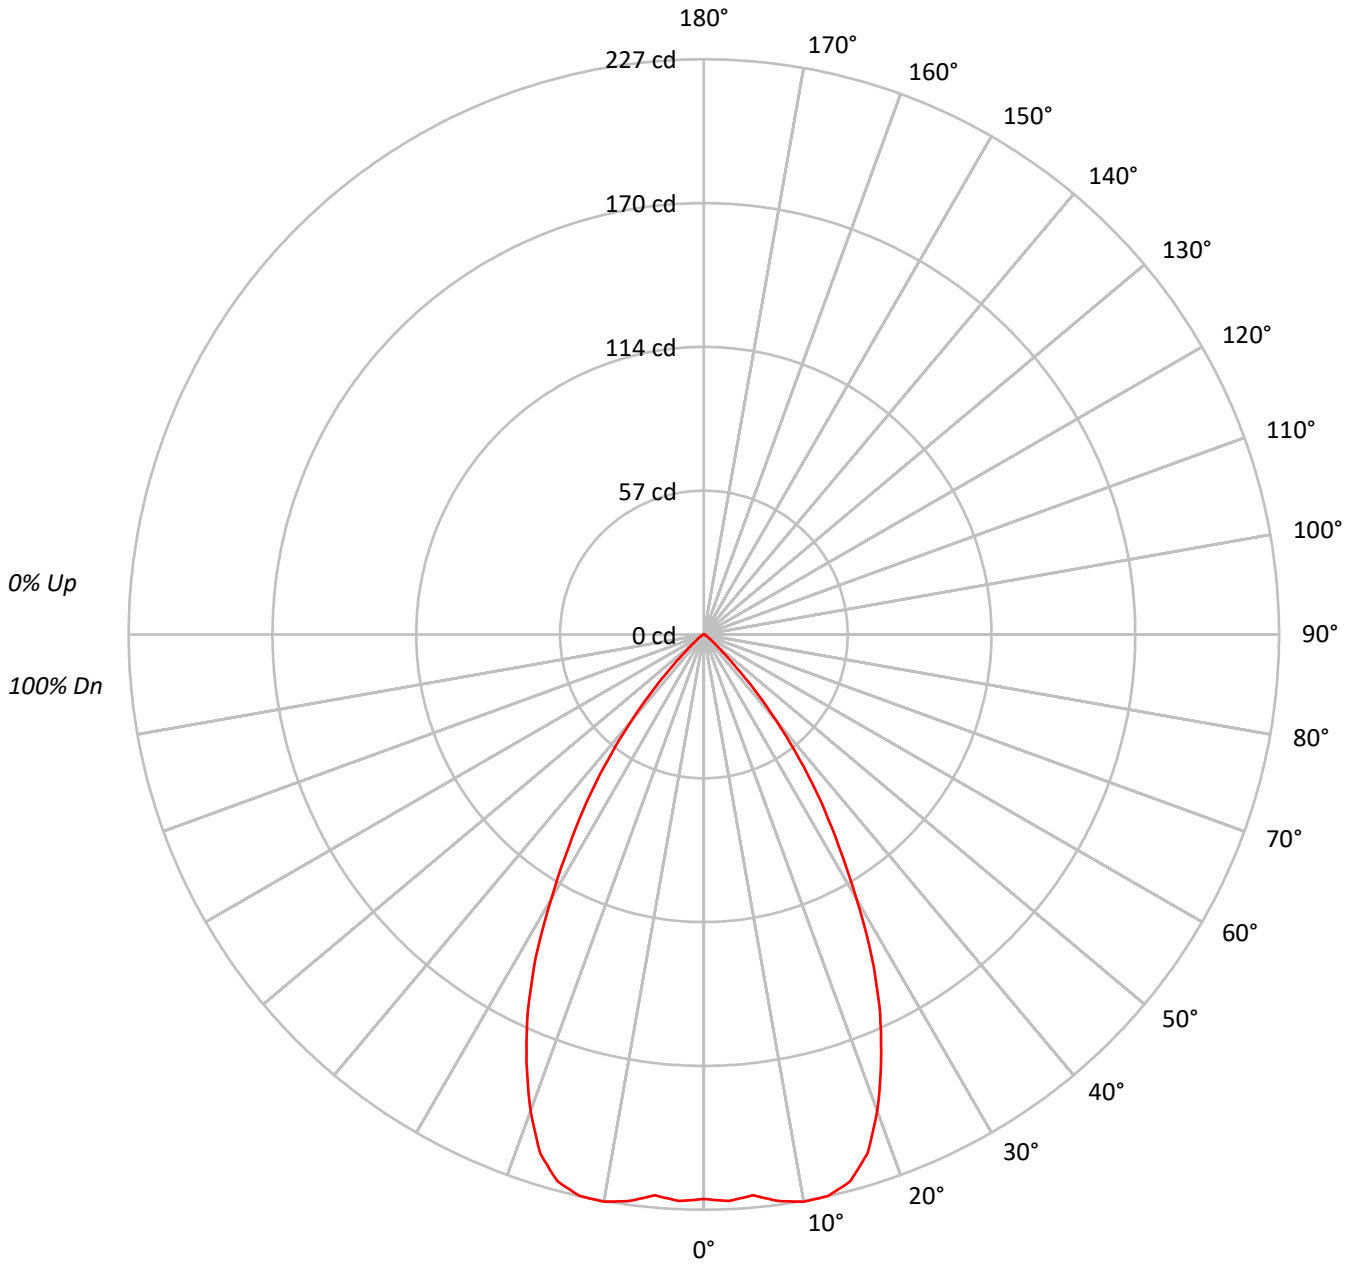



TEST NUMBER: P739625

CATALOG NUMBER: LD4D02D010-EU4DR650210IC9027-4LBSQW1B

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			
1	113	111	108	106	111	108	106	104	104	103	101	101	99	98	97	96	95	93			
2	108	103	99	95	106	101	97	94	98	95	92	95	92	90	92	90	88	87			
3	102	96	91	87	100	94	90	86	92	88	85	89	86	83	87	84	82	80			
4	97	89	84	79	95	88	83	79	86	82	78	84	80	77	82	79	76	75			
5	92	83	78	73	90	83	77	73	81	76	72	79	75	72	77	74	71	69			
6	87	78	72	68	86	77	72	68	76	71	67	74	70	67	73	69	66	65			
7	83	73	67	63	81	73	67	63	71	66	62	70	66	62	69	65	62	60			
8	79	69	63	59	77	68	63	59	67	62	58	66	62	58	65	61	58	57			
9	75	65	59	55	74	65	59	55	64	58	55	63	58	55	62	58	54	53			
10	71	61	56	52	70	61	55	52	60	55	51	59	55	51	59	54	51	50			

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	24343
5°	24370
10°	25218
15°	25270
20°	23266
25°	19819
30°	15177
35°	10724
40°	6318
45°	2565
50°	935
55°	533
60°	306
65°	155
70°	160
75°	127
80°	126
85°	125

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 2565 cd/sqm



TEST NUMBER: P739625

CATALOG NUMBER: LD4D02D010-EU4DR650210IC9027-4LBSQW1B

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	21.5	9.5
10°-20°	61.9	27.3
20°-30°	74.3	32.8
30°-40°	49.9	22.0
40°-50°	14.9	6.6
50°-60°	2.6	1.2
60°-70°	0.8	0.3
70°-80°	0.4	0.2
80°-90°	0.1	0.1
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	157.6	69.6
0°-40°	207.5	91.7
0°-60°	225.1	99.5
0°-90°	226.3	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	226.3	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	223	
5°	222	21
15°	223	62
25°	164	74
35°	80	50
45°	17	15
55°	3	3
65°	1	1
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P739625

CATALOG NUMBER: LD4D02D010-EU4DR650210IC9027-4LBSQW1B

CANDELA DISTRIBUTION (FULL):

0°	
0°	222.8
2.5°	223.8
5°	222.2
7.5°	225.5
10°	227.3
12.5°	226.9
15°	223.4
17.5°	214.7
20°	200.1
22.5°	182.8
25°	164.4
27.5°	143.6
30°	120.3
32.5°	99.1
35°	80.4
37.5°	61.8
40°	44.3
42.5°	29.0
45°	16.6
47.5°	8.8
50°	5.5
52.5°	3.8
55°	2.8
57.5°	1.9
60°	1.4
62.5°	0.9
65°	0.6
67.5°	0.6
70°	0.5
72.5°	0.4
75°	0.3
77.5°	0.3
80°	0.2
82.5°	0.2
85°	0.1
87.5°	0.1
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)