

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P738872

Luminaire Tested: LD4D02D010-EU4DR150210IC9035-4LBSQW1MW

Issue Date: 2/2/2024

Test Information

Test Method: LM-79-2019
Report Number: P738872
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2310-195-21)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/2/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LD4D02D010-EU4DR150210IC9035-4LBSQW1MW
Description: 4 INCH SQAURE DEEP 45° CUTOFF MATTE WHITE TRIM, WITH 15° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 3500K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 337.6 lumens
Efficiency: N/A
Efficacy: 66.2 lumens/watt
Spacing Criteria (0/90/45): 0.22 / 0.22 / 0.23
Luminous Opening: Vertical Cylinder (Dia: 0.35' x H: 0.35')
CIE Type: Direct

Input Watts (W): 5.1
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT




Downlight



TEST NUMBER: P738872
CATALOG NUMBER: LD4D02D010-EU4DR150210IC9035-4LBSQW1MW

Luminous Intensity Polar Plot

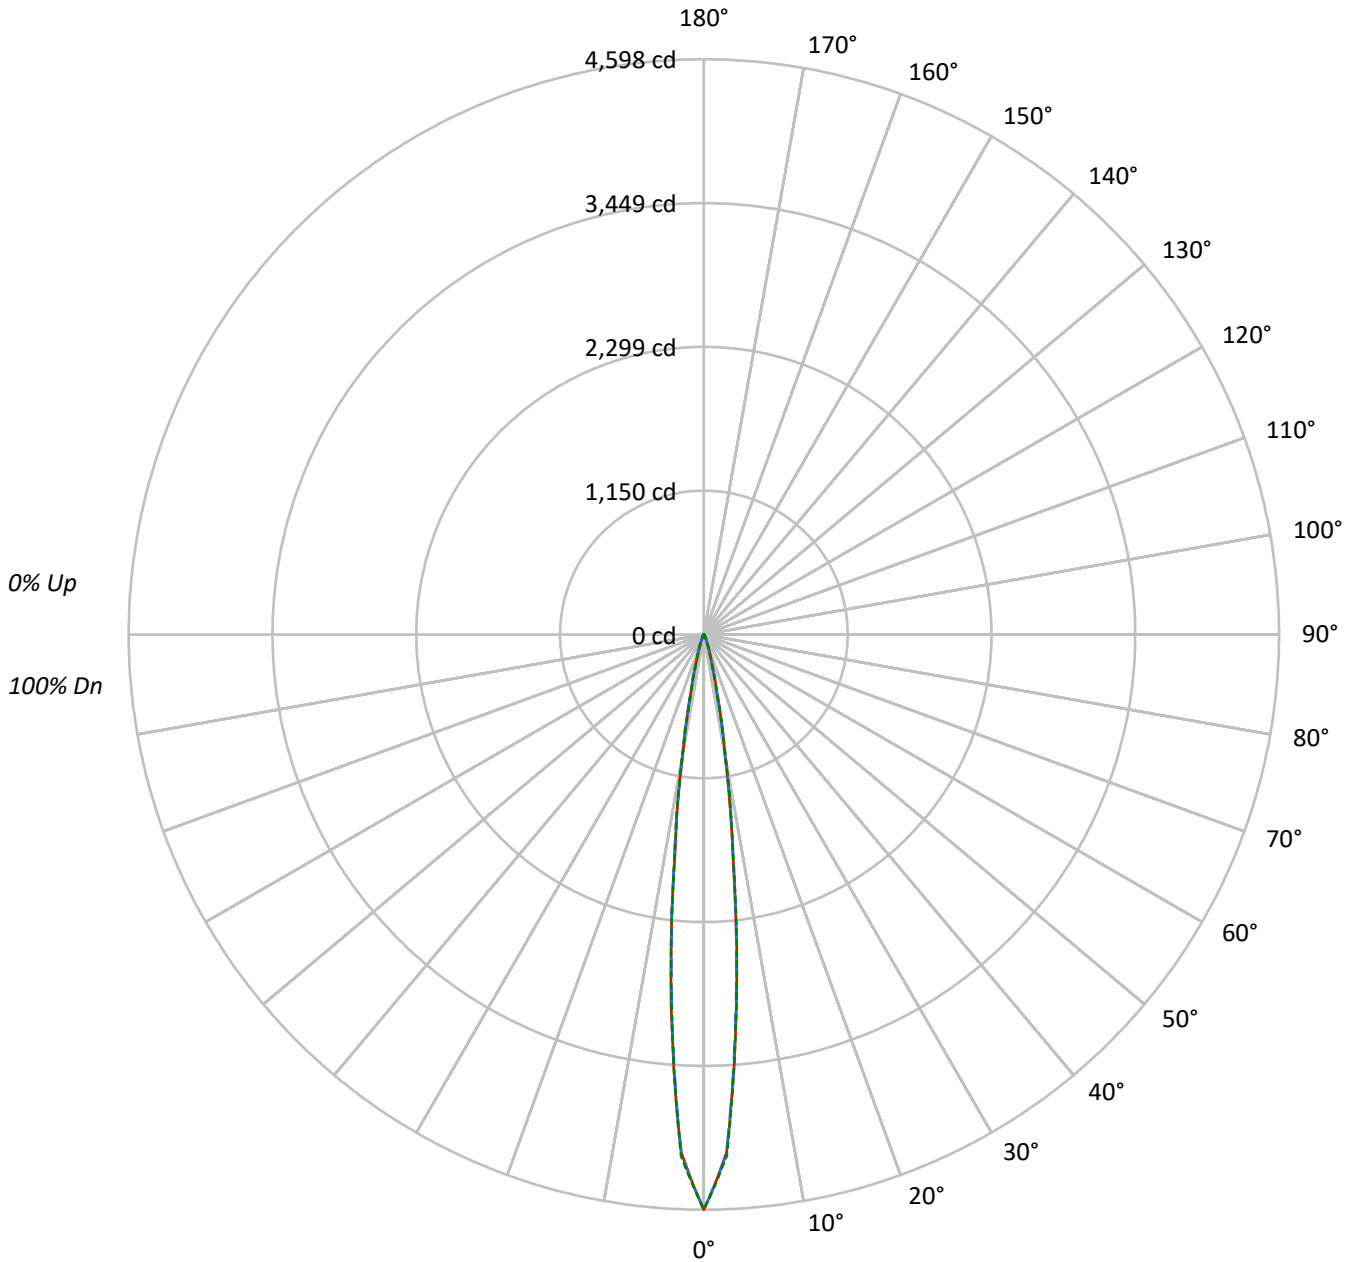



TEST NUMBER: P738872

CATALOG NUMBER: LD4D02D010-EU4DR150210IC9035-4LBSQW1MW

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0																
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100																			
1	116	114	112	111	113	112	110	109	108	107	106	104	103	103	101	100	100	98																			
2	113	110	107	105	111	108	106	104	105	103	102	102	101	100	100	98	98	96																			
3	110	106	103	101	108	105	102	100	103	100	99	100	99	97	98	97	96	94																			
4	108	103	100	98	106	102	99	97	100	98	96	99	97	95	97	95	94	93																			
5	105	101	98	95	104	100	97	95	98	96	94	97	95	93	96	94	92	92																			
6	104	99	95	93	102	98	95	93	97	94	92	96	93	92	95	93	91	90																			
7	102	97	93	91	101	96	93	91	95	93	91	94	92	90	93	91	90	89																			
8	100	95	92	90	99	95	92	90	94	91	89	93	91	89	92	90	89	88																			
9	99	93	90	88	98	93	90	88	92	90	88	92	89	88	91	89	87	87																			
10	97	92	89	87	96	92	89	87	91	89	87	91	88	87	90	88	86	86																			

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	517423	517423	517423
5°	304064	300130	302498
10°	90751	91385	92785
15°	22574	23008	22305
20°	6750	7822	6898
25°	2384	3030	2415
30°	876	1153	891
35°	436	494	421
40°	277	305	277
45°	203	217	203
50°	160	160	160
55°	132	132	132
60°	112	112	112
65°	86	86	86
70°	73	73	73
75°	45	45	60
80°	32	32	32
85°	17	17	17

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 45°

Vertical Angle: 45°

Luminance: 217 cd/sqm



TEST NUMBER: P738872

CATALOG NUMBER: LD4D02D010-EU4DR150210IC9035-4LBSQW1MW

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	218.9	64.8
10°-20°	90.0	26.7
20°-30°	17.9	5.3
30°-40°	4.5	1.3
40°-50°	2.3	0.7
50°-60°	1.7	0.5
60°-70°	1.3	0.4
70°-80°	0.7	0.2
80°-90°	0.2	0.1
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	326.8	96.8
0°-40°	331.3	98.1
0°-60°	335.4	99.3
0°-90°	337.6	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	337.6	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	4598	4598	4598	4598	4598	
5°	2992	2961	2953	2974	2976	218
15°	260	265	265	260	257	89
25°	31	35	39	34	31	16
35°	6	6	7	6	6	4
45°	3	3	3	3	3	2
55°	2	2	2	2	2	2
65°	1	1	1	1	1	1
75°	1	1	1	1	1	1
85°	0	0	0	0	0	0
90°	0	0	0	0	0	



TEST NUMBER: P738872

CATALOG NUMBER: LD4D02D010-EU4DR150210IC9035-4LBSQW1MW

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	4598.5	4598.5	4598.5	4598.5	4598.5
2.5°	4148.1	4151.6	4152.9	4157.0	4172.2
5°	2991.9	2961.1	2953.2	2973.6	2976.5
7.5°	1772.3	1778.5	1801.3	1806.4	1788.1
10°	972.6	980.6	979.4	986.4	994.4
12.5°	497.4	491.2	489.2	497.2	486.1
15°	259.9	264.8	264.9	260.3	256.8
17.5°	139.8	145.4	154.8	147.2	135.5
20°	82.5	87.6	95.6	89.4	84.3
22.5°	51.0	55.1	60.7	55.9	51.8
25°	30.6	34.7	38.9	34.5	31.0
27.5°	18.1	21.6	24.3	21.4	17.9
30°	11.7	13.6	15.4	13.4	11.9
32.5°	8.2	9.0	9.7	9.0	8.2
35°	6.0	6.4	6.8	6.4	5.8
37.5°	4.7	5.1	5.3	4.9	4.5
40°	3.9	4.1	4.3	4.1	3.9
42.5°	3.3	3.5	3.5	3.5	3.3
45°	2.9	2.9	3.1	2.9	2.9
47.5°	2.5	2.5	2.7	2.5	2.5
50°	2.3	2.3	2.3	2.3	2.3
52.5°	2.1	2.1	2.1	2.1	2.1
55°	1.9	1.9	1.9	1.9	1.9
57.5°	1.8	1.8	1.8	1.8	1.8
60°	1.6	1.6	1.6	1.6	1.6
62.5°	1.4	1.4	1.4	1.4	1.4
65°	1.2	1.2	1.2	1.2	1.2
67.5°	1.2	1.2	1.2	1.2	1.2
70°	1.0	1.0	1.0	1.0	1.0
72.5°	0.8	0.8	0.8	0.8	0.8
75°	0.6	0.6	0.6	0.6	0.8
77.5°	0.6	0.6	0.6	0.6	0.6
80°	0.4	0.4	0.4	0.4	0.4
82.5°	0.4	0.4	0.4	0.4	0.4
85°	0.2	0.2	0.2	0.2	0.2
87.5°	0.0	0.0	0.0	0.0	0.0
90°	0.0	0.0	0.0	0.0	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report





— 0°-180° - - 45°-225° - - - - 90°-270°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)