

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P744901

Luminaire Tested: LD4D25D010-EU4DR2015309030-4LBCSSQMW

Issue Date: 2/2/2024

Test Information

Test Method: LM-79-2019
Report Number: P744901
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2310-195-36)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/2/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LD4D25D010-EU4DR2015309030-4LBCSSQMW
Description: 4 INCH SQAURE SHALLOW CAST MATTE WHITE TRIM, WITH 20° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 3000K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 2359.9 lumens
Efficiency: N/A
Efficacy: 94.0 lumens/watt
Spacing Criteria (0/90/45): 0.34 / 0.34 / 0.36
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct

Input Watts (W): 25.1
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT




Downlight



TEST NUMBER: P744901
CATALOG NUMBER: LD4D25D010-EU4DR2015309030-4LBCSSQMW

Luminous Intensity Polar Plot

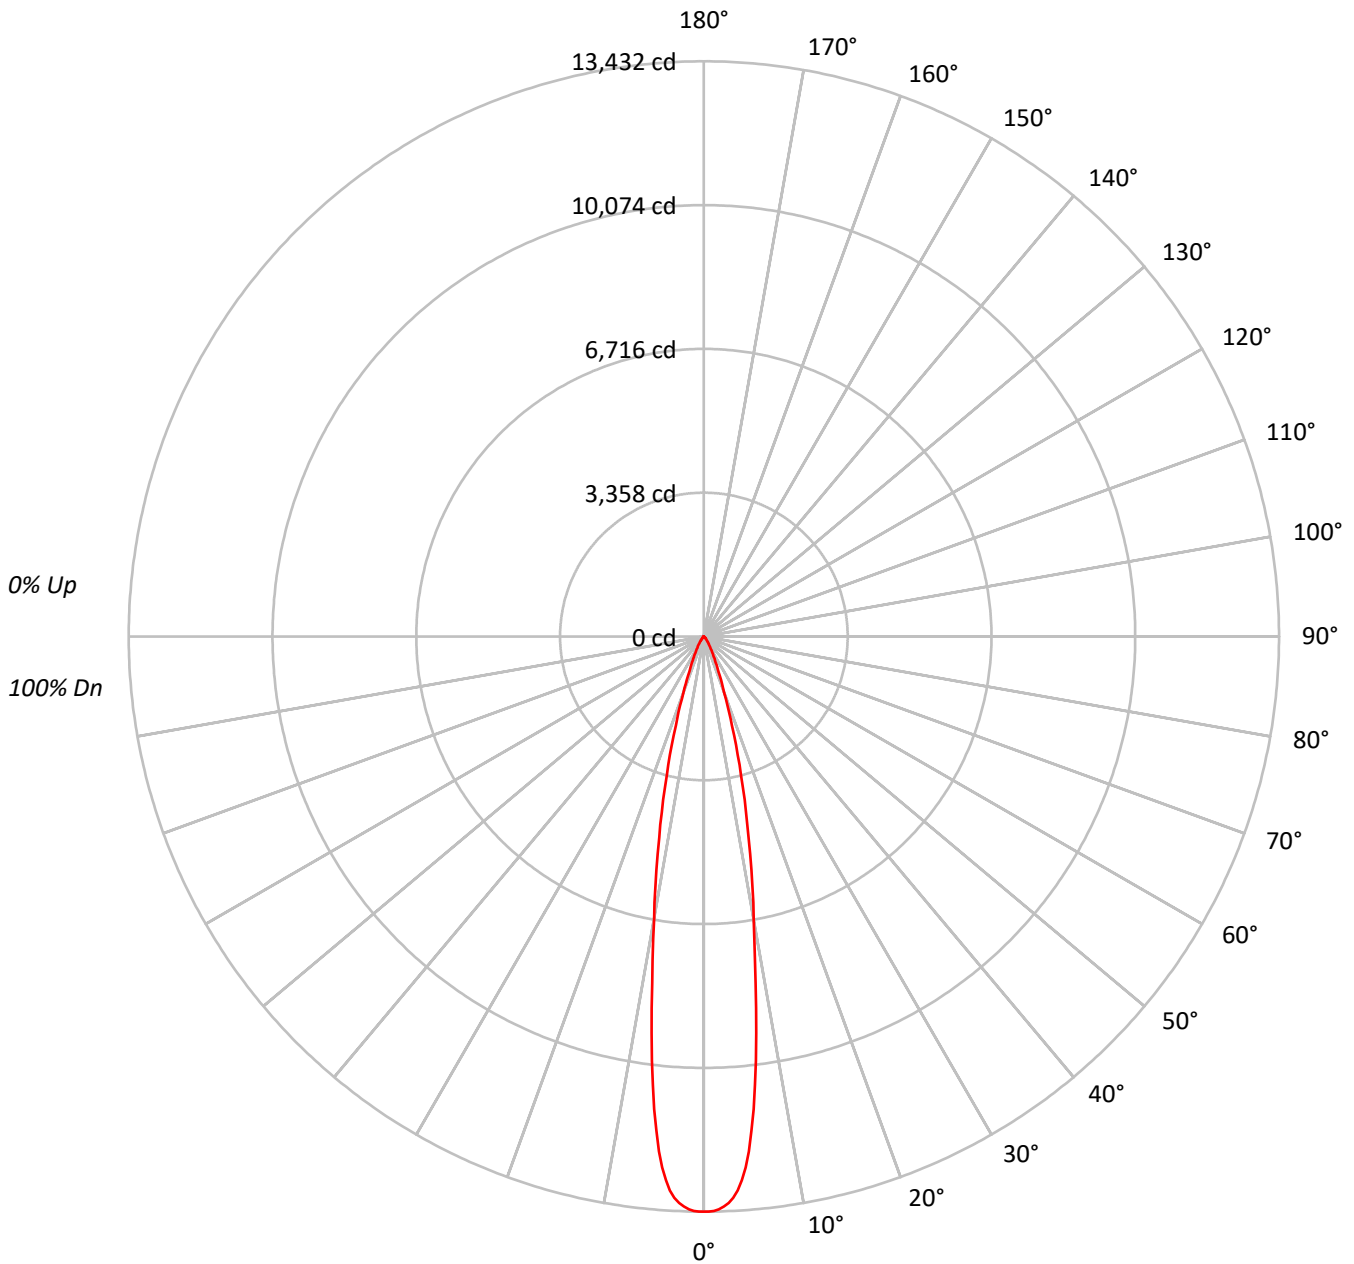



TEST NUMBER: P744901

CATALOG NUMBER: LD4D25D010-EU4DR2015309030-4LBCSSQMW

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0																
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100				100															
1	115	113	111	109	113	111	109	108	107	106	104	103	102	101	100	99	98	97	98	96	95	94															
2	111	108	105	102	109	106	104	101	103	101	99	100	99	97	98	96	95	94	98	96	95	94															
3	108	103	100	97	106	102	99	96	100	97	95	97	95	93	95	93	92	91	95	93	92	91															
4	105	99	96	93	103	98	95	92	96	93	91	95	92	90	93	91	89	88	93	91	89	88															
5	102	96	92	89	100	95	91	89	94	90	88	92	89	87	91	88	86	85	91	88	86	85															
6	99	93	89	86	98	92	88	86	91	87	85	90	87	84	88	86	84	83	88	86	84	83															
7	96	90	86	83	95	89	86	83	88	85	82	87	84	82	86	84	82	81	86	84	82	81															
8	94	87	83	81	93	87	83	80	86	83	80	85	82	80	84	82	80	79	84	82	80	79															
9	91	85	81	78	91	85	81	78	84	80	78	83	80	78	82	80	78	77	82	80	78	77															
10	89	83	79	76	88	82	79	76	82	78	76	81	78	76	81	78	76	75	81	78	76	75															

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	1467558
5°	1324012
10°	743107
15°	377736
20°	159933
25°	73828
30°	39085
35°	21061
40°	11253
45°	6660
50°	3859
55°	2057
60°	1311
65°	931
70°	383
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 6660 cd/sqm



TEST NUMBER: P744901

CATALOG NUMBER: LD4D25D010-EU4DR2015309030-4LBCSSQMW

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	956.3	40.5
10°-20°	941.7	39.9
20°-30°	307.6	13.0
30°-40°	104.7	4.4
40°-50°	35.2	1.5
50°-60°	10.6	0.5
60°-70°	3.5	0.2
70°-80°	0.2	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	2205.6	93.5
0°-40°	2310.4	97.9
0°-60°	2356.2	99.8
0°-90°	2359.9	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	2359.9	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	13432	
5°	12072	956
15°	3339	942
25°	612	308
35°	158	105
45°	43	35
55°	11	11
65°	4	4
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P744901

CATALOG NUMBER: LD4D25D010-EU4DR2015309030-4LBCSSQMW

CANDELA DISTRIBUTION (FULL):

	0°
0°	13431.7
0.5°	13431.7
1°	13415.0
1.5°	13381.5
2°	13320.5
2.5°	13239.2
3°	13124.4
3.5°	12964.1
4°	12726.1
4.5°	12436.6
5°	12071.8
5.5°	11592.2
6°	11100.6
6.5°	10537.3
7°	9985.9
7.5°	9340.0
8°	8763.5
8.5°	8183.4
9°	7647.6
9.5°	7156.0
10°	6697.9
12.5°	4809.4
15°	3339.4
17.5°	2181.6
20°	1375.5
22.5°	891.1
25°	612.4
27.5°	430.6
30°	309.8
32.5°	222.5
35°	157.9
37.5°	110.0
40°	78.9
42.5°	57.4
45°	43.1
47.5°	33.5
50°	22.7
52.5°	14.4
55°	10.8
57.5°	8.4
60°	6.0
62.5°	4.8
65°	3.6



TEST NUMBER: P744901
CATALOG NUMBER: LD4D25D010-EU4DR2015309030-4LBCSSQMW

CANDELA DISTRIBUTION (continued):

	0°
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report





67.5°		2.4
70°		1.2

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)