

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P747228

Luminaire Tested: LD4D35BD010-EU4DR6020359027-4LBCSSQMW

Issue Date: 1/30/2024

Test Information

Test Method: LM-79-2019
Report Number: P747228
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-60)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 1/30/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LD4D35BD010-EU4DR6020359027-4LBCSSQMW
Description: 4 INCH SQAURE SHALLOW CAST MATTE WHITE TRIM, WITH 60° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 2700K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 3051.7 lumens
Efficiency: N/A
Efficacy: 99.1 lumens/watt
Spacing Criteria (0/90/45): 0.98 / 0.98 / 0.92
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct


Input Watts (W): 30.8
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT



TEST NUMBER: P747228

CATALOG NUMBER: LD4D35BD010-EU4DR6020359027-4LBCSSQMW

Luminous Intensity Polar Plot

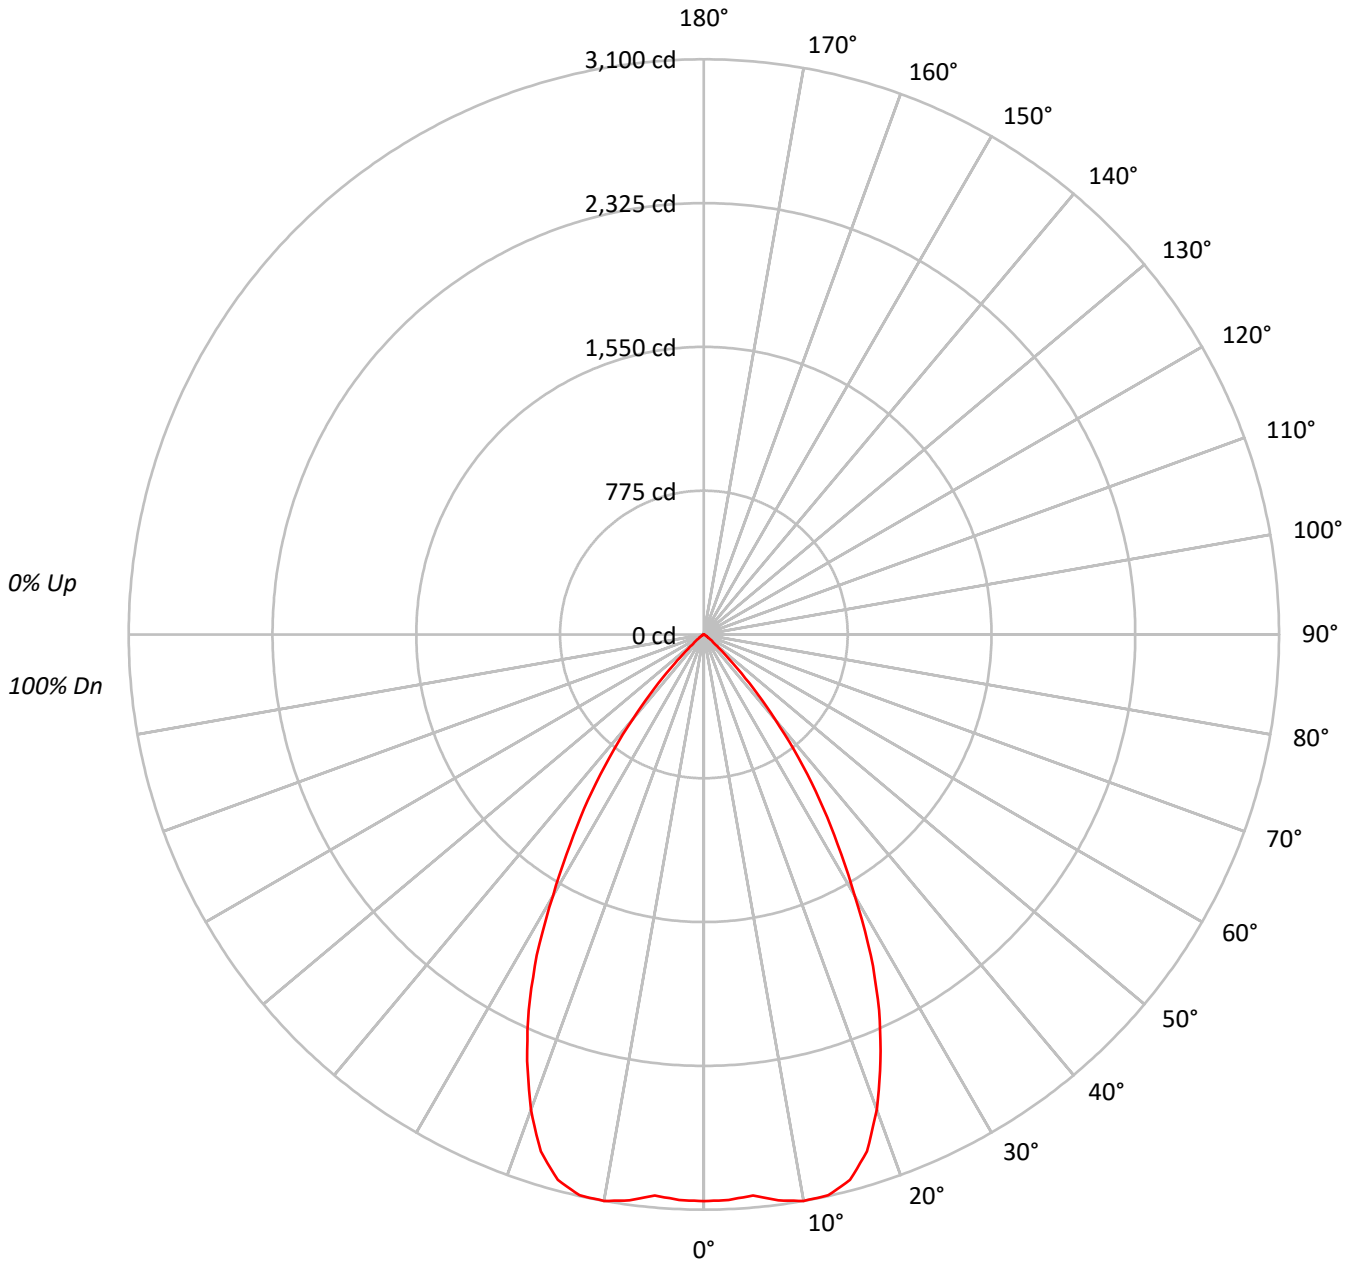



TEST NUMBER: P747228

CATALOG NUMBER: LD4D35BD010-EU4DR6020359027-4LBCSSQMW

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10		0		
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			
1	114	111	108	106	111	109	106	104	105	103	101	101	99	98	97	96	95	94			
2	108	103	99	96	106	101	98	95	98	95	92	95	93	90	92	90	89	87			
3	102	96	91	87	100	95	90	86	92	88	85	90	86	84	87	85	82	81			
4	97	90	84	80	95	88	83	79	86	82	78	84	81	78	82	79	77	75			
5	92	84	78	74	91	83	77	73	81	76	73	79	75	72	78	74	71	70			
6	87	79	73	68	86	78	72	68	76	71	68	75	70	67	74	70	67	65			
7	83	74	68	63	82	73	67	63	72	67	63	71	66	63	69	65	62	61			
8	79	69	63	59	78	69	63	59	68	63	59	67	62	59	66	61	58	57			
9	75	65	59	55	74	65	59	55	64	59	55	63	58	55	62	58	55	53			
10	72	62	56	52	71	61	56	52	61	55	52	60	55	52	59	55	52	50			

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	333682
5°	332873
10°	343922
15°	344277
20°	316774
25°	269442
30°	205306
35°	145187
40°	85250
45°	34396
50°	11491
55°	5524
60°	2273
65°	336
70°	0
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 34396 cd/sqm



TEST NUMBER: P747228

CATALOG NUMBER: LD4D35BD010-EU4DR6020359027-4LBCSSQMW

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	292.8	9.6
10°-20°	843.2	27.6
20°-30°	1009.2	33.1
30°-40°	675.0	22.1
40°-50°	200.1	6.6
50°-60°	28.8	0.9
60°-70°	2.7	0.1
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	2145.1	70.3
0°-40°	2820.1	92.4
0°-60°	3049.0	99.9
0°-90°	3051.7	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	3051.7	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	3054	
5°	3035	293
15°	3044	843
25°	2235	1009
35°	1088	675
45°	223	200
55°	29	29
65°	1	3
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P747228

CATALOG NUMBER: LD4D35BD010-EU4DR6020359027-4LBCSSQMW

CANDELA DISTRIBUTION (FULL):

	0°
0°	3054.0
2.5°	3050.1
5°	3035.0
7.5°	3076.1
10°	3099.9
12.5°	3095.6
15°	3043.6
17.5°	2921.0
20°	2724.4
22.5°	2488.3
25°	2235.0
27.5°	1949.5
30°	1627.3
32.5°	1339.7
35°	1088.5
37.5°	836.8
40°	597.7
42.5°	394.2
45°	222.6
47.5°	113.9
50°	67.6
52.5°	43.7
55°	29.0
57.5°	18.6
60°	10.4
62.5°	4.3
65°	1.3
67.5°	0.4
70°	0.0
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)