

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P747670

Luminaire Tested: LD4D40BD010-EU4DR3540509050-4LBCSSQMW

Issue Date: 1/30/2024

Test Information

Test Method: LM-79-2019
Report Number: P747670
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-20)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 1/30/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LD4D40BD010-EU4DR3540509050-4LBCSSQMW
Description: 4 INCH SQAURE SHALLOW CAST MATTE WHITE TRIM, WITH 35° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 5000K CCT
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 3746.1 lumens
Efficiency: N/A
Efficacy: 106.4 lumens/watt
Spacing Criteria (0/90/45): 0.6 / 0.6 / 0.54
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct

Input Watts (W): 35.2
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT



TEST NUMBER: P747670
CATALOG NUMBER: LD4D40BD010-EU4DR3540509050-4LBCSSQMW

Luminous Intensity Polar Plot

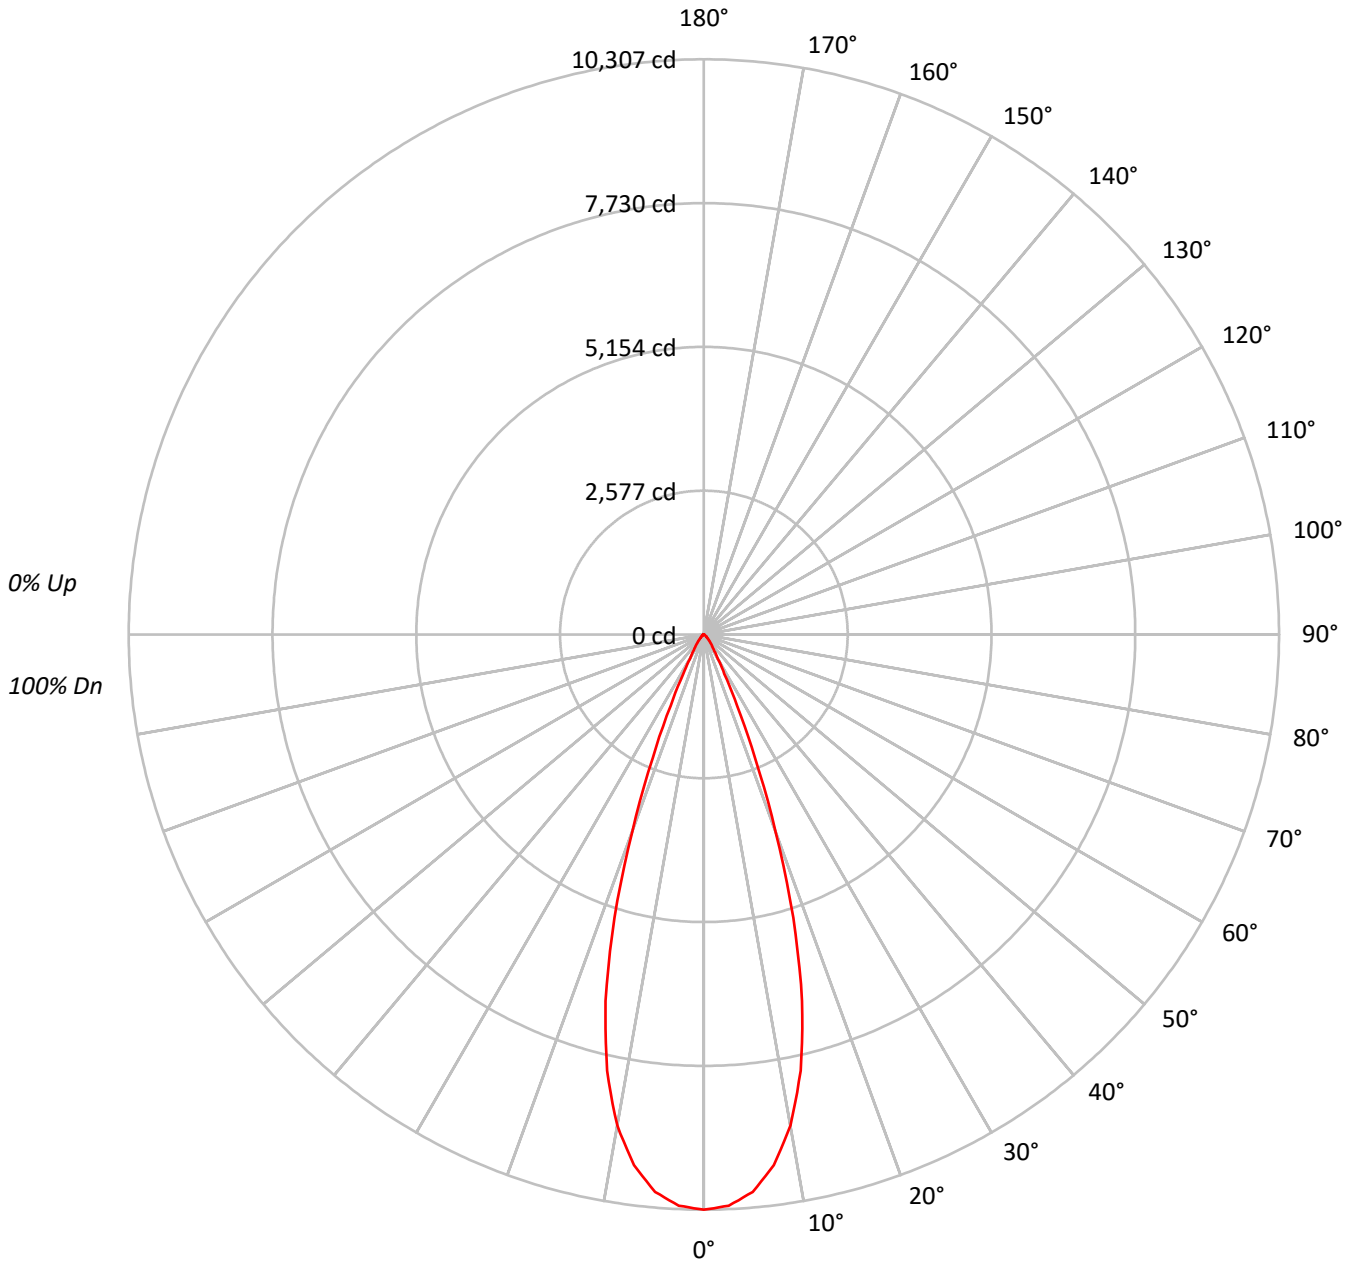



TEST NUMBER: P747670

CATALOG NUMBER: LD4D40BD010-EU4DR3540509050-4LBCSSQMW

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0																
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			100																
1	115	112	110	108	112	110	108	107	106	105	103	103	101	100	99	98	98	96			96																
2	110	106	103	101	108	105	102	99	102	99	97	99	97	95	96	95	93	92			92																
3	106	101	97	94	105	100	96	93	97	95	92	95	93	91	93	91	89	88			88																
4	103	97	92	89	101	96	92	89	94	90	88	92	89	87	90	88	86	84			84																
5	99	93	88	85	98	92	87	84	90	86	84	89	85	83	87	84	82	81			81																
6	96	89	84	81	94	88	84	81	87	83	80	85	82	80	84	81	79	78			78																
7	93	85	81	78	91	85	80	77	84	80	77	83	79	77	82	79	76	75			75																
8	90	82	78	74	88	82	77	74	81	77	74	80	76	74	79	76	73	72			72																
9	87	79	75	72	86	79	75	72	78	74	71	77	74	71	77	73	71	70			70																
10	84	77	72	69	83	76	72	69	76	72	69	75	71	69	74	71	69	68			68																

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	1126172
5°	1099710
10°	991127
15°	769273
20°	436326
25°	169755
30°	63334
35°	34720
40°	22692
45°	13814
50°	8788
55°	6210
60°	4545
65°	2482
70°	192
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 13814 cd/sqm



TEST NUMBER: P747670

CATALOG NUMBER: LD4D40BD010-EU4DR3540509050-4LBCSSQMW

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	922.2	24.6
10°-20°	1800.5	48.1
20°-30°	734.3	19.6
30°-40°	175.7	4.7
40°-50°	73.2	2.0
50°-60°	30.3	0.8
60°-70°	9.5	0.3
70°-80°	0.2	0.0
80°-90°	0.2	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	3456.9	92.3
0°-40°	3632.6	97.0
0°-60°	3736.2	99.7
0°-90°	3746.1	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	3746.1	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	10307	
5°	10027	922
15°	6801	1800
25°	1408	734
35°	260	176
45°	89	73
55°	33	30
65°	10	10
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P747670

CATALOG NUMBER: LD4D40BD010-EU4DR3540509050-4LBCSSQMW

CANDELA DISTRIBUTION (FULL):

0°	
0°	10307.2
2.5°	10245.4
5°	10026.7
7.5°	9590.5
10°	8933.4
12.5°	8008.2
15°	6800.8
17.5°	5324.2
20°	3752.6
22.5°	2392.9
25°	1408.1
27.5°	795.9
30°	502.0
32.5°	352.4
35°	260.3
37.5°	201.2
40°	159.1
42.5°	122.5
45°	89.4
47.5°	66.9
50°	51.7
52.5°	41.0
55°	32.6
57.5°	26.4
60°	20.8
62.5°	15.2
65°	9.6
67.5°	3.4
70°	0.6
72.5°	0.6
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.6
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)