

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P748956

Luminaire Tested: LD4D45BD010-EU4DR7040509030-4LBCSSQMMS

Issue Date: 1/30/2024

Test Information

Test Method: LM-79-2019
Report Number: P748956
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-76)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 1/30/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LD4D45BD010-EU4DR7040509030-4LBCSSQMMMS
Description: 4 INCH SQAURE SHALLOW CAST MATTE METALLIC SILVER TRIM, WITH 70° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 3000K CCT
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 4091.2 lumens
Efficiency: N/A
Efficacy: 105.7 lumens/watt
Spacing Criteria (0/90/45): 1.1 / 1.1 / 1.04
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct

Input Watts (W): 38.7
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT



TEST NUMBER: P748956
CATALOG NUMBER: LD4D45BD010-EU4DR7040509030-4LBCSSQMMS

Luminous Intensity Polar Plot

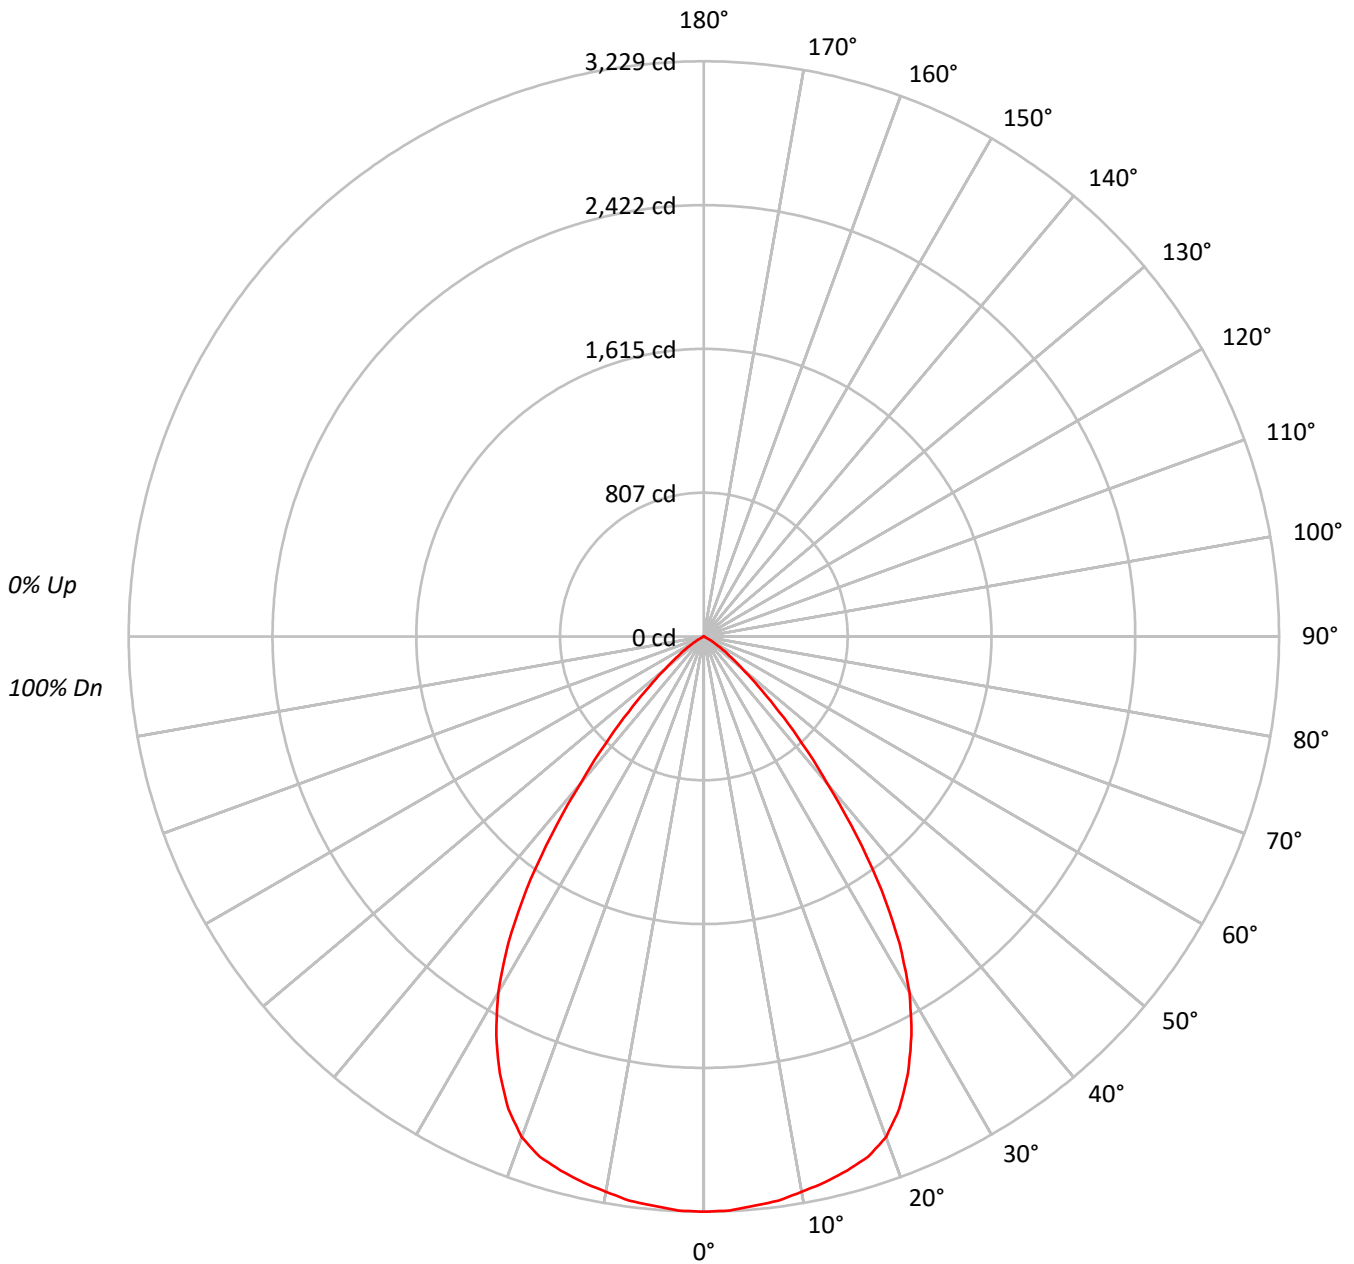



TEST NUMBER: P748956

CATALOG NUMBER: LD4D45BD010-EU4DR7040509030-4LBCSSQMMS

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20			
RC	80				70				50				30				10		0	
RW	70	50	30	10	70	50	30	10	50	30	10		50	30	10		50	30	10	0
RCR																				
0	119	119	119	119	116	116	116	116	111	111	111		106	106	106		102	102	102	100
1	113	110	107	105	111	108	106	103	104	102	100		100	99	97		97	95	94	93
2	107	102	97	94	105	100	96	92	97	93	90		94	91	88		91	89	87	85
3	101	94	88	84	99	92	87	83	90	85	82		87	84	81		85	82	79	78
4	95	87	81	76	93	86	80	76	83	78	75		81	77	74		79	76	73	71
5	89	80	74	69	88	79	73	69	78	72	68		76	71	68		74	70	67	65
6	84	75	68	63	83	74	68	63	72	67	63		71	66	62		69	65	62	60
7	80	69	63	58	78	69	62	58	67	62	58		66	61	57		65	61	57	56
8	75	65	58	54	74	64	58	54	63	57	53		62	57	53		61	56	53	51
9	71	61	54	50	70	60	54	50	59	53	50		58	53	49		57	53	49	48
10	67	57	50	46	66	56	50	46	55	50	46		55	50	46		54	49	46	44

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	352814
5°	351935
10°	351178
15°	351075
20°	347644
25°	326562
30°	291135
35°	232126
40°	154126
45°	92155
50°	47764
55°	25107
60°	8872
65°	155
70°	0
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 92155 cd/sqm



TEST NUMBER: P748956

CATALOG NUMBER: LD4D45BD010-EU4DR7040509030-4LBCSSQMMS

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	305.2	7.5
10°-20°	875.2	21.4
20°-30°	1234.6	30.2
30°-40°	1065.8	26.1
40°-50°	477.3	11.7
50°-60°	124.9	3.1
60°-70°	8.1	0.2
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	2415.0	59.0
0°-40°	3480.8	85.1
0°-60°	4083.0	99.8
0°-90°	4091.2	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	4091.2	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	3229	
5°	3209	305
15°	3104	875
25°	2709	1235
35°	1740	1066
45°	596	477
55°	132	125
65°	1	8
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P748956

CATALOG NUMBER: LD4D45BD010-EU4DR7040509030-4LBCSSQMMS

CANDELA DISTRIBUTION (FULL):

	0°
0°	3229.1
2.5°	3225.6
5°	3208.8
7.5°	3194.9
10°	3165.3
12.5°	3138.5
15°	3103.7
17.5°	3063.6
20°	2989.9
22.5°	2868.5
25°	2708.8
27.5°	2523.6
30°	2307.6
32.5°	2043.4
35°	1740.3
37.5°	1405.8
40°	1080.6
42.5°	821.1
45°	596.4
47.5°	411.1
50°	281.0
52.5°	193.9
55°	131.8
57.5°	79.6
60°	40.6
62.5°	12.8
65°	0.6
67.5°	0.0
70°	0.0
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)