

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P748304

Luminaire Tested: LD4D45BD010-EU4DR2540509050-4LBSQW1MW

Issue Date: 1/30/2024

Test Information

Test Method: LM-79-2019
Report Number: P748304
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-4)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 1/30/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LD4D45BD010-EU4DR2540509050-4LBSQW1MW
Description: 4 INCH SQAURE DEEP 45° CUTOFF MATTE WHITE TRIM, WITH 25° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 5000K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 3333.7 lumens
Efficiency: N/A
Efficacy: 86.1 lumens/watt
Spacing Criteria (0/90/45): 0.42 / 0.42 / 0.45
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct


Input Watts (W): 38.7
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT



TEST NUMBER: P748304

CATALOG NUMBER: LD4D45BD010-EU4DR2540509050-4LBSQW1MW

Luminous Intensity Polar Plot

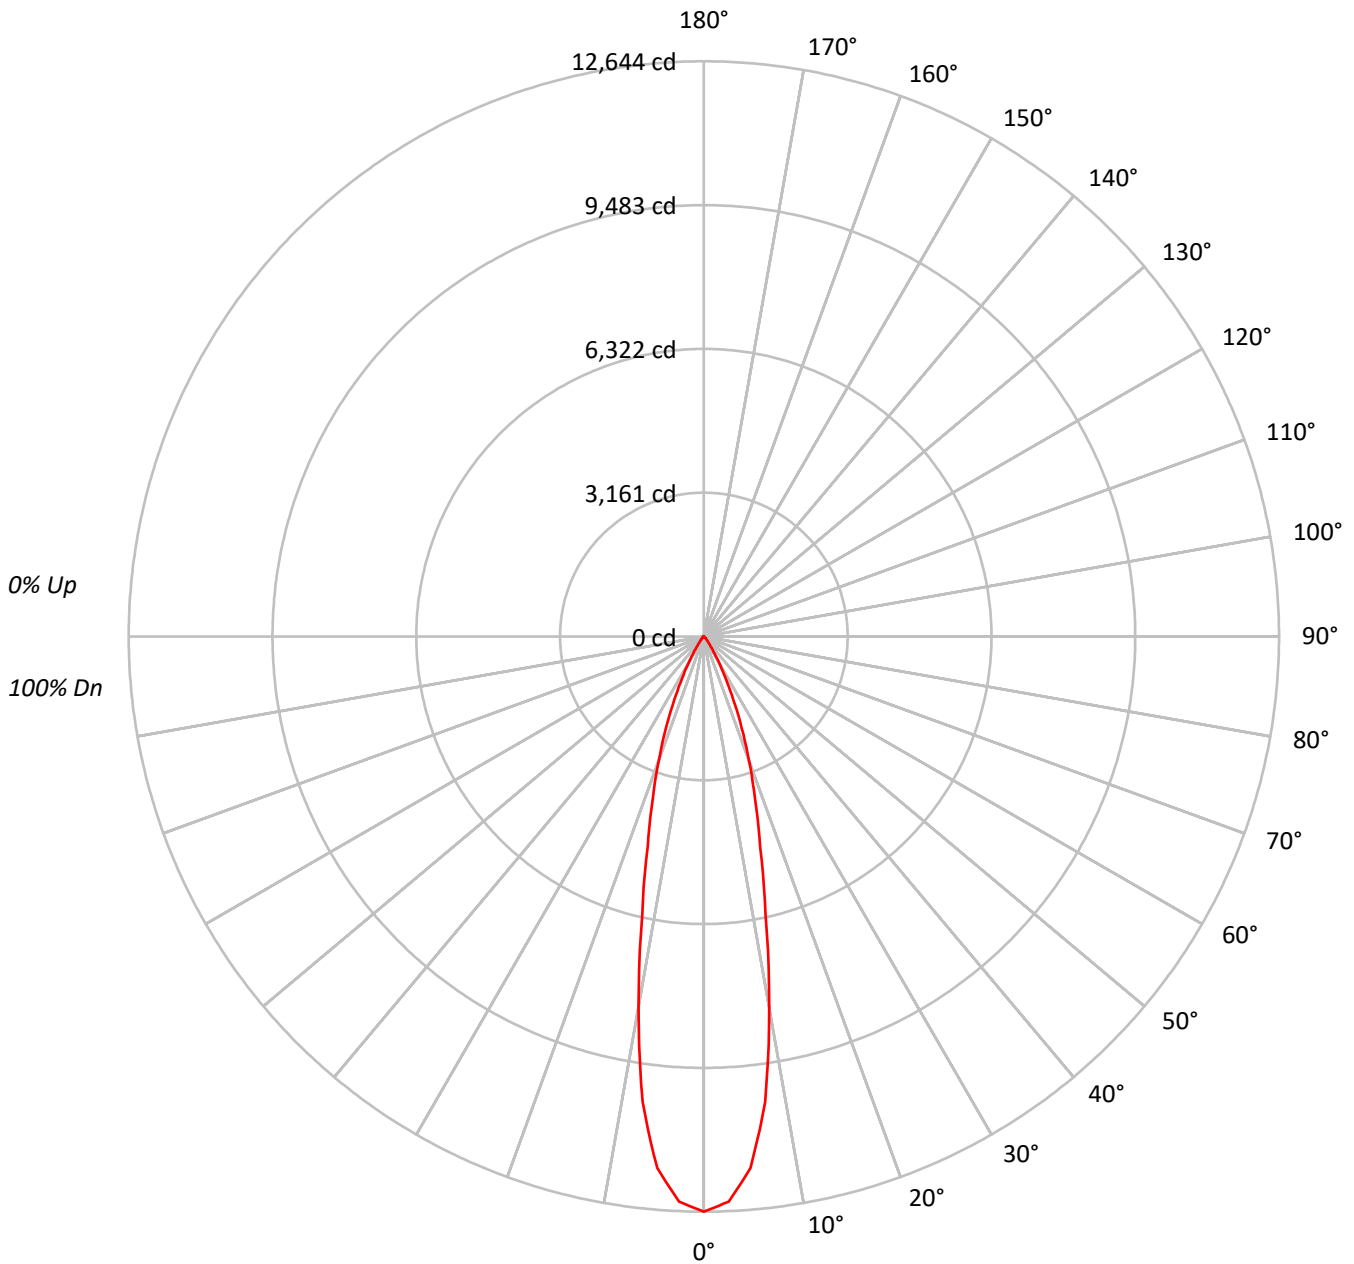



TEST NUMBER: P748304

CATALOG NUMBER: LD4D45BD010-EU4DR2540509050-4LBSQW1MW

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0																
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100																			
1	115	113	111	109	112	110	109	107	106	105	104	103	102	101	99	99	98	96																			
2	111	107	104	101	109	105	102	100	102	100	98	99	97	96	97	95	94	92																			
3	107	102	98	95	105	101	97	94	98	95	93	96	93	91	94	92	90	89																			
4	103	97	93	90	102	96	93	90	94	91	89	93	90	88	91	89	87	85																			
5	100	93	89	86	98	93	89	86	91	87	85	89	86	84	88	85	83	82																			
6	97	90	85	82	95	89	85	82	88	84	81	87	83	81	85	83	80	79																			
7	93	87	82	79	92	86	82	79	85	81	78	84	80	78	83	80	78	77																			
8	91	84	79	76	90	83	79	76	82	78	76	81	78	75	80	77	75	74																			
9	88	81	76	73	87	80	76	73	80	76	73	79	75	73	78	75	73	72																			
10	85	78	74	71	85	78	74	71	77	73	71	76	73	71	76	73	70	69																			

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	1381504
5°	1286689
10°	917836
15°	540566
20°	336354
25°	184583
30°	84416
35°	31972
40°	14477
45°	8699
50°	3621
55°	2324
60°	1617
65°	1112
70°	160
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 8699 cd/sqm



TEST NUMBER: P748304

CATALOG NUMBER: LD4D45BD010-EU4DR2540509050-4LBSQW1MW

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	1008.2	30.2
10°-20°	1365.6	41.0
20°-30°	722.6	21.7
30°-40°	178.4	5.4
40°-50°	43.5	1.3
50°-60°	11.5	0.3
60°-70°	3.8	0.1
70°-80°	0.1	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	3096.4	92.9
0°-40°	3274.8	98.2
0°-60°	3329.8	99.9
0°-90°	3333.7	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	3333.7	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	12644	
5°	11732	###
15°	4779	1366
25°	1531	723
35°	240	178
45°	56	44
55°	12	11
65°	4	4
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P748304

CATALOG NUMBER: LD4D45BD010-EU4DR2540509050-4LBSQW1MW

CANDELA DISTRIBUTION (FULL):

	0°
0°	12644.1
2.5°	12436.3
5°	11731.5
7.5°	10315.7
10°	8272.8
12.5°	6253.7
15°	4778.9
17.5°	3724.5
20°	2892.8
22.5°	2169.4
25°	1531.1
27.5°	1026.8
30°	669.1
32.5°	407.1
35°	239.7
37.5°	146.7
40°	101.5
42.5°	77.6
45°	56.3
47.5°	34.0
50°	21.3
52.5°	15.4
55°	12.2
57.5°	9.6
60°	7.4
62.5°	5.8
65°	4.3
67.5°	1.6
70°	0.5
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)