

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P740587

Luminaire Tested: LD4D05D010-EU4DR600210IC9035-4LBSQW1B

Issue Date: 2/5/2024

Test Information

Test Method: LM-79-2019
Report Number: P740587
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-57)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/5/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LD4D05D010-EU4DR600210IC9035-4LBSQW1B
Description: 4 INCH SQAURE DEEP 45° CUTOFF SPECULAR BLACK TRIM, WITH 60° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 3500K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 536.8 lumens
Efficiency: N/A
Efficacy: 71.6 lumens/watt
Spacing Criteria (0/90/45): 0.91 / 0.91 / 0.84
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct

Input Watts (W): 7.5
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT




Downlight



TEST NUMBER: P740587
CATALOG NUMBER: LD4D05D010-EU4DR600210IC9035-4LBSQW1B

Luminous Intensity Polar Plot

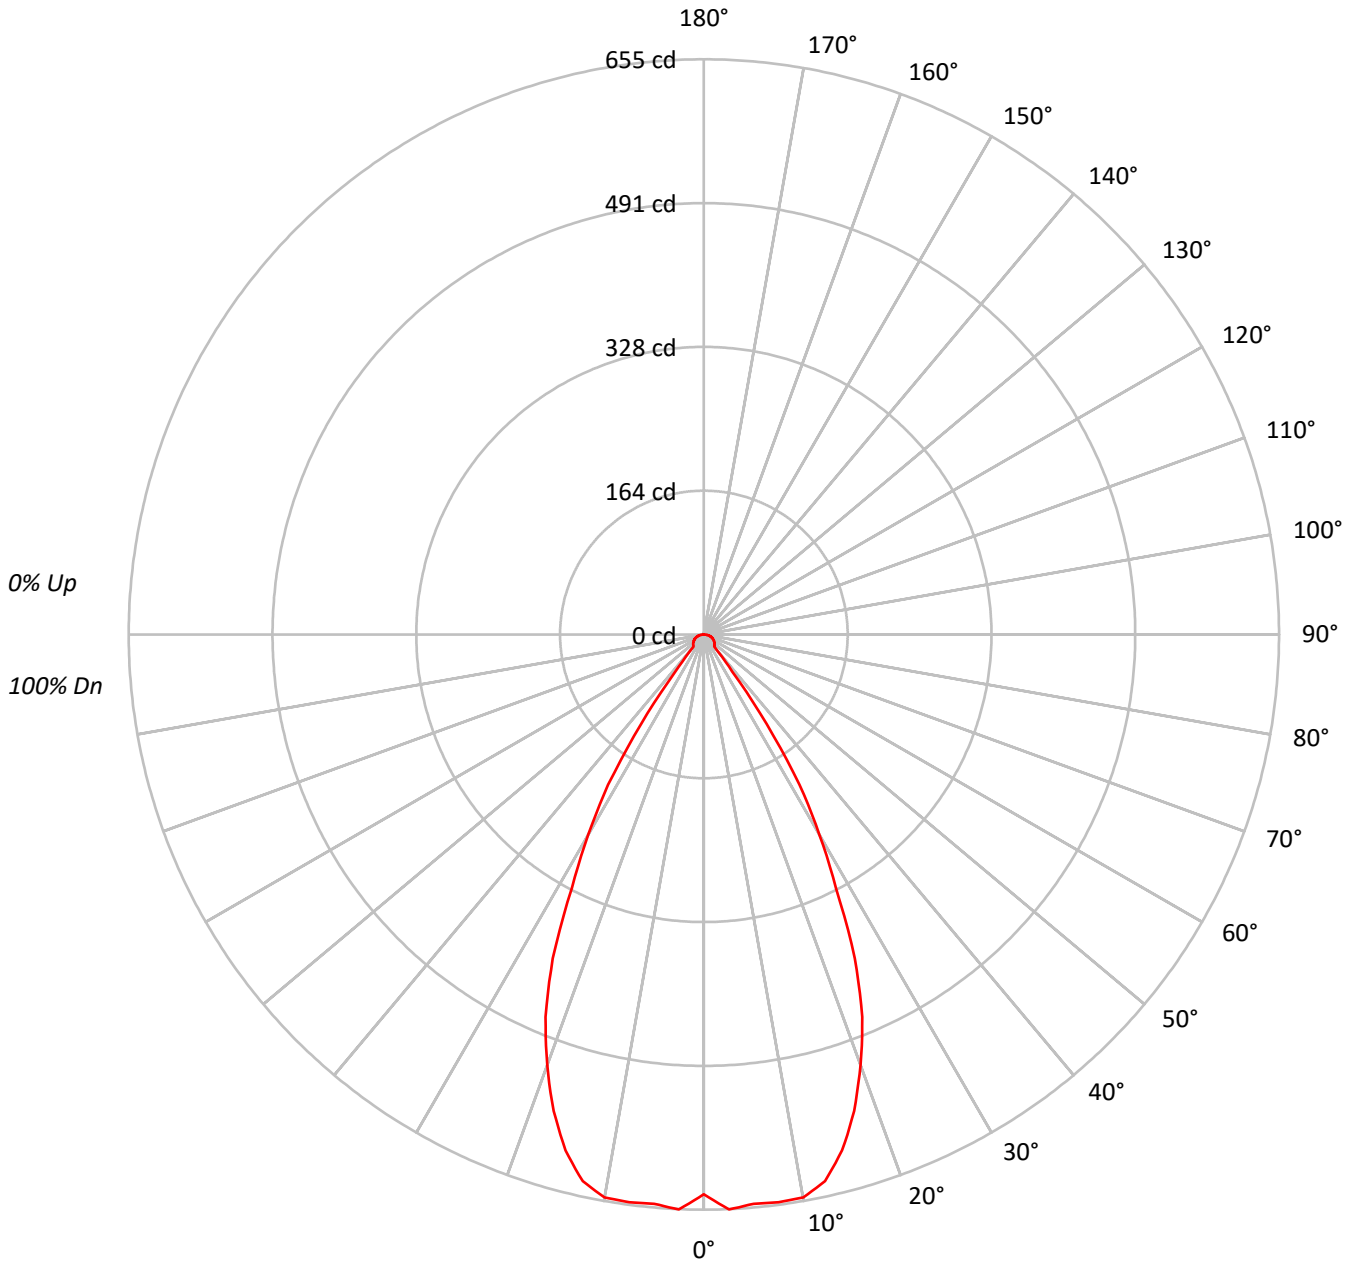



TEST NUMBER: P740587

CATALOG NUMBER: LD4D05D010-EU4DR600210IC9035-4LBSQW1B

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20			
RC	80				70				50				30				10		0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10
RCR																				
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100		
1	113	110	108	105	111	108	106	104	104	102	100	100	99	97	97	96	95	93		
2	107	102	98	95	105	101	97	94	97	94	92	94	92	90	92	90	88	86		
3	102	96	90	86	100	94	89	86	91	88	84	89	86	83	87	84	82	80		
4	97	89	84	80	95	88	83	79	86	82	78	84	80	77	82	79	76	75		
5	92	84	78	74	91	83	78	74	81	77	73	80	76	72	78	75	72	70		
6	88	79	73	69	87	78	73	69	77	72	68	75	71	68	74	70	67	66		
7	84	75	69	65	83	74	68	64	73	68	64	72	67	64	71	67	63	62		
8	80	71	65	61	79	70	65	61	69	64	60	68	64	60	67	63	60	59		
9	77	67	61	57	75	67	61	57	66	61	57	65	60	57	64	60	57	55		
10	73	64	58	54	72	63	58	54	63	58	54	62	57	54	61	57	54	53		

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	69654
5°	71368
10°	72226
15°	68808
20°	60671
25°	49066
30°	33194
35°	16633
40°	2696
45°	2642
50°	2703
55°	2743
60°	2797
65°	2870
70°	2939
75°	2955
80°	2894
85°	2382

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 75°
 Luminance: 2955 cd/sqm



TEST NUMBER: P740587

CATALOG NUMBER: LD4D05D010-EU4DR600210IC9035-4LBSQW1B

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	62.2	11.6
10°-20°	168.3	31.3
20°-30°	181.0	33.7
30°-40°	78.7	14.7
40°-50°	13.2	2.5
50°-60°	12.9	2.4
60°-70°	11.0	2.0
70°-80°	7.3	1.4
80°-90°	2.2	0.4
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	411.5	76.7
0°-40°	490.2	91.3
0°-60°	516.3	96.2
0°-90°	536.8	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	536.8	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	638	
5°	651	62
15°	608	168
25°	407	181
35°	125	79
45°	17	13
55°	14	13
65°	11	11
75°	7	7
85°	2	2
90°	0	



TEST NUMBER: P740587

CATALOG NUMBER: LD4D05D010-EU4DR600210IC9035-4LBSQW1B

CANDELA DISTRIBUTION (FULL):

	0°
0°	637.5
2.5°	655.4
5°	650.7
7.5°	652.2
10°	651.0
12.5°	637.6
15°	608.3
17.5°	568.9
20°	521.8
22.5°	471.3
25°	407.0
27.5°	325.6
30°	263.1
32.5°	202.8
35°	124.7
37.5°	53.3
40°	18.9
42.5°	17.4
45°	17.1
47.5°	16.5
50°	15.9
52.5°	15.1
55°	14.4
57.5°	13.6
60°	12.8
62.5°	12.0
65°	11.1
67.5°	10.2
70°	9.2
72.5°	8.1
75°	7.0
77.5°	5.8
80°	4.6
82.5°	3.2
85°	1.9
87.5°	0.7
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)