

Scaled data based on original data using  
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-  
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P740444

Luminaire Tested: LD4D05D010-EU4DR500210IC9040-4LBSQW1B

Issue Date: 1/30/2024

**Test Information**

Test Method: LM-79-2019  
Report Number: P740444  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-44)  
Test Lab: COOPER LIGHTING SOLUTIONS  
Issue Date: 1/30/2024  
Manufacturer: COOPER LIGHTING SOLUTIONS  
Product Line: PORTFOLIO  
Catalog Number: LD4D05D010-EU4DR500210IC9040-4LBSQW1B  
Description: 4 INCH SQAURE DEEP 45° CUTOFF SPECULAR BLACK TRIM, WITH 50° OPTIC  
Light Source: (1) HIGH LUMEN LED 90CRI / 4000K CCT  
Ballast/Driver: -

**Summary**

Lumens per Lamp: N/A  
Luminaire Lumens: 623.9 lumens  
Efficiency: N/A  
Efficacy: 83.2 lumens/watt  
Spacing Criteria (0/90/45): 0.8 / 0.8 / 0.73  
Luminous Opening: Circular (Dia: 0.35' x H: 0')  
CIE Type: Direct

Input Watts (W): 7.5  
Input Voltage (V): NR  
Input Current (Ain): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 24 FT




Downlight



TEST NUMBER: P740444  
CATALOG NUMBER: LD4D05D010-EU4DR500210IC9040-4LBSQW1B

### Luminous Intensity Polar Plot

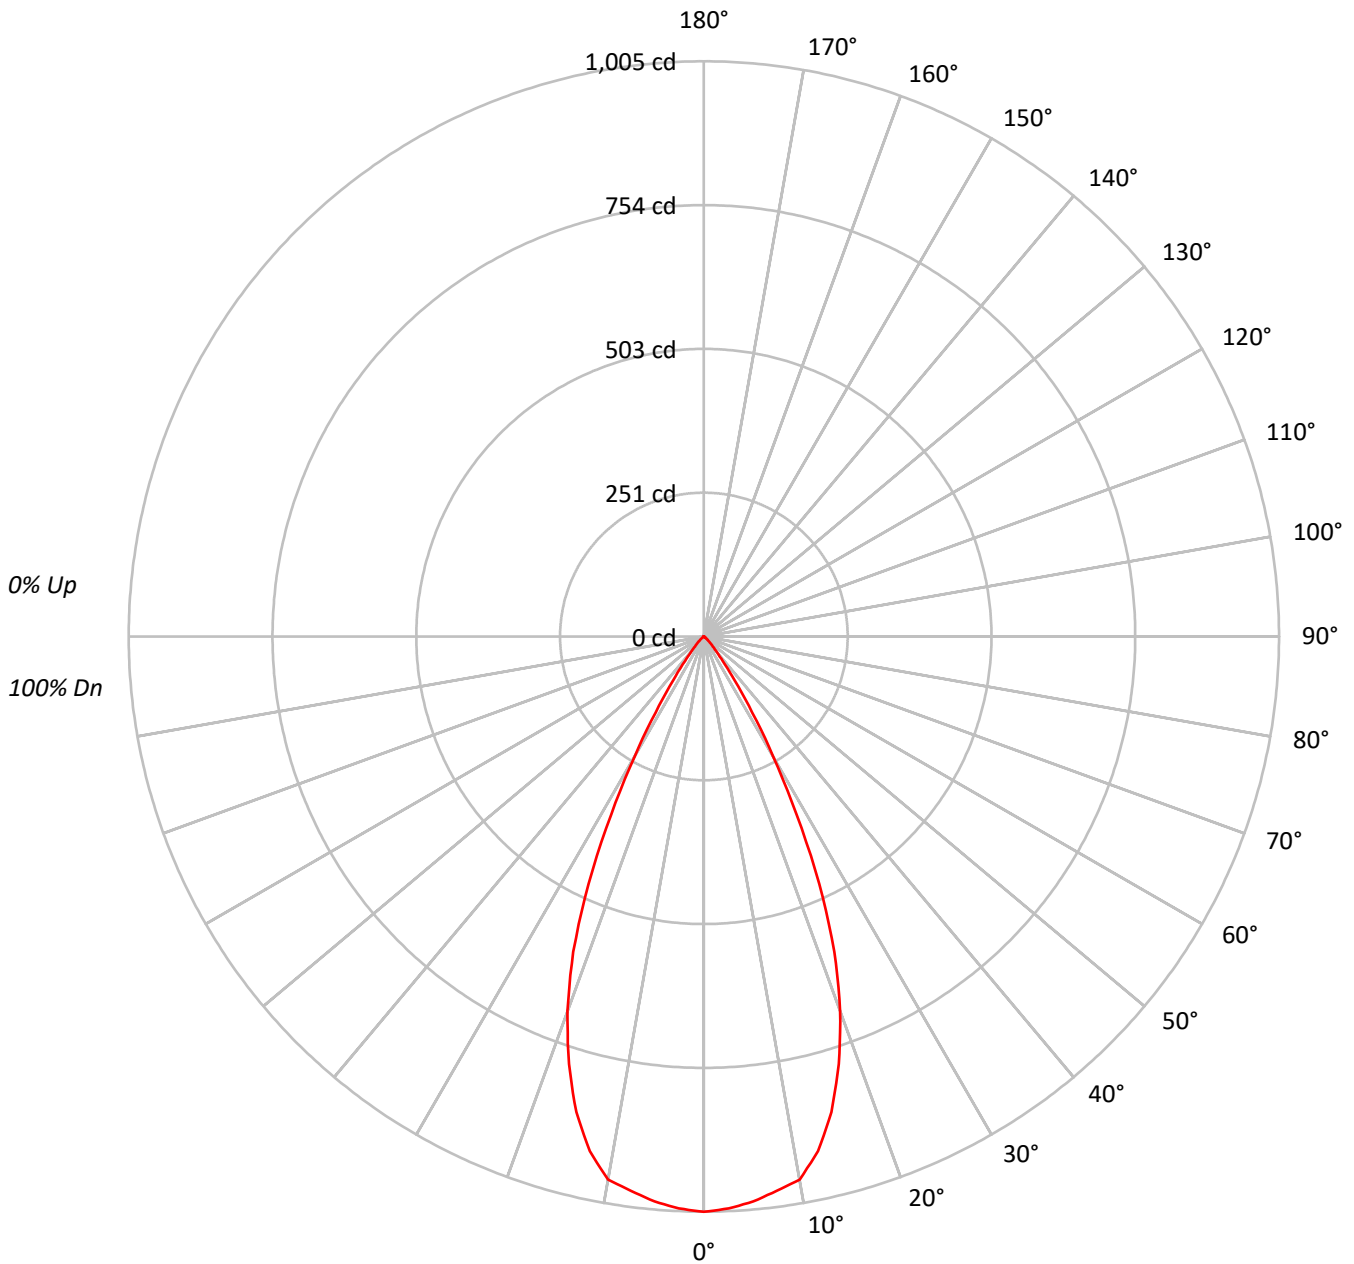



TEST NUMBER: P740444

CATALOG NUMBER: LD4D05D010-EU4DR500210IC9040-4LBSQW1B

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20				20				20				20				20	
RC	80				70				50				30				10	0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																		
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100
1	114	112	109	107	112	110	108	106	106	104	102	102	101	99	98	97	97	95
2	109	105	101	98	107	103	100	97	100	98	95	97	95	93	95	93	91	90
3	105	99	95	91	103	98	94	90	95	92	89	93	90	88	91	88	86	85
4	100	94	89	85	99	93	88	85	90	87	84	89	85	83	87	84	82	80
5	96	89	84	80	95	88	83	79	86	82	79	85	81	78	83	80	77	76
6	92	84	79	75	91	83	79	75	82	78	74	81	77	74	79	76	74	72
7	88	80	75	71	87	79	74	71	78	74	71	77	73	70	76	73	70	69
8	85	76	71	67	84	76	71	67	75	70	67	74	70	67	73	69	66	65
9	81	73	68	64	80	72	67	64	71	67	64	71	67	64	70	66	63	62
10	78	70	64	61	77	69	64	61	68	64	61	68	64	61	67	63	60	59

**AVERAGE LUMINANCE (cd/sqm):**

	0°
0°	109829
5°	108680
10°	106897
15°	97336
20°	80996
25°	57493
30°	30431
35°	12405
40°	4607
45°	2101
50°	867
55°	438
60°	219
65°	52
70°	0
75°	0
80°	0
85°	0

**MAXIMUM LUMINANCE 45°-90°:**

Horizontal Angle: 0°  
 Vertical Angle: 45°  
 Luminance: 2101 cd/sqm



TEST NUMBER: P740444

CATALOG NUMBER: LD4D05D010-EU4DR500210IC9040-4LBSQW1B

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	93.7	15.0
10°-20°	236.7	37.9
20°-30°	212.6	34.1
30°-40°	66.6	10.7
40°-50°	11.6	1.9
50°-60°	2.3	0.4
60°-70°	0.3	0.1
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	543.0	87.0
0°-40°	609.6	97.7
0°-60°	623.5	99.9
0°-90°	623.9	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	623.9	100.0

**CANDELA DISTRIBUTION:**

	0°	Flux
0°	1005	
5°	991	94
15°	860	237
25°	477	213
35°	93	67
45°	14	12
55°	2	2
65°	0	0
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P740444

CATALOG NUMBER: LD4D05D010-EU4DR500210IC9040-4LBSQW1B

**CANDELA DISTRIBUTION (FULL):**

	0°
0°	1005.2
2.5°	1000.3
5°	990.9
7.5°	976.7
10°	963.5
12.5°	921.1
15°	860.5
17.5°	783.6
20°	696.6
22.5°	596.0
25°	476.9
27.5°	350.6
30°	241.2
32.5°	157.0
35°	93.0
37.5°	53.4
40°	32.3
42.5°	21.0
45°	13.6
47.5°	8.3
50°	5.1
52.5°	3.5
55°	2.3
57.5°	1.6
60°	1.0
62.5°	0.6
65°	0.2
67.5°	0.1
70°	0.0
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report





Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)