

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P749633

Luminaire Tested: LD4D50D010-EU4DR6540509024-4LBCSSQMW

Issue Date: 2/2/2024

Test Information

Test Method: LM-79-2019
Report Number: P749633
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-147)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/2/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LD4D50D010-EU4DR6540509024-4LBCSSQMW
Description: 4 INCH SQAURE SHALLOW CAST MATTE WHITE TRIM, WITH 65° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 2400K CCT
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 3717.2 lumens
Efficiency: N/A
Efficacy: 79.1 lumens/watt
Spacing Criteria (0/90/45): 0.95 / 0.95 / 0.96
Luminous Opening: Circular (Dia: 0.48' x H: 0')
CIE Type: Direct

Input Watts (W): 47
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT



TEST NUMBER: P749633
CATALOG NUMBER: LD4D50D010-EU4DR6540509024-4LBCSSQMW

Luminous Intensity Polar Plot

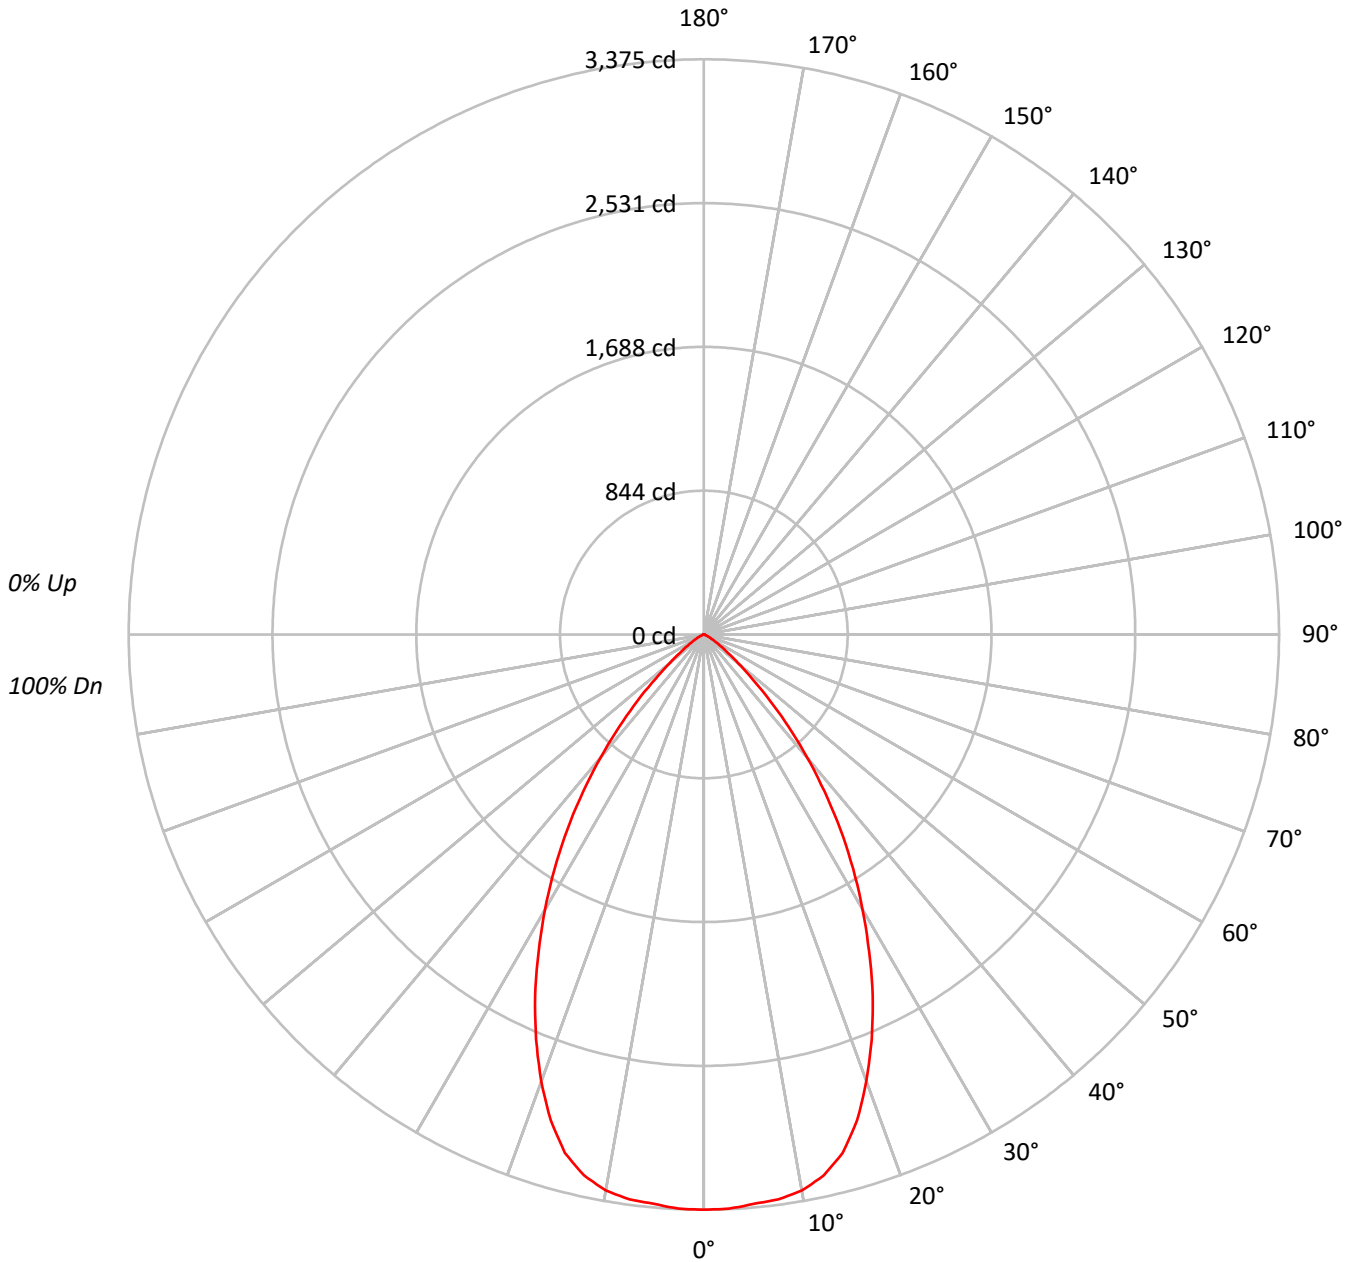



TEST NUMBER: P749633

CATALOG NUMBER: LD4D50D010-EU4DR6540509024-4LBCSSQMW

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20	
RC	80				70				50				30				10	0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																		
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100
1	113	110	107	105	111	108	105	103	104	102	100	100	99	97	97	95	94	93
2	107	102	97	94	105	100	96	92	97	93	90	94	91	88	91	89	87	85
3	101	94	88	84	99	92	87	83	90	86	82	87	84	81	85	82	80	78
4	95	87	81	76	93	86	80	76	84	79	75	82	77	74	80	76	73	72
5	90	81	74	70	88	80	74	69	78	73	69	76	72	68	75	71	68	66
6	85	75	69	64	83	74	68	64	73	67	63	71	67	63	70	66	62	61
7	80	70	64	59	79	69	63	59	68	63	59	67	62	58	66	61	58	56
8	76	66	59	55	75	65	59	55	64	58	54	63	58	54	62	57	54	52
9	72	61	55	51	71	61	55	51	60	54	51	59	54	50	58	54	50	49
10	68	58	52	47	67	57	51	47	57	51	47	56	51	47	55	50	47	46

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	197119
5°	196623
10°	196453
15°	190402
20°	173336
25°	151051
30°	125632
35°	99546
40°	71849
45°	45386
50°	23660
55°	12575
60°	6600
65°	3635
70°	1520
75°	1670
80°	1177
85°	1005

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 45386 cd/sqm



TEST NUMBER: P749633

CATALOG NUMBER: LD4D50D010-EU4DR6540509024-4LBCSSQMW

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	319.2	8.6
10°-20°	874.0	23.5
20°-30°	1068.4	28.7
30°-40°	866.9	23.3
40°-50°	432.0	11.6
50°-60°	120.5	3.2
60°-70°	27.4	0.7
70°-80°	7.1	0.2
80°-90°	1.8	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	2261.6	60.8
0°-40°	3128.5	84.2
0°-60°	3680.9	99.0
0°-90°	3717.2	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	3717.2	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	3375	
5°	3354	319
15°	3149	874
25°	2344	1068
35°	1396	867
45°	550	432
55°	124	120
65°	26	27
75°	7	7
85°	2	2
90°	0	



TEST NUMBER: P749633

CATALOG NUMBER: LD4D50D010-EU4DR6540509024-4LBCSSQMW

CANDELA DISTRIBUTION (FULL):

	0°
0°	3375.1
2.5°	3372.7
5°	3353.8
7.5°	3342.9
10°	3312.6
12.5°	3251.1
15°	3149.0
17.5°	2989.3
20°	2788.9
22.5°	2572.6
25°	2344.0
27.5°	2099.5
30°	1862.9
32.5°	1629.3
35°	1396.2
37.5°	1163.6
40°	942.4
42.5°	735.0
45°	549.5
47.5°	382.9
50°	260.4
52.5°	179.5
55°	123.5
57.5°	83.3
60°	56.5
62.5°	39.2
65°	26.3
67.5°	13.4
70°	8.9
72.5°	8.4
75°	7.4
77.5°	5.0
80°	3.5
82.5°	2.5
85°	1.5
87.5°	1.0
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)