

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P749344

Luminaire Tested: LD4D50D010-EU4DR4540509027-4LBSQW1MW

Issue Date: 1/30/2024

Test Information

Test Method: LM-79-2019
Report Number: P749344
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-36)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 1/30/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LD4D50D010-EU4DR4540509027-4LBSQW1MW
Description: 4 INCH SQAURE DEEP 45° CUTOFF MATTE WHITE TRIM, WITH 45° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 2700K CCT
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 4423.7 lumens
Efficiency: N/A
Efficacy: 94.1 lumens/watt
Spacing Criteria (0/90/45): 0.75 / 0.75 / 0.69
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct

Input Watts (W): 47
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT



TEST NUMBER: P749344
CATALOG NUMBER: LD4D50D010-EU4DR4540509027-4LBSQW1MW

Luminous Intensity Polar Plot

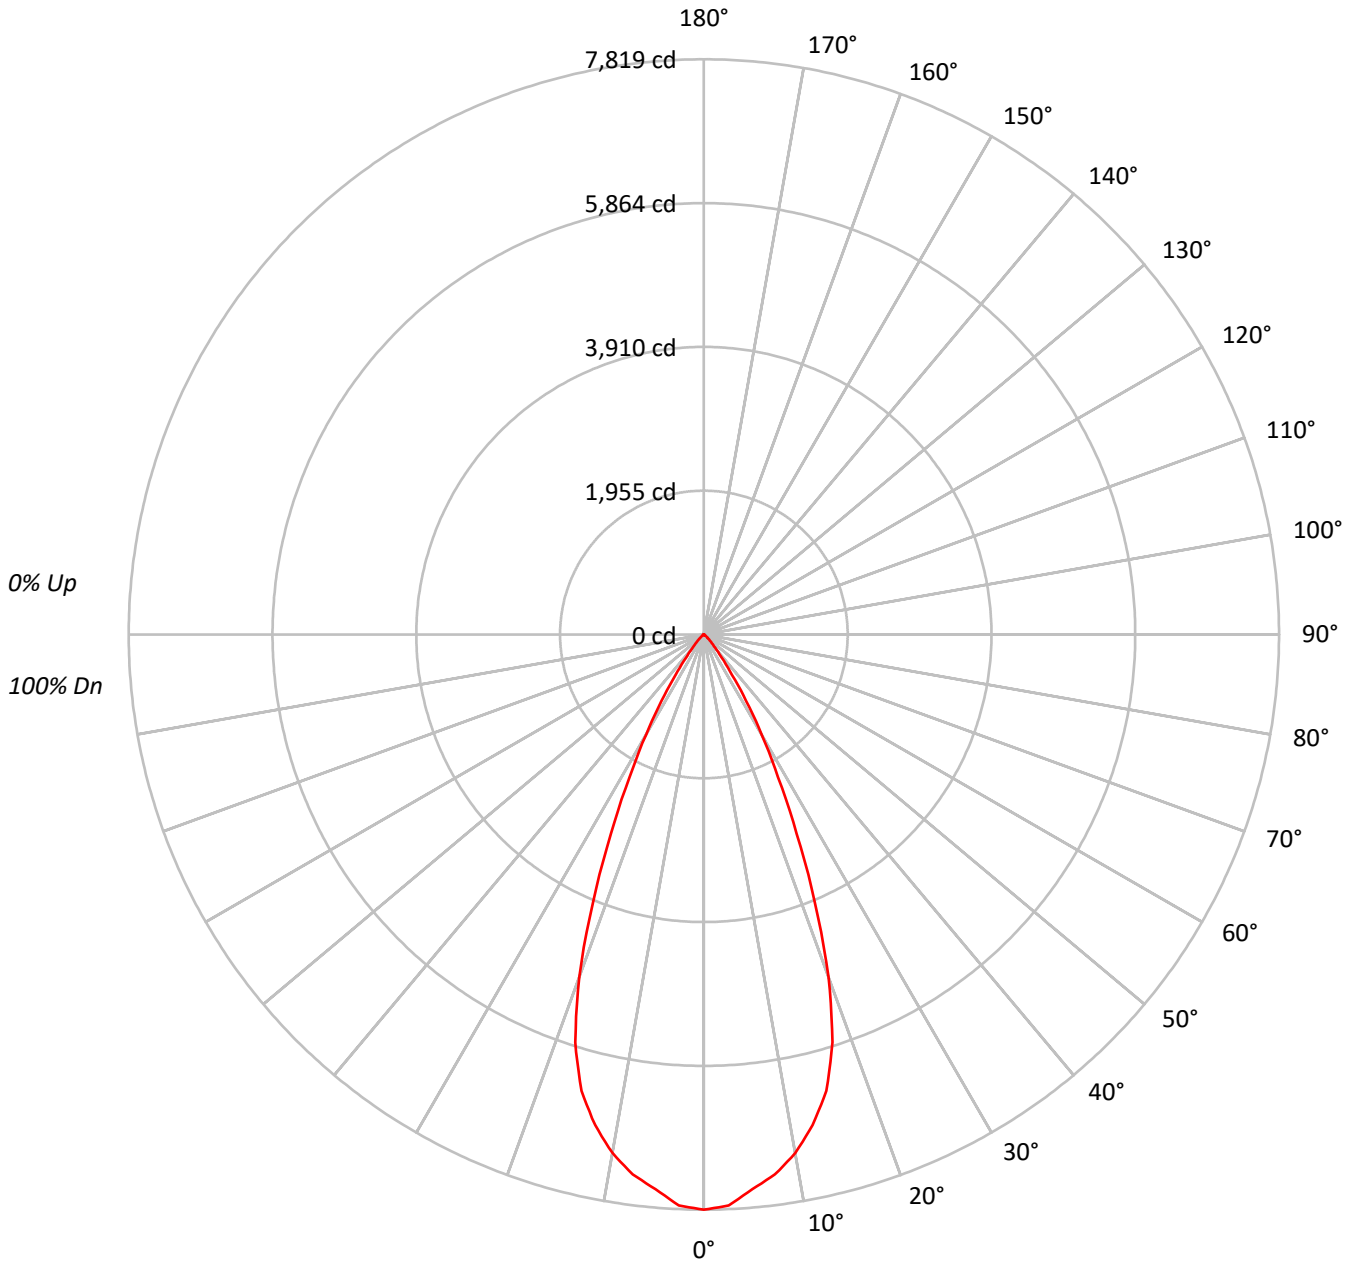



TEST NUMBER: P749344

CATALOG NUMBER: LD4D50D010-EU4DR4540509027-4LBSQW1MW

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20			
RC	80				70				50				30				10		0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10
RCR																				
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100		
1	114	112	110	108	112	110	108	106	106	104	103	102	101	100	98	98	97	95		
2	109	105	102	99	107	103	100	98	100	98	95	97	95	93	95	93	91	90		
3	105	99	95	91	103	98	94	91	95	92	89	93	90	88	91	89	87	85		
4	100	94	89	85	99	93	88	85	91	87	84	89	86	83	87	84	82	81		
5	96	89	84	80	95	88	83	80	86	82	79	85	81	79	83	80	78	77		
6	92	85	80	76	91	84	79	76	83	78	75	81	77	75	80	77	74	73		
7	89	81	75	72	87	80	75	72	79	74	71	78	74	71	77	73	71	69		
8	85	77	72	68	84	76	71	68	75	71	68	74	70	67	73	70	67	66		
9	82	73	68	65	81	73	68	65	72	68	65	71	67	64	71	67	64	63		
10	79	70	65	62	78	70	65	62	69	65	62	68	64	61	68	64	61	60		

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	854321
5°	830000
10°	794087
15°	726753
20°	576574
25°	359956
30°	198405
35°	89086
40°	35087
45°	16533
50°	7836
55°	4096
60°	2010
65°	465
70°	192
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 16533 cd/sqm



TEST NUMBER: P749344

CATALOG NUMBER: LD4D50D010-EU4DR4540509027-4LBSQW1MW

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	711.0	16.1
10°-20°	1750.0	39.6
20°-30°	1385.8	31.3
30°-40°	461.5	10.4
40°-50°	91.6	2.1
50°-60°	20.8	0.5
60°-70°	3.0	0.1
70°-80°	0.1	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	3846.8	87.0
0°-40°	4308.3	97.4
0°-60°	4420.7	99.9
0°-90°	4423.7	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	4423.7	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	7819	
5°	7568	711
15°	6425	1750
25°	2986	1386
35°	668	461
45°	107	92
55°	22	21
65°	2	3
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P749344

CATALOG NUMBER: LD4D50D010-EU4DR4540509027-4LBSQW1MW

CANDELA DISTRIBUTION (FULL):

	0°
0°	7819.1
2.5°	7768.1
5°	7567.6
7.5°	7402.2
10°	7157.4
12.5°	6831.4
15°	6424.9
17.5°	5813.6
20°	4958.8
22.5°	3940.3
25°	2985.8
27.5°	2186.3
30°	1572.6
32.5°	1069.5
35°	667.9
37.5°	396.1
40°	246.0
42.5°	161.7
45°	107.0
47.5°	68.9
50°	46.1
52.5°	30.8
55°	21.5
57.5°	14.1
60°	9.2
62.5°	4.9
65°	1.8
67.5°	0.6
70°	0.6
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)