

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P749672

Luminaire Tested: LD4D50D010-EU4DR6540509035-4LBCSSQMW

Issue Date: 2/2/2024

Test Information

Test Method: LM-79-2019
Report Number: P749672
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-147)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/2/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LD4D50D010-EU4DR6540509035-4LBCSSQMW
Description: 4 INCH SQAURE SHALLOW CAST MATTE WHITE TRIM, WITH 65° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 3500K CCT
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 4383.7 lumens
Efficiency: N/A
Efficacy: 93.3 lumens/watt
Spacing Criteria (0/90/45): 0.95 / 0.95 / 0.96
Luminous Opening: Circular (Dia: 0.48' x H: 0')
CIE Type: Direct

Input Watts (W): 47
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT



TEST NUMBER: P749672
CATALOG NUMBER: LD4D50D010-EU4DR6540509035-4LBCSSQMW

Luminous Intensity Polar Plot

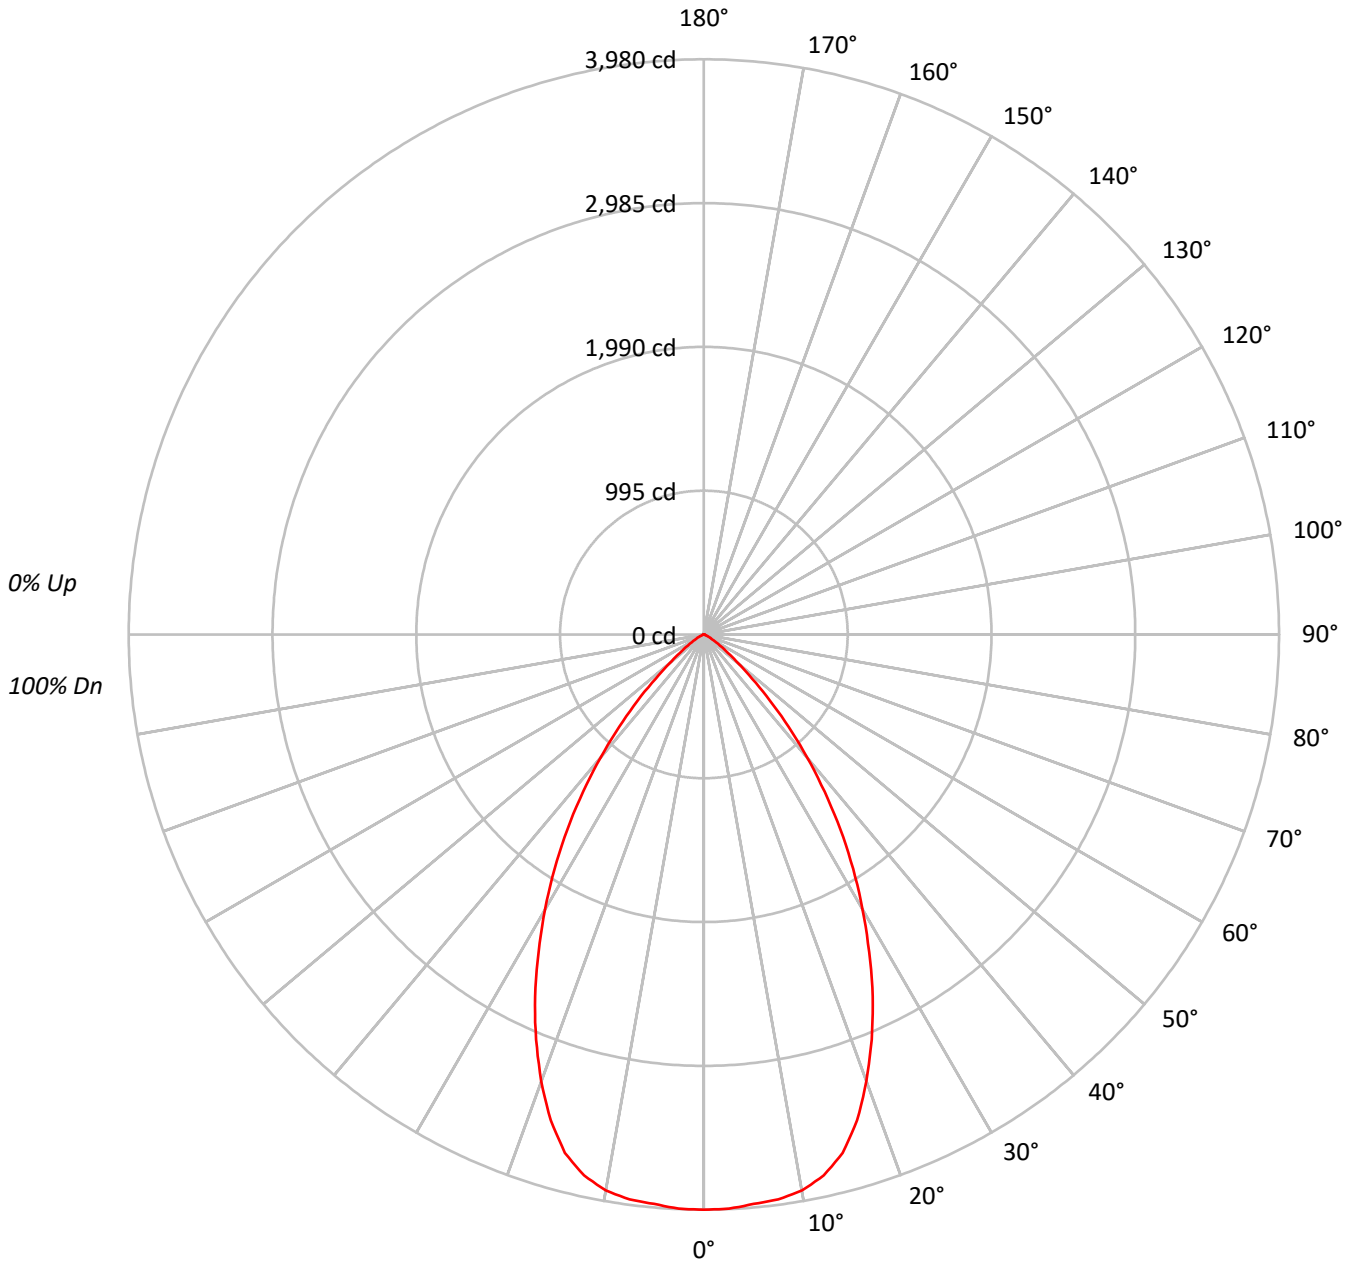



TEST NUMBER: P749672

CATALOG NUMBER: LD4D50D010-EU4DR6540509035-4LBCSSQMWW

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10		0		
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			
1	113	110	107	105	111	108	105	103	104	102	100	100	99	97	97	95	94	93			
2	107	102	97	94	105	100	96	92	97	93	90	94	91	88	91	89	87	85			
3	101	94	88	84	99	92	87	83	90	86	82	87	84	81	85	82	80	78			
4	95	87	81	76	93	86	80	76	84	79	75	82	77	74	80	76	73	72			
5	90	81	74	70	88	80	74	69	78	73	69	76	72	68	75	71	68	66			
6	85	75	69	64	83	74	68	64	73	67	63	71	67	63	70	66	62	61			
7	80	70	64	59	79	69	63	59	68	63	59	67	62	58	66	61	58	56			
8	76	66	59	55	75	65	59	55	64	58	54	63	58	54	62	57	54	52			
9	72	61	55	51	71	61	55	51	60	54	51	59	54	50	58	54	50	49			
10	68	58	52	47	67	57	51	47	57	51	47	56	51	47	55	50	47	46			

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	232465
5°	231881
10°	231680
15°	224540
20°	204418
25°	178136
30°	148157
35°	117392
40°	84726
45°	53530
50°	27903
55°	14826
60°	7791
65°	4284
70°	1793
75°	1986
80°	1379
85°	1206

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 53530 cd/sqm



TEST NUMBER: P749672

CATALOG NUMBER: LD4D50D010-EU4DR6540509035-4LBCSSQMW

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	376.4	8.6
10°-20°	1030.8	23.5
20°-30°	1259.9	28.7
30°-40°	1022.3	23.3
40°-50°	509.4	11.6
50°-60°	142.1	3.2
60°-70°	32.3	0.7
70°-80°	8.4	0.2
80°-90°	2.2	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	2667.1	60.8
0°-40°	3689.4	84.2
0°-60°	4340.9	99.0
0°-90°	4383.7	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	4383.7	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	3980	
5°	3955	376
15°	3714	1031
25°	2764	1260
35°	1646	1022
45°	648	509
55°	146	142
65°	31	32
75°	9	8
85°	2	2
90°	0	



TEST NUMBER: P749672

CATALOG NUMBER: LD4D50D010-EU4DR6540509035-4LBCSSQMW

CANDELA DISTRIBUTION (FULL):

	0°
0°	3980.3
2.5°	3977.4
5°	3955.2
7.5°	3942.3
10°	3906.6
12.5°	3834.1
15°	3713.6
17.5°	3525.3
20°	3289.0
22.5°	3033.9
25°	2764.3
27.5°	2475.9
30°	2196.9
32.5°	1921.4
35°	1646.5
37.5°	1372.2
40°	1111.3
42.5°	866.8
45°	648.1
47.5°	451.6
50°	307.1
52.5°	211.7
55°	145.6
57.5°	98.3
60°	66.7
62.5°	46.2
65°	31.0
67.5°	15.8
70°	10.5
72.5°	9.9
75°	8.8
77.5°	5.8
80°	4.1
82.5°	2.9
85°	1.8
87.5°	1.2
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)