

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P749139

Luminaire Tested: LD4D50D010-EU4DR3040509040-4LBCSSQMW

Issue Date: 1/30/2024

Test Information

Test Method: LM-79-2019
Report Number: P749139
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-16)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 1/30/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LD4D50D010-EU4DR3040509040-4LBCSSQMW
Description: 4 INCH SQAURE SHALLOW CAST MATTE WHITE TRIM, WITH 30° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 4000K CCT
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 4565.7 lumens
Efficiency: N/A
Efficacy: 97.1 lumens/watt
Spacing Criteria (0/90/45): 0.52 / 0.52 / 0.49
Luminous Opening: Rectangular (W 0.38' x L: 0.38' x H: 0')
CIE Type: Direct

Input Watts (W): 47
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT



TEST NUMBER: P749139
CATALOG NUMBER: LD4D50D010-EU4DR3040509040-4LBCSSQMW

Luminous Intensity Polar Plot

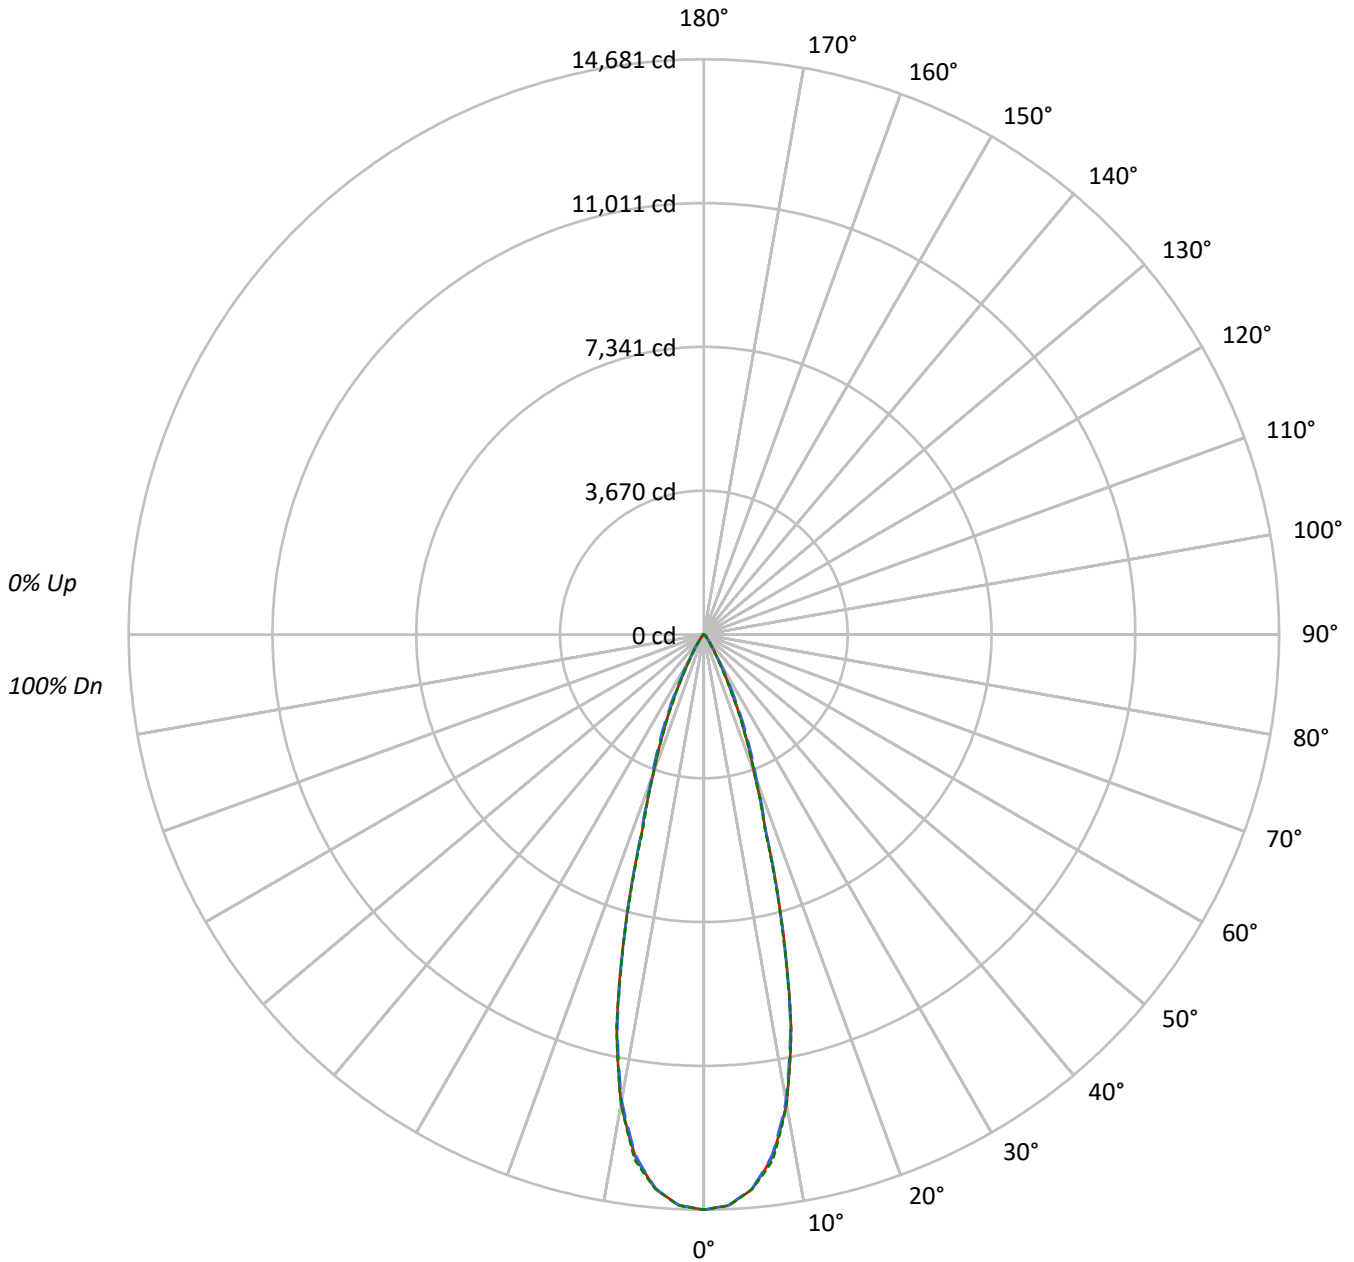



TEST NUMBER: P749139

CATALOG NUMBER: LD4D50D010-EU4DR3040509040-4LBCSSQMW

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0													
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100						100													
1	115	113	111	109	112	110	109	107	106	105	104	103	102	101	99	99	98	96						96													
2	111	107	104	101	109	105	102	100	102	100	98	99	97	96	97	95	94	92						92													
3	107	102	98	95	105	101	97	94	98	95	93	96	93	91	94	92	90	89						89													
4	103	98	93	90	102	96	93	90	94	91	89	93	90	88	91	89	87	85						85													
5	100	94	89	86	98	93	89	86	91	88	85	90	86	84	88	86	83	82						82													
6	97	90	85	82	95	89	85	82	88	84	81	87	83	81	85	83	80	79						79													
7	94	87	82	79	92	86	82	79	85	81	78	84	81	78	83	80	78	77						77													
8	91	84	79	76	90	83	79	76	82	78	76	81	78	75	80	77	75	74						74													
9	88	81	76	73	87	80	76	73	80	76	73	79	75	73	78	75	73	72						72													
10	85	78	74	71	85	78	74	71	77	73	71	76	73	71	76	73	70	69						69													

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1123726	1123726	1123726
5°	1091468	1090192	1091521
10°	945375	938714	945150
15°	616808	613496	610413
20°	306714	318223	306298
25°	154504	174225	151337
30°	61860	67402	53897
35°	28696	27481	23034
40°	12390	13759	11671
45°	8736	10847	8811
50°	3001	7895	3179
55°	1735	3270	1828
60°	1209	1439	1209
65°	779	779	779
70°	492	313	492
75°	0	207	0
80°	0	0	0
85°	0	0	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 22.5°

Vertical Angle: 45°

Luminance: 10847 cd/sqm



TEST NUMBER: P749139

CATALOG NUMBER: LD4D50D010-EU4DR3040509040-4LBCSSQMW

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	1291.0	28.3
10°-20°	2079.1	45.5
20°-30°	898.4	19.7
30°-40°	204.8	4.5
40°-50°	70.3	1.5
50°-60°	17.2	0.4
60°-70°	4.5	0.1
70°-80°	0.5	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	4268.5	93.5
0°-40°	4473.3	98.0
0°-60°	4560.8	99.9
0°-90°	4565.7	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	4565.7	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	14681	14681	14681	14681	14681	
5°	14205	14192	14189	14218	14206	1292
15°	7784	7690	7742	7717	7703	2084
25°	1829	1898	2063	1850	1792	876
35°	307	314	294	292	246	208
45°	81	100	100	100	81	57
55°	13	14	24	14	14	13
65°	4	4	4	4	4	4
75°	0	0	1	0	0	1
85°	0	0	0	0	0	0
90°	0	0	0	0	0	0



TEST NUMBER: P749139

CATALOG NUMBER: LD4D50D010-EU4DR3040509040-4LBCSSQMW

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	14680.9	14680.9	14680.9	14680.9	14680.9
2.5°	14583.6	14573.5	14579.3	14586.5	14589.4
5°	14205.2	14191.5	14188.6	14218.2	14205.9
7.5°	13441.9	13422.4	13392.9	13459.9	13522.6
10°	12163.2	12141.6	12077.5	12109.2	12160.3
12.5°	10275.5	10205.6	10204.1	10305.1	10291.4
15°	7783.7	7690.0	7741.9	7716.7	7703.0
17.5°	5234.3	5198.3	5267.5	5246.6	5156.5
20°	3765.4	3774.7	3906.7	3840.3	3760.3
22.5°	2747.6	2781.5	2937.9	2767.1	2704.4
25°	1829.4	1898.5	2062.9	1850.3	1791.9
27.5°	1125.1	1156.9	1323.4	1110.7	1079.0
30°	699.9	684.0	762.6	654.5	609.8
32.5°	459.1	439.0	464.2	416.6	380.6
35°	307.1	313.5	294.1	291.9	246.5
37.5°	191.7	220.6	194.6	207.6	158.6
40°	124.0	160.0	137.7	152.1	116.8
42.5°	101.6	123.3	113.2	120.4	103.8
45°	80.7	100.2	100.2	100.2	81.4
47.5°	44.7	67.0	85.8	68.5	47.6
50°	25.2	33.9	66.3	35.3	26.7
52.5°	17.3	19.5	45.4	20.2	18.0
55°	13.0	13.7	24.5	14.4	13.7
57.5°	10.1	10.8	13.0	10.8	10.1
60°	7.9	7.9	9.4	8.6	7.9
62.5°	5.8	5.8	6.5	5.8	5.8
65°	4.3	4.3	4.3	4.3	4.3
67.5°	2.2	2.9	2.9	2.9	2.9
70°	2.2	1.4	1.4	1.4	2.2
72.5°	1.4	0.7	0.7	0.7	0.7
75°	0.0	0.0	0.7	0.0	0.0
77.5°	0.0	0.0	0.0	0.0	0.0
80°	0.0	0.0	0.0	0.0	0.0
82.5°	0.0	0.0	0.0	0.0	0.0
85°	0.0	0.0	0.0	0.0	0.0
87.5°	0.0	0.0	0.0	0.0	0.0
90°	0.0	0.0	0.0	0.0	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report





— 0°-180° - - 45°-225° - - - - 90°-270°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)