

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P751268

Luminaire Tested: LD4D60D010-EU4DR6555659050-4LBSQW1MW

Issue Date: 2/5/2024

Test Information

Test Method: LM-79-2019
Report Number: P751268
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-59)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/5/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LD4D60D010-EU4DR6555659050-4LBSQW1MW
Description: 4 INCH SQAURE DEEP 45° CUTOFF MATTE WHITE TRIM, WITH 65° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 5000K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 5052.8 lumens
Efficiency: N/A
Efficacy: 78.5 lumens/watt
Spacing Criteria (0/90/45): 0.98 / 0.98 / 0.92
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct


Input Watts (W): 64.4
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT



TEST NUMBER: P751268

CATALOG NUMBER: LD4D60D010-EU4DR6555659050-4LBSQW1MW

Luminous Intensity Polar Plot

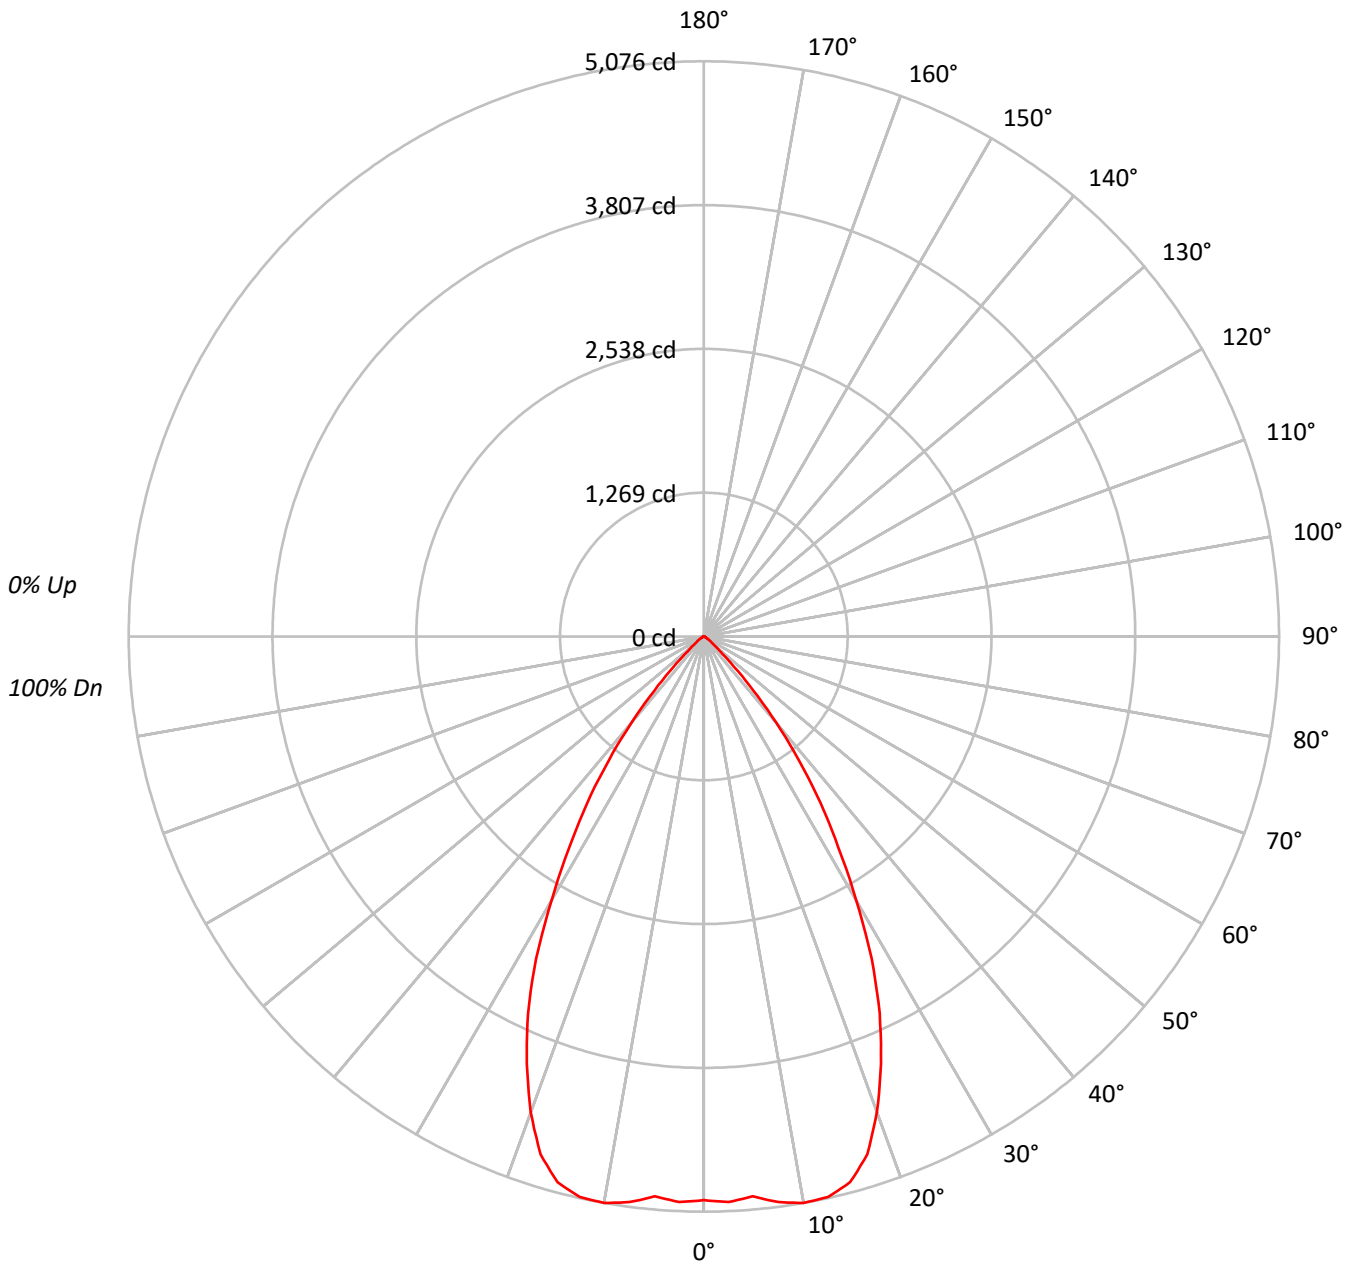



TEST NUMBER: P751268

CATALOG NUMBER: LD4D60D010-EU4DR6555659050-4LBSQW1MW

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20			
RC	80				70				50				30				10		0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10
RCR																				
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100		
1	113	111	108	106	111	108	106	104	104	103	101	101	99	98	97	96	95	93		
2	108	103	99	95	106	101	97	94	98	95	92	95	92	90	92	90	88	87		
3	102	96	91	87	100	94	90	86	92	88	85	89	86	83	87	84	82	80		
4	97	89	84	79	95	88	83	79	86	82	78	84	80	77	82	79	76	75		
5	92	83	78	73	90	83	77	73	81	76	72	79	75	72	77	74	71	69		
6	87	78	72	68	86	77	72	68	76	71	67	74	70	67	73	69	66	65		
7	83	73	67	63	81	73	67	63	71	66	62	70	66	62	69	65	62	60		
8	79	69	63	59	77	68	63	59	67	62	58	66	62	58	65	61	58	57		
9	75	65	59	55	74	65	59	55	64	58	55	63	58	55	62	58	54	53		
10	71	61	56	52	70	61	55	52	60	55	51	59	55	51	59	54	51	50		

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	543561
5°	544014
10°	563163
15°	564093
20°	519344
25°	442513
30°	338749
35°	239329
40°	141275
45°	57357
50°	20789
55°	11582
60°	6643
65°	3645
70°	3833
75°	2997
80°	3083
85°	2633

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 57357 cd/sqm



TEST NUMBER: P751268

CATALOG NUMBER: LD4D60D010-EU4DR6555659050-4LBSQW1MW

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	479.0	9.5
10°-20°	1381.8	27.3
20°-30°	1657.9	32.8
30°-40°	1114.2	22.1
40°-50°	333.5	6.6
50°-60°	58.8	1.2
60°-70°	16.7	0.3
70°-80°	8.2	0.2
80°-90°	2.6	0.1
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	3518.8	69.6
0°-40°	4632.9	91.7
0°-60°	5025.3	99.5
0°-90°	5052.8	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	5052.8	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	4975	
5°	4960	479
15°	4987	1382
25°	3671	1658
35°	1794	1114
45°	371	334
55°	61	59
65°	14	17
75°	7	8
85°	2	3
90°	0	



TEST NUMBER: P751268

CATALOG NUMBER: LD4D60D010-EU4DR6555659050-4LBSQW1MW

CANDELA DISTRIBUTION (FULL):

	0°
0°	4974.9
2.5°	4996.1
5°	4960.1
7.5°	5035.0
10°	5076.0
12.5°	5066.1
15°	4986.9
17.5°	4793.2
20°	4466.6
22.5°	4082.0
25°	3670.6
27.5°	3206.1
30°	2685.0
32.5°	2212.8
35°	1794.3
37.5°	1380.7
40°	990.5
42.5°	646.9
45°	371.2
47.5°	196.5
50°	122.3
52.5°	84.8
55°	60.8
57.5°	43.8
60°	30.4
62.5°	19.8
65°	14.1
67.5°	12.7
70°	12.0
72.5°	9.2
75°	7.1
77.5°	6.4
80°	4.9
82.5°	3.5
85°	2.1
87.5°	1.4
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)