

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P751440

Luminaire Tested: LD4D65D010-EU4DR3055659027-4LBCSSQMW

Issue Date: 1/30/2024

Test Information

Test Method: LM-79-2019
Report Number: P751440
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-16)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 1/30/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LD4D65D010-EU4DR3055659027-4LBCSSQMW
Description: 4 INCH SQAURE SHALLOW CAST MATTE WHITE TRIM, WITH 30° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 2700K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 5760.9 lumens
Efficiency: N/A
Efficacy: 79.1 lumens/watt
Spacing Criteria (0/90/45): 0.52 / 0.52 / 0.49
Luminous Opening: Rectangular (W 0.38' x L: 0.38' x H: 0')
CIE Type: Direct


Input Watts (W): 72.8
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT



TEST NUMBER: P751440

CATALOG NUMBER: LD4D65D010-EU4DR3055659027-4LBCSSQMW

Luminous Intensity Polar Plot

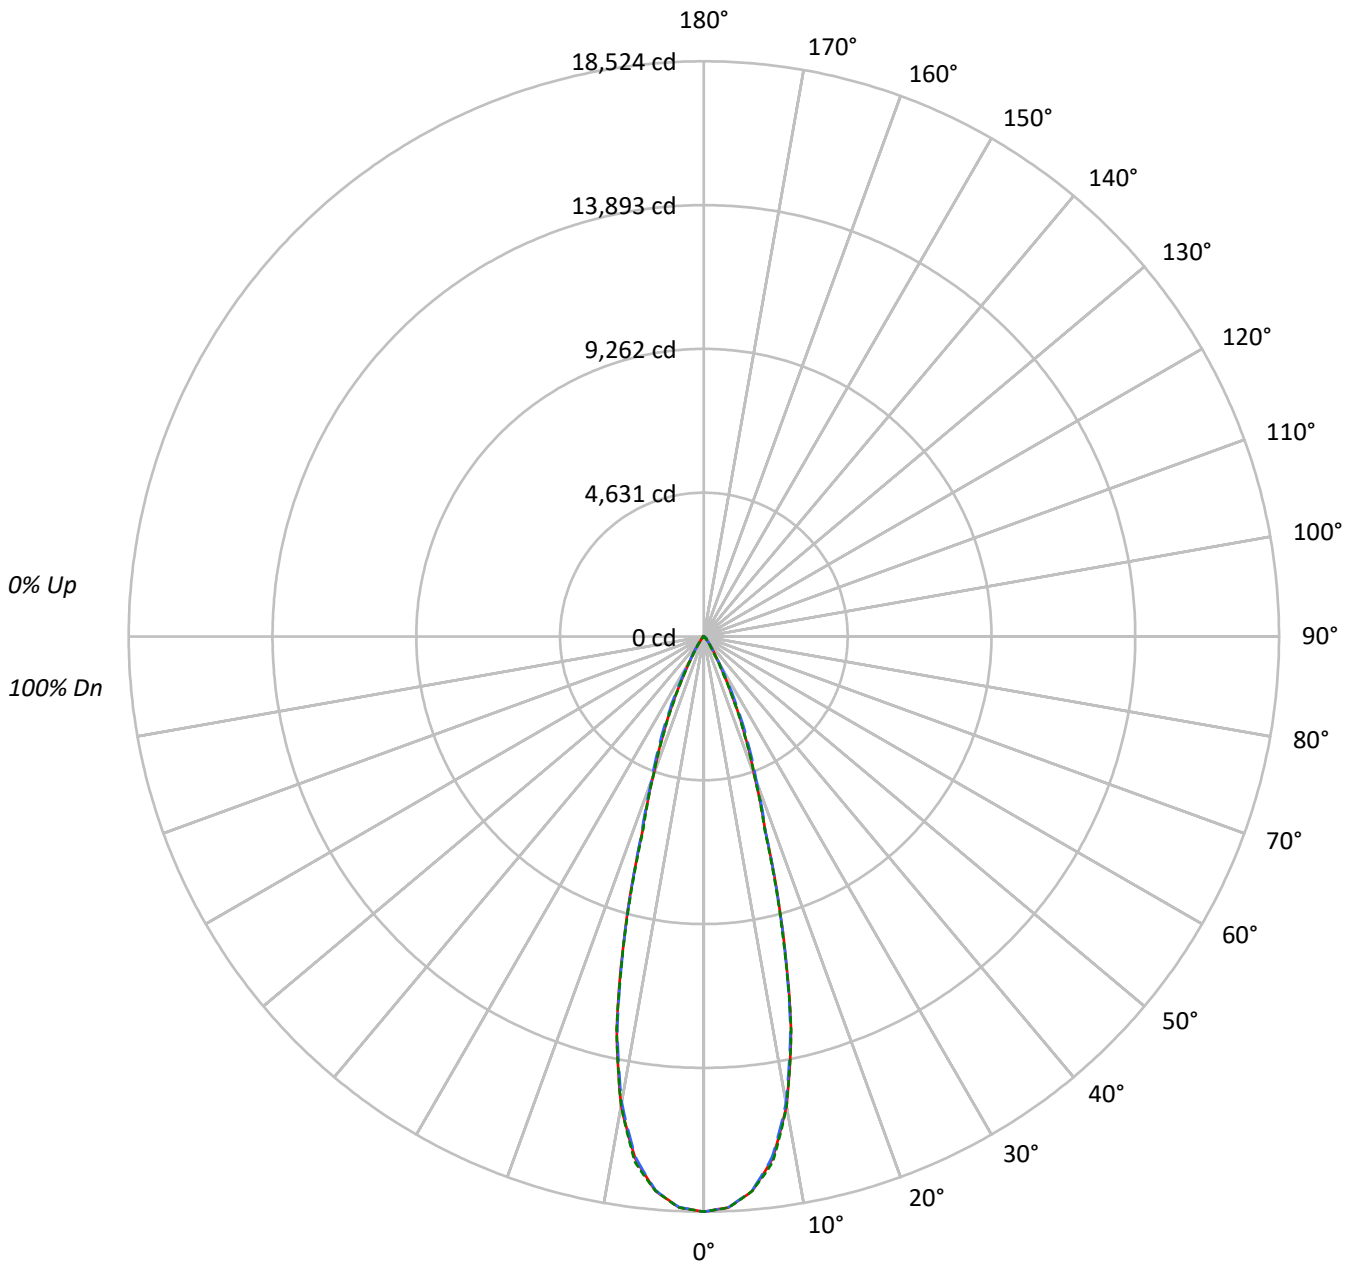



TEST NUMBER: P751440

CATALOG NUMBER: LD4D65D010-EU4DR3055659027-4LBCSSQMW

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0																
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100																			
1	115	113	111	109	112	110	109	107	106	105	104	103	102	101	99	99	98	96																			
2	111	107	104	101	109	105	102	100	102	100	98	99	97	96	97	95	94	92																			
3	107	102	98	95	105	101	97	94	98	95	93	96	93	91	94	92	90	89																			
4	103	98	93	90	102	96	93	90	94	91	89	93	90	88	91	89	87	85																			
5	100	94	89	86	98	93	89	86	91	88	85	90	86	84	88	86	83	82																			
6	97	90	85	82	95	89	85	82	88	84	81	87	83	81	85	83	80	79																			
7	94	87	82	79	92	86	82	79	85	81	78	84	81	78	83	80	78	77																			
8	91	84	79	76	90	83	79	76	82	78	76	81	78	75	80	77	75	74																			
9	88	81	76	73	87	80	76	73	80	76	73	79	75	73	78	75	73	72																			
10	85	78	74	71	85	78	74	71	77	73	71	76	73	71	76	73	70	69																			

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1417898	1417898	1417898
5°	1377197	1375591	1377266
10°	1192857	1184447	1192577
15°	778283	774099	770208
20°	387005	401520	386483
25°	194942	219831	190947
30°	78053	85044	68003
35°	36200	34676	29061
40°	15628	17356	14718
45°	11031	13683	11128
50°	3787	9967	4013
55°	2189	4124	2309
60°	1531	1806	1531
65°	996	996	996
70°	604	403	604
75°	0	266	0
80°	0	0	0
85°	0	0	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 22.5°
 Vertical Angle: 45°
 Luminance: 13683 cd/sqm



TEST NUMBER: P751440

CATALOG NUMBER: LD4D65D010-EU4DR3055659027-4LBCSSQMW

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	1628.9	28.3
10°-20°	2623.4	45.5
20°-30°	1133.6	19.7
30°-40°	258.4	4.5
40°-50°	88.7	1.5
50°-60°	21.7	0.4
60°-70°	5.6	0.1
70°-80°	0.6	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	5385.9	93.5
0°-40°	5644.3	98.0
0°-60°	5754.7	99.9
0°-90°	5760.9	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	5760.9	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	18524	18524	18524	18524	18524	
5°	17924	17907	17903	17940	17925	1630
15°	9821	9703	9769	9737	9720	2630
25°	2308	2396	2603	2335	2261	1105
35°	387	396	371	368	311	263
45°	102	126	126	126	103	72
55°	16	17	31	18	17	16
65°	6	6	6	6	6	5
75°	0	0	1	0	0	1
85°	0	0	0	0	0	0
90°	0	0	0	0	0	0



TEST NUMBER: P751440

CATALOG NUMBER: LD4D65D010-EU4DR3055659027-4LBCSSQMW

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	18524.1	18524.1	18524.1	18524.1	18524.1
2.5°	18401.3	18388.6	18395.9	18405.0	18408.6
5°	17923.9	17906.6	17903.0	17940.2	17924.8
7.5°	16960.7	16936.2	16898.9	16983.5	17062.6
10°	15347.3	15320.1	15239.1	15279.1	15343.7
12.5°	12965.4	12877.2	12875.4	13002.7	12985.4
15°	9821.4	9703.2	9768.6	9736.8	9719.5
17.5°	6604.6	6559.1	6646.4	6620.0	6506.4
20°	4751.1	4762.9	4929.3	4845.7	4744.7
22.5°	3466.9	3509.7	3707.0	3491.5	3412.3
25°	2308.2	2395.5	2602.9	2334.6	2260.9
27.5°	1419.7	1459.7	1669.8	1401.5	1361.5
30°	883.1	863.1	962.2	825.8	769.4
32.5°	579.3	553.9	585.7	525.7	480.2
35°	387.4	395.6	371.1	368.3	311.0
37.5°	241.9	278.3	245.6	261.9	200.1
40°	156.4	201.9	173.7	191.9	147.3
42.5°	128.2	155.5	142.8	151.9	131.0
45°	101.9	126.4	126.4	126.4	102.8
47.5°	56.4	84.6	108.2	86.4	60.0
50°	31.8	42.7	83.7	44.6	33.7
52.5°	21.8	24.6	57.3	25.5	22.7
55°	16.4	17.3	30.9	18.2	17.3
57.5°	12.7	13.6	16.4	13.6	12.7
60°	10.0	10.0	11.8	10.9	10.0
62.5°	7.3	7.3	8.2	7.3	7.3
65°	5.5	5.5	5.5	5.5	5.5
67.5°	2.7	3.6	3.6	3.6	3.6
70°	2.7	1.8	1.8	1.8	2.7
72.5°	1.8	0.9	0.9	0.9	0.9
75°	0.0	0.0	0.9	0.0	0.0
77.5°	0.0	0.0	0.0	0.0	0.0
80°	0.0	0.0	0.0	0.0	0.0
82.5°	0.0	0.0	0.0	0.0	0.0
85°	0.0	0.0	0.0	0.0	0.0
87.5°	0.0	0.0	0.0	0.0	0.0
90°	0.0	0.0	0.0	0.0	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report





— 0°-180° - - 45°-225° - - - - 90°-270°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)