

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P751908

Luminaire Tested: LD4D65D010-EU4DR6055659027-4LBCSSQMW

Issue Date: 1/30/2024

Test Information

Test Method: LM-79-2019
Report Number: P751908
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-60)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 1/30/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LD4D65D010-EU4DR6055659027-4LBCSSQMW
Description: 4 INCH SQAURE SHALLOW CAST MATTE WHITE TRIM, WITH 60° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 2700K CCT
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 6354.7 lumens
Efficiency: N/A
Efficacy: 87.3 lumens/watt
Spacing Criteria (0/90/45): 0.98 / 0.98 / 0.92
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct

Input Watts (W): 72.8
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT



TEST NUMBER: P751908
CATALOG NUMBER: LD4D65D010-EU4DR6055659027-4LBCSSQMW

Luminous Intensity Polar Plot

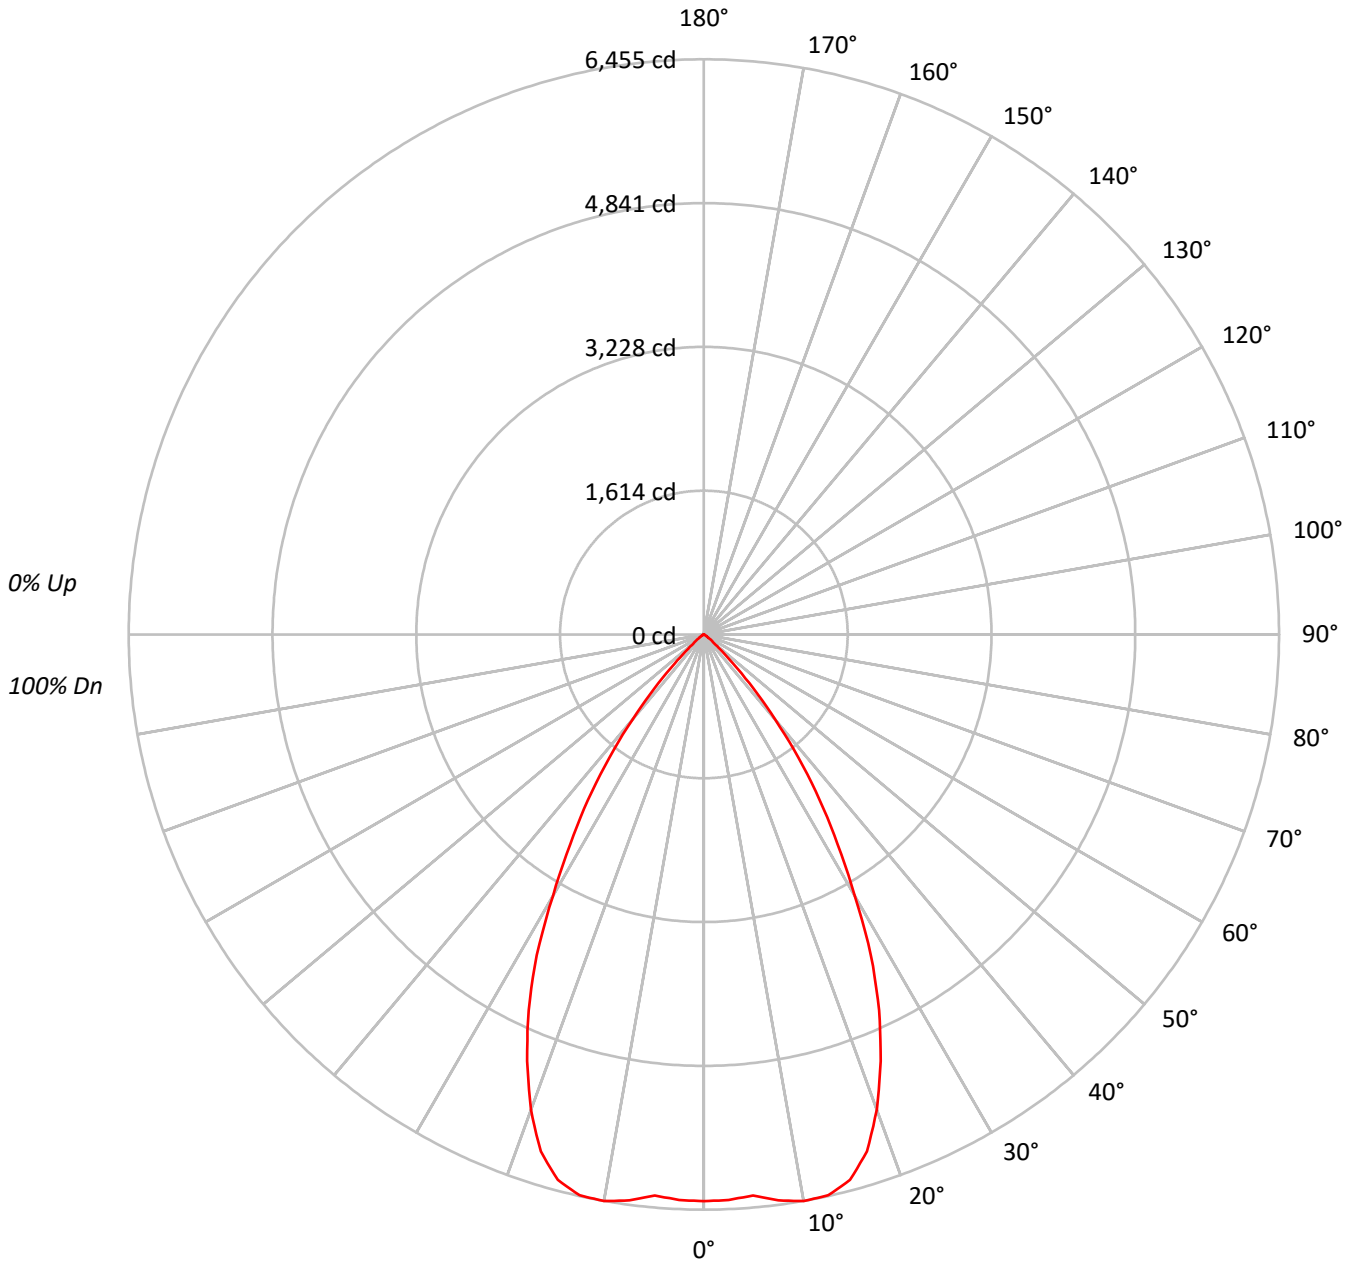



TEST NUMBER: P751908

CATALOG NUMBER: LD4D65D010-EU4DR6055659027-4LBCSSQMW

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20			
RC	80				70				50				30				10		0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10
RCR																				
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100		
1	114	111	108	106	111	109	106	104	105	103	101	101	99	98	97	96	95	94		
2	108	103	99	96	106	101	98	95	98	95	92	95	93	90	92	90	89	87		
3	102	96	91	87	100	95	90	86	92	88	85	90	86	84	87	85	82	81		
4	97	90	84	80	95	88	83	79	86	82	78	84	81	78	82	79	77	75		
5	92	84	78	74	91	83	77	73	81	76	73	79	75	72	78	74	71	70		
6	87	79	73	68	86	78	72	68	76	71	68	75	70	67	74	70	67	65		
7	83	74	68	63	82	73	67	63	72	67	63	71	66	63	69	65	62	61		
8	79	69	63	59	78	69	63	59	68	63	59	67	62	59	66	61	58	57		
9	75	65	59	55	74	65	59	55	64	59	55	63	58	55	62	58	55	53		
10	72	62	56	52	71	61	56	52	61	55	52	60	55	52	59	55	52	50		

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	694844
5°	693144
10°	716169
15°	716901
20°	659628
25°	561055
30°	427505
35°	302312
40°	177531
45°	71635
50°	23916
55°	11506
60°	4720
65°	698
70°	0
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 71635 cd/sqm



TEST NUMBER: P751908

CATALOG NUMBER: LD4D65D010-EU4DR6055659027-4LBCSSQMW

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	609.6	9.6
10°-20°	1755.8	27.6
20°-30°	2101.5	33.1
30°-40°	1405.5	22.1
40°-50°	416.7	6.6
50°-60°	59.9	0.9
60°-70°	5.7	0.1
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	4466.9	70.3
0°-40°	5872.4	92.4
0°-60°	6349.1	99.9
0°-90°	6354.7	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	6354.7	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	6360	
5°	6320	610
15°	6338	1756
25°	4654	2101
35°	2266	1406
45°	464	417
55°	60	60
65°	3	6
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P751908

CATALOG NUMBER: LD4D65D010-EU4DR6055659027-4LBCSSQMW

CANDELA DISTRIBUTION (FULL):

0°	
0°	6359.5
2.5°	6351.3
5°	6319.8
7.5°	6405.4
10°	6455.1
12.5°	6446.0
15°	6337.8
17.5°	6082.6
20°	5673.1
22.5°	5181.5
25°	4653.9
27.5°	4059.6
30°	3388.5
32.5°	2789.6
35°	2266.5
37.5°	1742.5
40°	1244.7
42.5°	820.7
45°	463.6
47.5°	237.2
50°	140.7
52.5°	91.1
55°	60.4
57.5°	38.8
60°	21.6
62.5°	9.0
65°	2.7
67.5°	0.9
70°	0.0
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)