

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P751918

Luminaire Tested: LD4D65D010-EU4DR6055659027-4LBSQW1MW

Issue Date: 2/5/2024

Test Information

Test Method: LM-79-2019
Report Number: P751918
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-57)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/5/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LD4D65D010-EU4DR6055659027-4LBSQW1MW
Description: 4 INCH SQAURE DEEP 45° CUTOFF MATTE WHITE TRIM, WITH 60° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 2700K CCT
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 5822.6 lumens
Efficiency: N/A
Efficacy: 80.0 lumens/watt
Spacing Criteria (0/90/45): 0.91 / 0.91 / 0.83
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct

Input Watts (W): 72.8
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT



TEST NUMBER: P751918
CATALOG NUMBER: LD4D65D010-EU4DR6055659027-4LBSQW1MW

Luminous Intensity Polar Plot

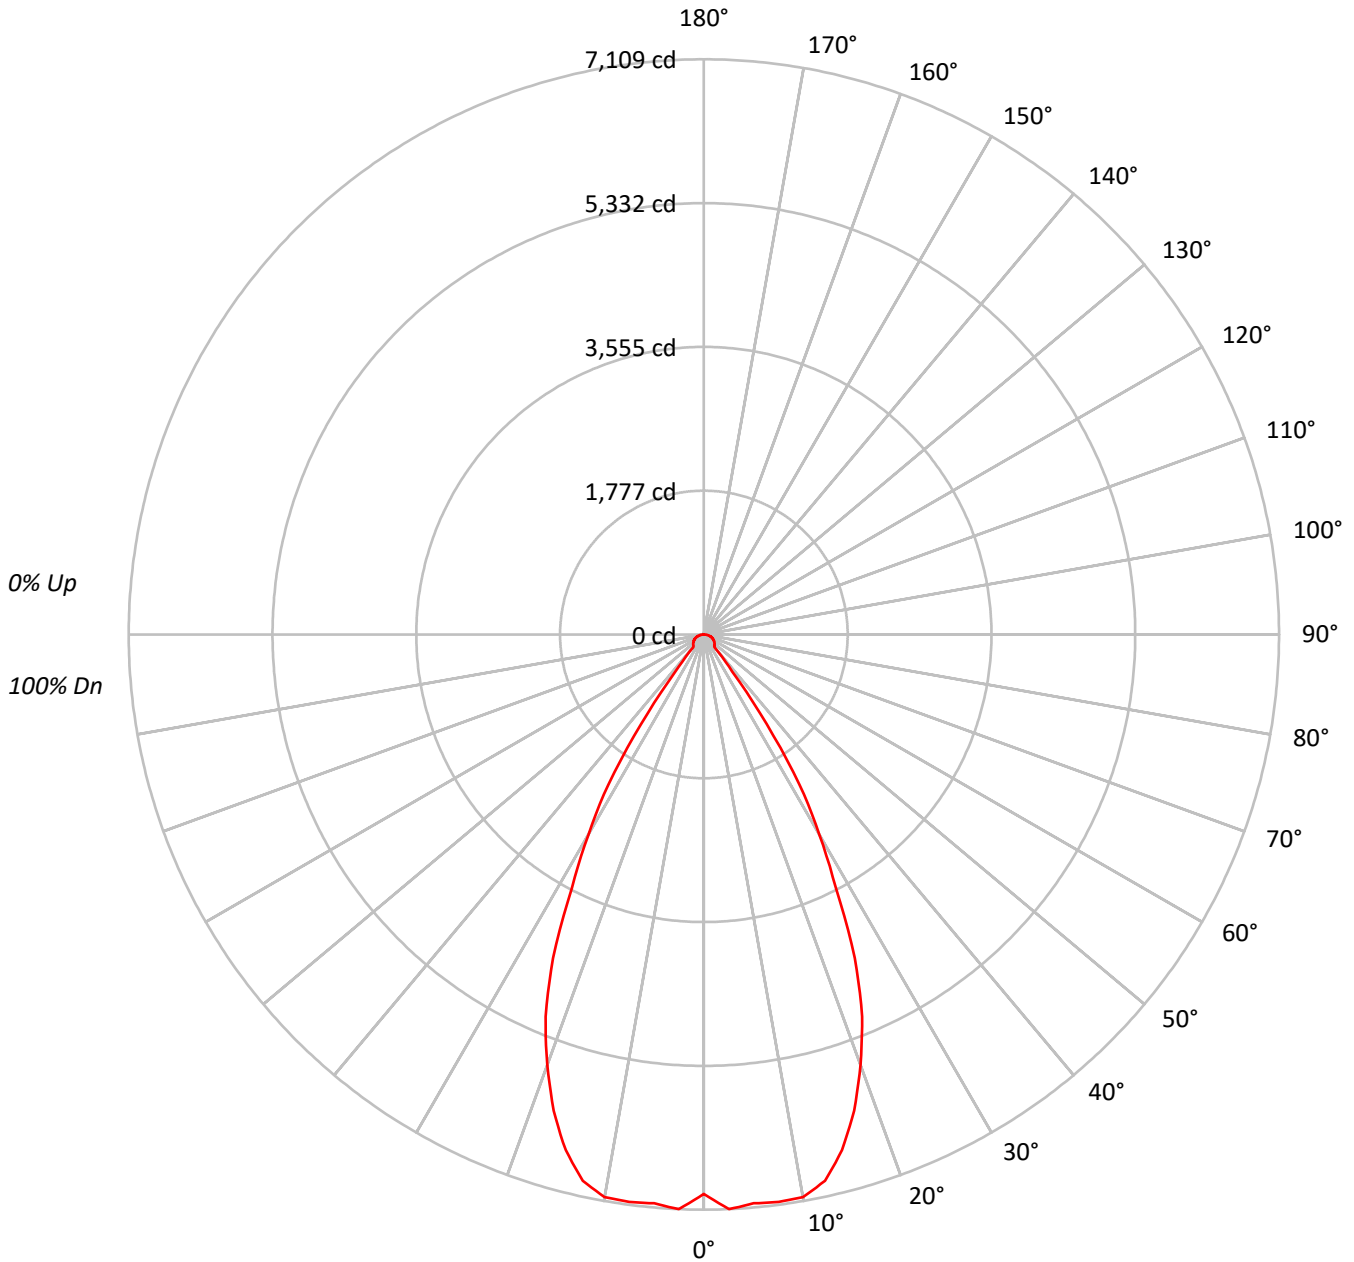



TEST NUMBER: P751918

CATALOG NUMBER: LD4D65D010-EU4DR6055659027-4LBSQW1MW

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20			
RC	80				70				50				30				10		0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10
RCR																				
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100		
1	113	110	108	105	111	108	106	104	104	102	100	100	99	97	97	96	95	93		
2	107	102	98	95	105	101	97	94	97	94	92	94	92	90	92	90	88	86		
3	102	96	90	86	100	94	89	86	91	88	84	89	86	83	87	84	82	80		
4	97	89	84	80	95	88	83	79	86	82	78	84	80	77	82	79	76	75		
5	92	84	78	74	91	83	78	74	81	77	73	80	76	72	78	75	72	70		
6	88	79	73	69	87	78	73	69	77	72	68	75	71	68	74	70	67	66		
7	84	75	69	65	83	74	68	64	73	68	64	72	67	64	71	67	63	62		
8	80	71	65	61	79	70	65	61	69	64	60	68	64	60	67	63	60	59		
9	77	67	61	57	75	67	61	57	66	61	57	65	60	57	64	60	57	55		
10	73	64	58	54	72	63	58	54	62	58	54	62	57	54	61	57	54	53		

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	755538
5°	774119
10°	783469
15°	746367
20°	658058
25°	532254
30°	360033
35°	180414
40°	29268
45°	28648
50°	29219
55°	29659
60°	30484
65°	31179
70°	31914
75°	32295
80°	31146
85°	25950

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 75°
 Luminance: 32295 cd/sqm



TEST NUMBER: P751918

CATALOG NUMBER: LD4D65D010-EU4DR6055659027-4LBSQW1MW

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	674.6	11.6
10°-20°	1825.1	31.3
20°-30°	1963.7	33.7
30°-40°	853.6	14.7
40°-50°	143.4	2.5
50°-60°	139.4	2.4
60°-70°	119.2	2.0
70°-80°	79.8	1.4
80°-90°	23.9	0.4
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	4463.4	76.7
0°-40°	5316.9	91.3
0°-60°	5599.7	96.2
0°-90°	5822.6	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	5822.6	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	6915	
5°	7058	675
15°	6598	1825
25°	4415	1964
35°	1353	854
45°	185	143
55°	156	139
65°	121	119
75°	76	80
85°	21	24
90°	0	



TEST NUMBER: P751918

CATALOG NUMBER: LD4D65D010-EU4DR6055659027-4LBSQW1MW

CANDELA DISTRIBUTION (FULL):

	0°
0°	6915.0
2.5°	7109.4
5°	7058.1
7.5°	7074.3
10°	7061.7
12.5°	6915.9
15°	6598.3
17.5°	6171.7
20°	5659.6
22.5°	5111.6
25°	4415.0
27.5°	3531.3
30°	2853.7
32.5°	2199.4
35°	1352.6
37.5°	578.7
40°	205.2
42.5°	189.0
45°	185.4
47.5°	179.1
50°	171.9
52.5°	163.8
55°	155.7
57.5°	147.6
60°	139.5
62.5°	130.5
65°	120.6
67.5°	110.7
70°	99.9
72.5°	88.2
75°	76.5
77.5°	63.0
80°	49.5
82.5°	35.1
85°	20.7
87.5°	7.2
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)