

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P751710

Luminaire Tested: LD4D65D010-EU4DR4555659035-4LBSQW1MW

Issue Date: 1/30/2024

Test Information

Test Method: LM-79-2019
Report Number: P751710
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-36)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 1/30/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LD4D65D010-EU4DR4555659035-4LBSQW1MW
Description: 4 INCH SQAURE DEEP 45° CUTOFF MATTE WHITE TRIM, WITH 45° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 3500K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 6332.6 lumens
Efficiency: N/A
Efficacy: 87.0 lumens/watt
Spacing Criteria (0/90/45): 0.75 / 0.75 / 0.69
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct


Input Watts (W): 72.8
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT



TEST NUMBER: P751710

CATALOG NUMBER: LD4D65D010-EU4DR4555659035-4LBSQW1MW

Luminous Intensity Polar Plot

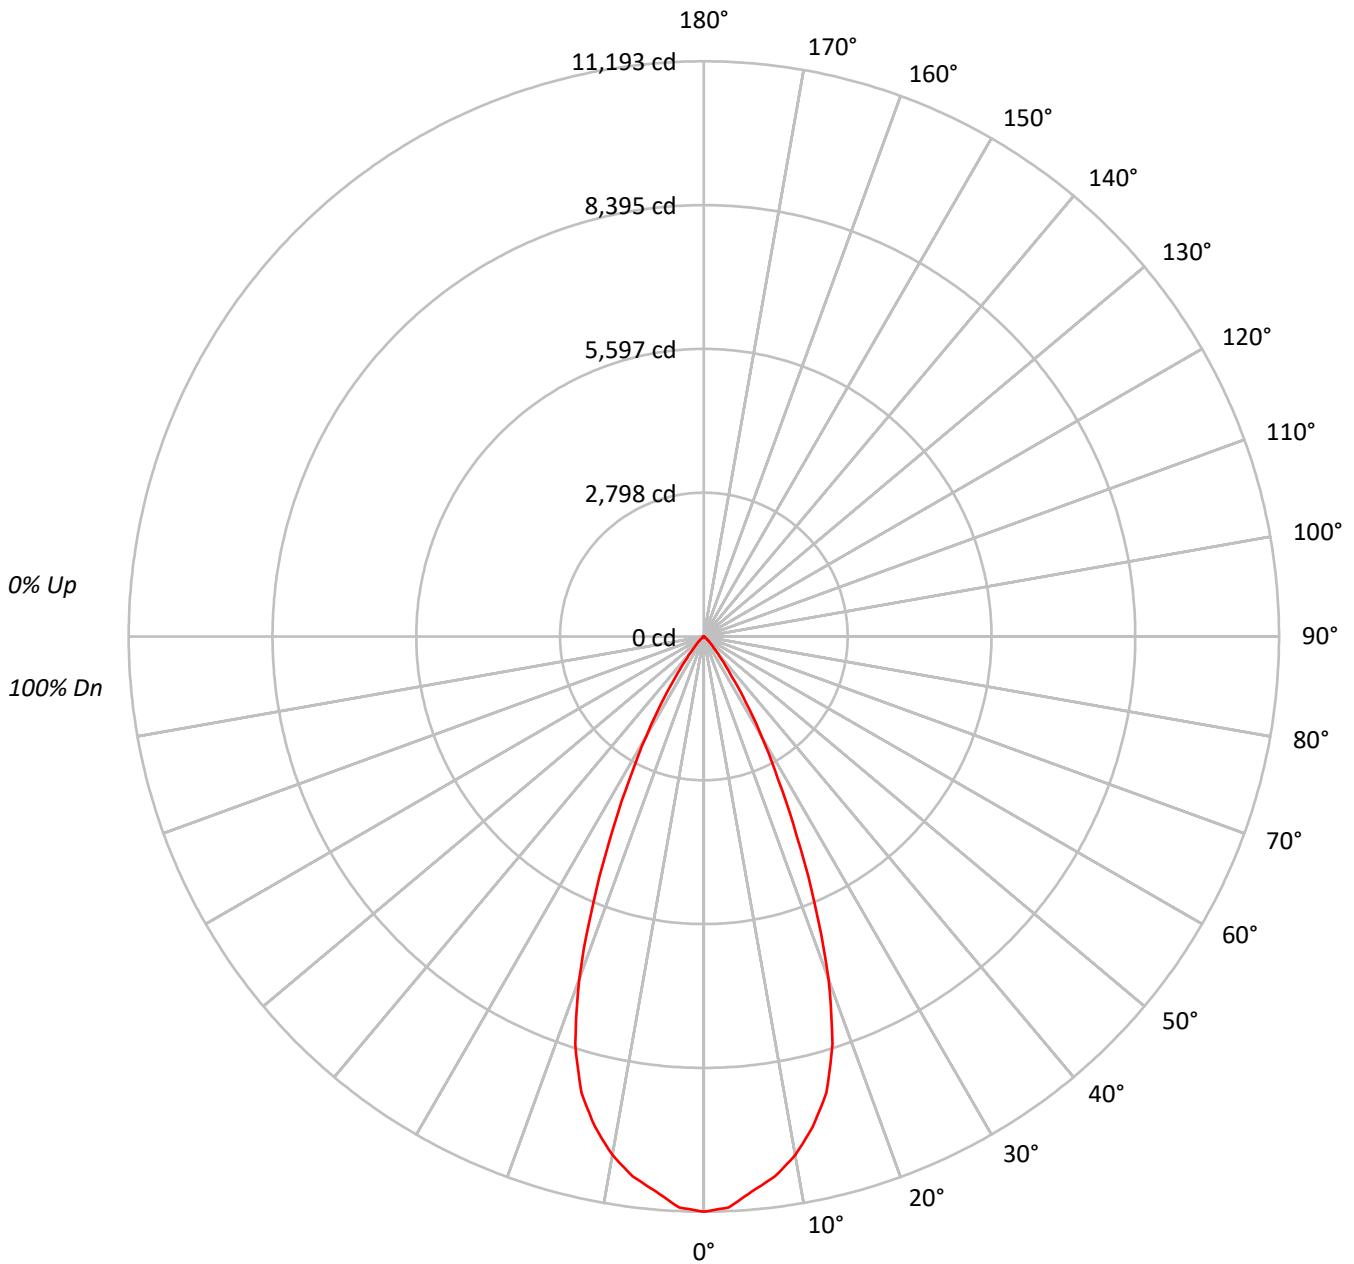



TEST NUMBER: P751710

CATALOG NUMBER: LD4D65D010-EU4DR4555659035-4LBSQW1MW

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20					20					20					20					20	
RC	80					70					50					30					10	0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0	
RCR																						
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100				
1	114	112	110	108	112	110	108	106	106	104	103	102	101	100	98	98	97	95				
2	109	105	102	99	107	103	100	98	100	98	95	97	95	93	95	93	91	90				
3	105	99	95	91	103	98	94	91	95	92	89	93	90	88	91	89	87	85				
4	100	94	89	85	99	93	88	85	91	87	84	89	86	83	87	84	82	81				
5	96	89	84	80	95	88	83	80	86	82	79	85	81	79	83	80	78	77				
6	92	85	80	76	91	84	79	76	83	78	75	81	77	75	80	77	74	73				
7	89	81	75	72	87	80	75	72	79	74	71	78	74	71	77	73	71	69				
8	85	77	72	68	84	76	71	68	75	71	68	74	70	67	73	70	67	66				
9	82	73	68	65	81	73	68	65	72	68	65	71	67	64	71	67	64	63				
10	79	70	65	62	78	70	65	62	69	65	62	68	64	61	68	64	61	60				

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	1222956
5°	1188132
10°	1136722
15°	1040342
20°	825351
25°	515280
30°	284007
35°	127527
40°	50220
45°	23672
50°	11219
55°	5867
60°	2884
65°	672
70°	288
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 23672 cd/sqm



TEST NUMBER: P751710

CATALOG NUMBER: LD4D65D010-EU4DR4555659035-4LBSQW1MW

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	1017.9	16.1
10°-20°	2505.1	39.6
20°-30°	1983.8	31.3
30°-40°	660.6	10.4
40°-50°	131.1	2.1
50°-60°	29.8	0.5
60°-70°	4.3	0.1
70°-80°	0.1	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	5506.7	87.0
0°-40°	6167.3	97.4
0°-60°	6328.2	99.9
0°-90°	6332.6	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	6332.6	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	11193	
5°	10833	###
15°	9197	2505
25°	4274	1984
35°	956	661
45°	153	131
55°	31	30
65°	3	4
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P751710

CATALOG NUMBER: LD4D65D010-EU4DR4555659035-4LBSQW1MW

CANDELA DISTRIBUTION (FULL):

0°	
0°	11193.0
2.5°	11119.9
5°	10832.9
7.5°	10596.1
10°	10245.7
12.5°	9779.1
15°	9197.2
17.5°	8322.1
20°	7098.4
22.5°	5640.5
25°	4274.2
27.5°	3129.7
30°	2251.1
32.5°	1531.0
35°	956.1
37.5°	567.0
40°	352.1
42.5°	231.5
45°	153.2
47.5°	98.6
50°	66.0
52.5°	44.0
55°	30.8
57.5°	20.2
60°	13.2
62.5°	7.0
65°	2.6
67.5°	0.9
70°	0.9
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)