

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P752307

Luminaire Tested: LD4D70BD010-EU4DR3570959027-4LBSQW1B

Issue Date: 1/30/2024

Test Information

Test Method: LM-79-2019
Report Number: P752307
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-20)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 1/30/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LD4D70BD010-EU4DR3570959027-4LBSQW1B
Description: 4 INCH SQAURE DEEP 45° CUTOFF SPECULAR BLACK TRIM, WITH 35° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 2700K CCT
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 5388.9 lumens
Efficiency: N/A
Efficacy: 80.9 lumens/watt
Spacing Criteria (0/90/45): 0.6 / 0.6 / 0.54
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct

Input Watts (W): 66.6
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT



TEST NUMBER: P752307
CATALOG NUMBER: LD4D70BD010-EU4DR3570959027-4LBSQW1B

Luminous Intensity Polar Plot

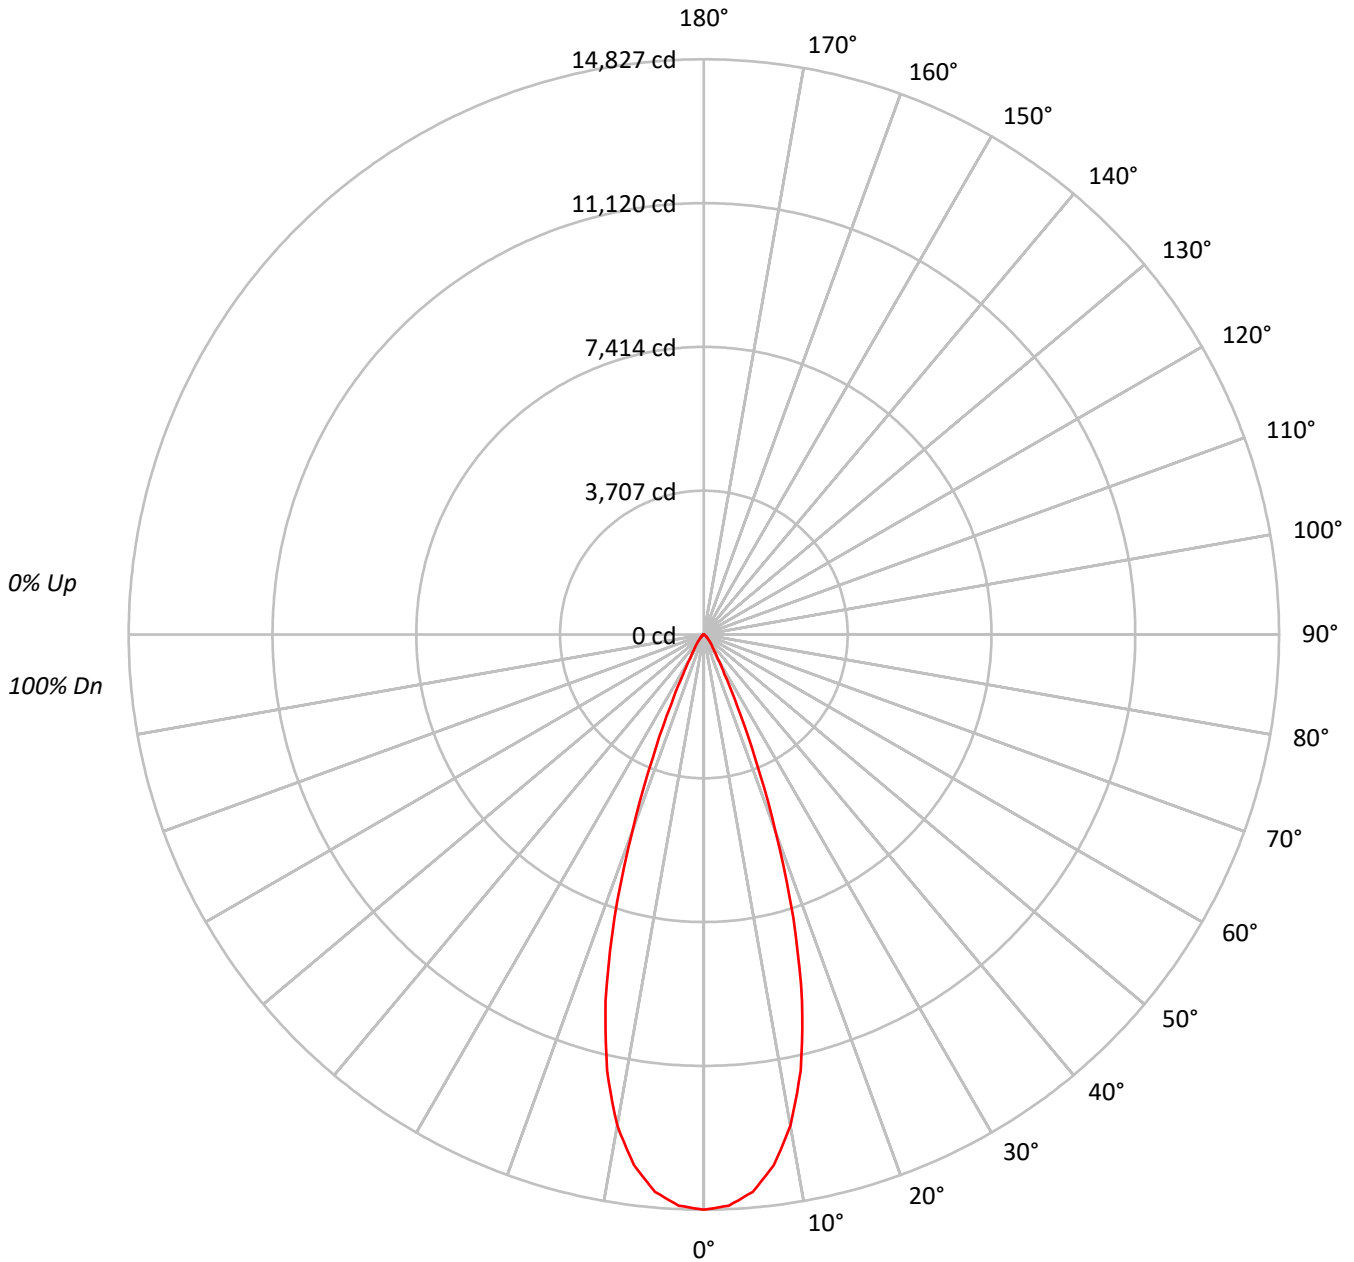



TEST NUMBER: P752307

CATALOG NUMBER: LD4D70BD010-EU4DR3570959027-4LBSQW1B

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10		0		
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			
1	115	112	110	108	112	110	108	107	106	105	103	103	101	100	99	98	98	96			
2	110	106	103	101	108	105	102	99	102	99	97	99	97	95	96	95	93	92			
3	106	101	97	94	105	100	96	93	97	95	92	95	93	91	93	91	89	88			
4	103	97	92	89	101	96	92	89	94	90	88	92	89	87	90	88	86	84			
5	99	93	88	85	98	92	87	84	90	86	84	89	85	83	87	84	82	81			
6	96	89	84	81	94	88	84	81	87	83	80	85	82	80	84	81	79	78			
7	93	85	81	78	91	85	80	77	84	80	77	83	79	77	82	79	76	75			
8	90	82	78	74	88	82	77	74	81	77	74	80	76	74	79	76	73	72			
9	87	79	75	72	86	79	75	72	78	74	71	77	74	71	77	73	71	70			
10	84	77	72	69	83	76	72	69	76	72	69	75	71	69	74	71	69	68			

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	1620053
5°	1581997
10°	1425793
15°	1106639
20°	627676
25°	244198
30°	91103
35°	49939
40°	32634
45°	19871
50°	12646
55°	8934
60°	6534
65°	3542
70°	256
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 19871 cd/sqm



TEST NUMBER: P752307

CATALOG NUMBER: LD4D70BD010-EU4DR3570959027-4LBSQW1B

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	1326.6	24.6
10°-20°	2590.0	48.1
20°-30°	1056.3	19.6
30°-40°	252.8	4.7
40°-50°	105.3	2.0
50°-60°	43.6	0.8
60°-70°	13.6	0.3
70°-80°	0.3	0.0
80°-90°	0.2	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	4973.0	92.3
0°-40°	5225.7	97.0
0°-60°	5374.7	99.7
0°-90°	5388.9	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	5388.9	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	14827	
5°	14424	###
15°	9783	2590
25°	2026	1056
35°	374	253
45°	129	105
55°	47	44
65°	14	14
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P752307

CATALOG NUMBER: LD4D70BD010-EU4DR3570959027-4LBSQW1B

CANDELA DISTRIBUTION (FULL):

	0°
0°	14827.4
2.5°	14738.5
5°	14424.0
7.5°	13796.5
10°	12851.2
12.5°	11520.2
15°	9783.3
17.5°	7659.1
20°	5398.3
22.5°	3442.2
25°	2025.6
27.5°	1145.0
30°	722.1
32.5°	507.0
35°	374.4
37.5°	289.5
40°	228.8
42.5°	176.3
45°	128.6
47.5°	96.2
50°	74.4
52.5°	59.0
55°	46.9
57.5°	38.0
60°	29.9
62.5°	21.8
65°	13.7
67.5°	4.9
70°	0.8
72.5°	0.8
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.8
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)