

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P752505

Luminaire Tested: LD4D70BD010-EU4DR4570959050-4LBCSSQMMS

Issue Date: 1/30/2024

Test Information

Test Method: LM-79-2019
Report Number: P752505
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-36)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 1/30/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LD4D70BD010-EU4DR4570959050-4LBCSSQMMMS
Description: 4 INCH SQAURE SHALLOW CAST MATTE METALLIC SILVER TRIM, WITH 45° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 5000K CCT
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 7097.2 lumens
Efficiency: N/A
Efficacy: 106.6 lumens/watt
Spacing Criteria (0/90/45): 0.75 / 0.75 / 0.69
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct

Input Watts (W): 66.6
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT



TEST NUMBER: P752505
CATALOG NUMBER: LD4D70BD010-EU4DR4570959050-4LBCSSQMMS

Luminous Intensity Polar Plot

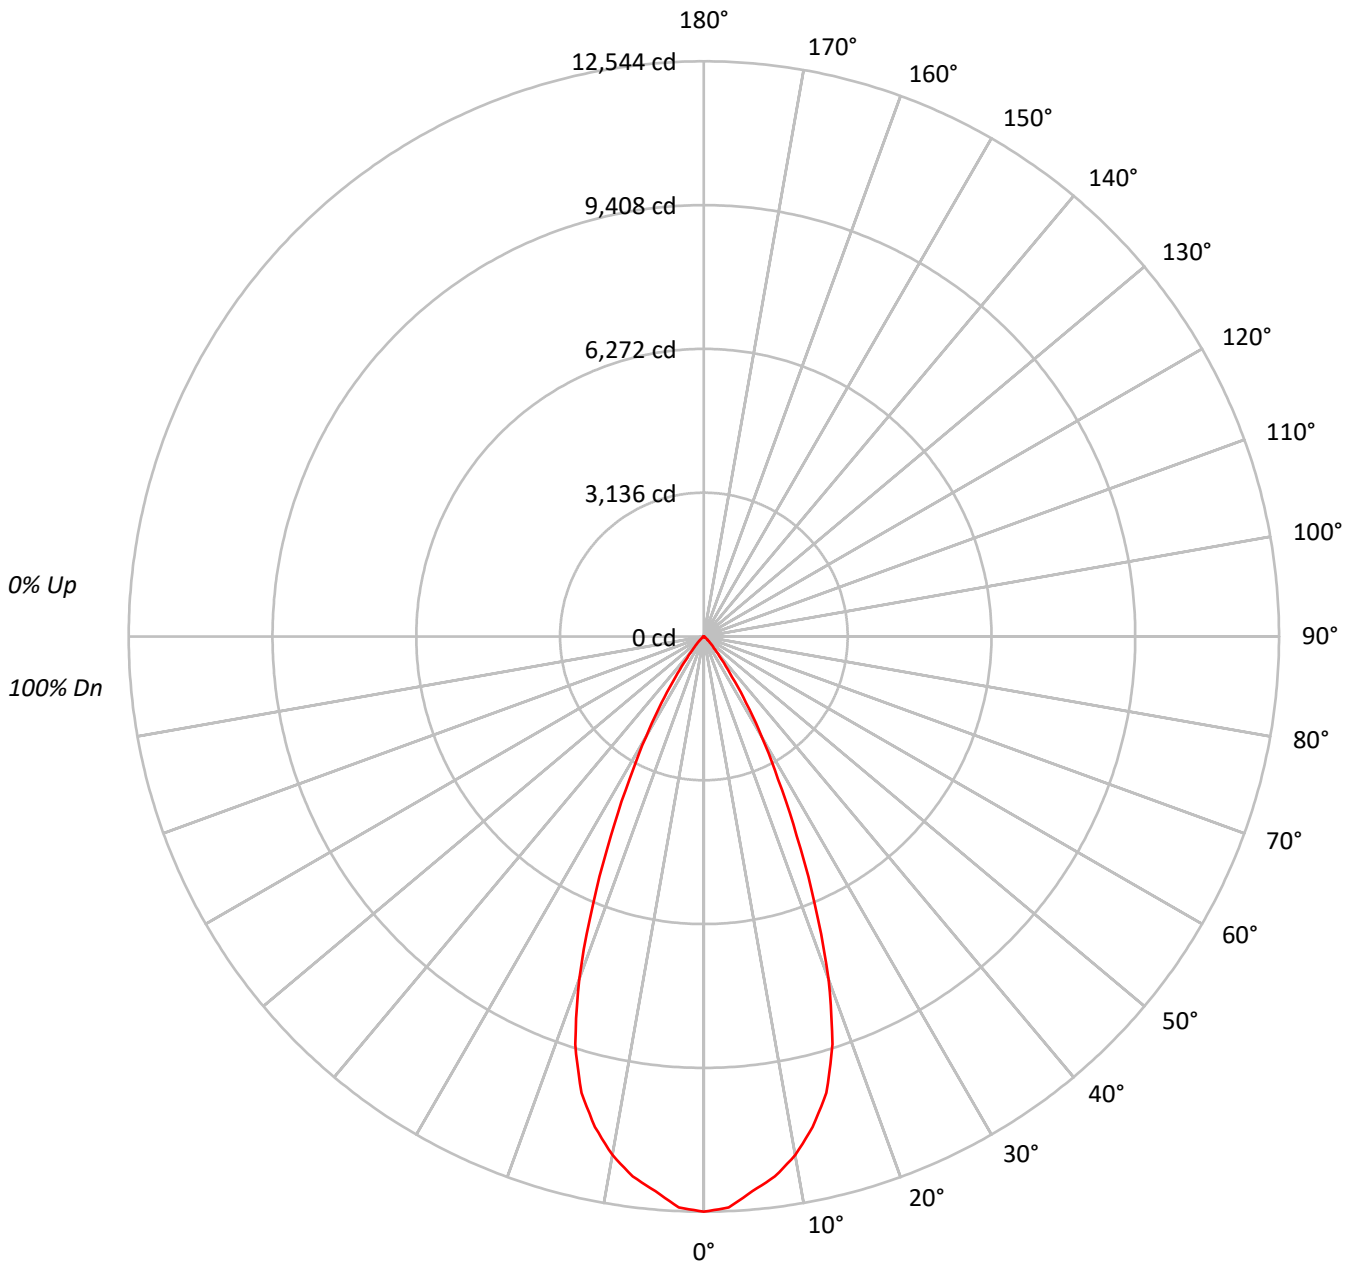



TEST NUMBER: P752505

CATALOG NUMBER: LD4D70BD010-EU4DR4570959050-4LBCSSQMMS

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20	
RC	80				70				50				30				10	0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																		
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100
1	114	112	110	108	112	110	108	106	106	104	103	102	101	100	98	98	97	95
2	109	105	102	99	107	103	100	98	100	98	95	97	95	93	95	93	91	90
3	105	99	95	91	103	98	94	91	95	92	89	93	90	88	91	89	87	85
4	100	94	89	85	99	93	88	85	91	87	84	89	86	83	87	84	82	81
5	96	89	84	80	95	88	83	80	86	82	79	85	81	79	83	80	78	77
6	92	85	80	76	91	84	79	76	83	78	75	81	77	75	80	77	74	73
7	89	81	75	72	87	80	75	72	79	74	71	78	74	71	77	73	71	69
8	85	77	72	68	84	76	71	68	75	71	68	74	70	67	73	70	67	66
9	82	73	68	65	81	73	68	65	72	68	65	71	67	64	71	67	64	63
10	79	70	65	62	78	70	65	62	69	65	62	68	64	61	68	64	61	60

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	1370600
5°	1331580
10°	1273963
15°	1165945
20°	924997
25°	577487
30°	318298
35°	142920
40°	56296
45°	26531
50°	12578
55°	6572
60°	3234
65°	776
70°	319
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 26531 cd/sqm



TEST NUMBER: P752505

CATALOG NUMBER: LD4D70BD010-EU4DR4570959050-4LBCSSQMMS

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	1140.7	16.1
10°-20°	2807.5	39.6
20°-30°	2223.3	31.3
30°-40°	740.4	10.4
40°-50°	146.9	2.1
50°-60°	33.4	0.5
60°-70°	4.8	0.1
70°-80°	0.1	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	6171.5	87.0
0°-40°	6911.9	97.4
0°-60°	7092.2	99.9
0°-90°	7097.2	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	7097.2	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	12544	
5°	12141	###
15°	10308	2808
25°	4790	2223
35°	1072	740
45°	172	147
55°	34	33
65°	3	5
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P752505

CATALOG NUMBER: LD4D70BD010-EU4DR4570959050-4LBCSSQMMMS

CANDELA DISTRIBUTION (FULL):

0°	
0°	12544.3
2.5°	12462.4
5°	12140.8
7.5°	11875.4
10°	11482.7
12.5°	10959.8
15°	10307.6
17.5°	9326.9
20°	7955.4
22.5°	6321.5
25°	4790.2
27.5°	3507.6
30°	2522.9
32.5°	1715.8
35°	1071.5
37.5°	635.4
40°	394.7
42.5°	259.5
45°	171.7
47.5°	110.5
50°	74.0
52.5°	49.3
55°	34.5
57.5°	22.7
60°	14.8
62.5°	7.9
65°	3.0
67.5°	1.0
70°	1.0
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)