

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P752987

Luminaire Tested: LD4D75BD010-EU4DR3070959024-4LBCSSQMW

Issue Date: 1/30/2024

Test Information

Test Method: LM-79-2019
Report Number: P752987
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-16)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 1/30/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LD4D75BD010-EU4DR3070959024-4LBCSSQMW
Description: 4 INCH SQAURE SHALLOW CAST MATTE WHITE TRIM, WITH 30° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 2400K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 5479.0 lumens
Efficiency: N/A
Efficacy: 75.7 lumens/watt
Spacing Criteria (0/90/45): 0.52 / 0.52 / 0.49
Luminous Opening: Rectangular (W 0.38' x L: 0.38' x H: 0')
CIE Type: Direct


Input Watts (W): 72.4
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT



TEST NUMBER: P752987

CATALOG NUMBER: LD4D75BD010-EU4DR3070959024-4LBCSSQMW

Luminous Intensity Polar Plot

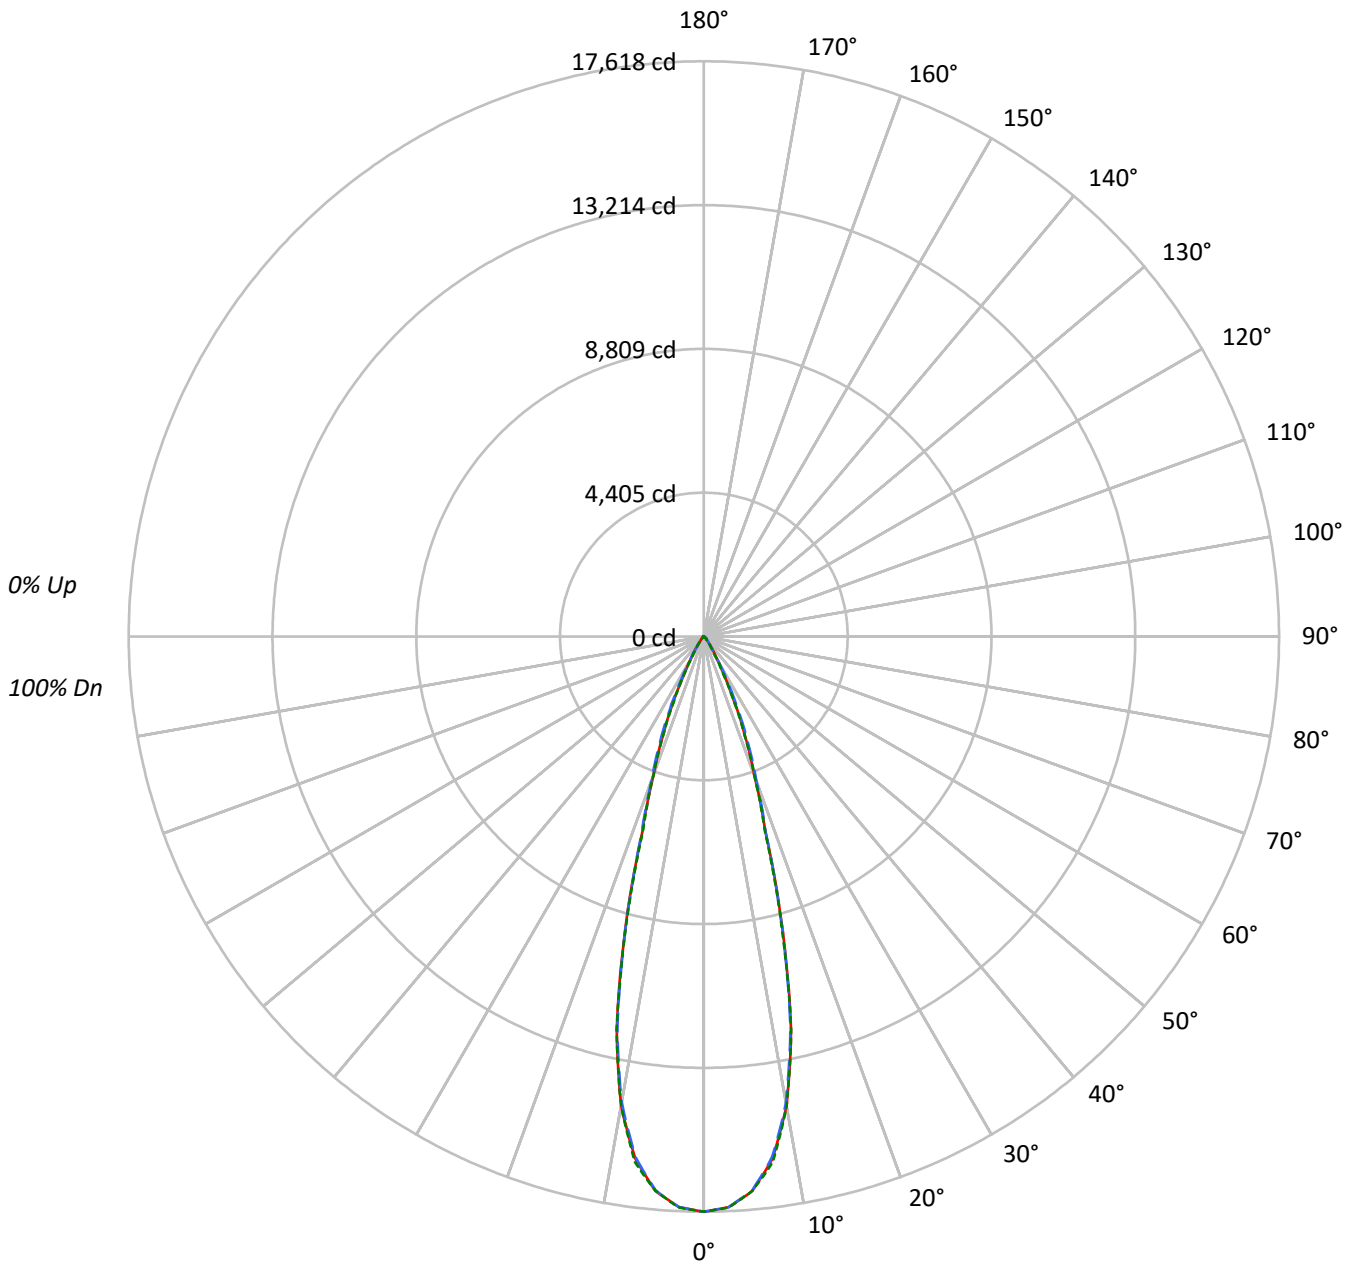



TEST NUMBER: P752987

CATALOG NUMBER: LD4D75BD010-EU4DR3070959024-4LBCSSQMW

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0													
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100																			
1	115	113	111	109	112	110	109	107	106	105	104	103	102	101	99	99	98	96																			
2	111	107	104	101	109	105	102	100	102	100	98	99	97	96	97	95	94	92																			
3	107	102	98	95	105	101	97	94	98	95	93	96	93	91	94	92	90	89																			
4	103	98	93	90	102	96	93	90	94	91	89	93	90	88	91	89	87	85																			
5	100	94	89	86	98	93	89	86	91	88	85	90	86	84	88	86	83	82																			
6	97	90	85	82	95	89	85	82	88	84	81	87	83	81	85	83	80	79																			
7	94	87	82	79	92	86	82	79	85	81	78	84	81	78	83	80	78	77																			
8	91	84	79	76	90	83	79	76	82	78	76	81	78	75	80	77	75	74																			
9	88	81	76	73	87	80	76	73	80	76	73	79	75	73	78	75	73	72																			
10	85	78	74	71	85	78	74	71	77	73	71	76	73	71	76	73	70	69																			

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1348519	1348519	1348519
5°	1309812	1308283	1309873
10°	1134494	1126496	1134221
15°	740198	736228	732527
20°	368066	381873	367577
25°	185407	209072	181606
30°	74234	80881	64680
35°	34433	32976	27640
40°	14868	16507	13999
45°	10489	13011	10576
50°	3608	9479	3811
55°	2082	3923	2189
60°	1454	1715	1454
65°	942	942	942
70°	582	380	582
75°	0	266	0
80°	0	0	0
85°	0	0	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 22.5°
 Vertical Angle: 45°
 Luminance: 13011 cd/sqm



TEST NUMBER: P752987

CATALOG NUMBER: LD4D75BD010-EU4DR3070959024-4LBCSSQMW

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	1549.2	28.3
10°-20°	2495.0	45.5
20°-30°	1078.2	19.7
30°-40°	245.7	4.5
40°-50°	84.4	1.5
50°-60°	20.6	0.4
60°-70°	5.3	0.1
70°-80°	0.6	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	5122.4	93.5
0°-40°	5368.1	98.0
0°-60°	5473.1	99.9
0°-90°	5479.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	5479.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	17618	17618	17618	17618	17618	
5°	17047	17030	17027	17062	17048	1550
15°	9341	9228	9291	9260	9244	2501
25°	2195	2278	2476	2220	2150	1051
35°	368	376	353	350	296	250
45°	97	120	120	120	98	69
55°	16	16	29	17	16	15
65°	5	5	5	5	5	5
75°	0	0	1	0	0	1
85°	0	0	0	0	0	0
90°	0	0	0	0	0	0



TEST NUMBER: P752987

CATALOG NUMBER: LD4D75BD010-EU4DR3070959024-4LBCSSQMW

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	17617.7	17617.7	17617.7	17617.7	17617.7
2.5°	17501.0	17488.9	17495.8	17504.4	17507.9
5°	17046.9	17030.4	17027.0	17062.4	17047.7
7.5°	16130.9	16107.5	16072.0	16152.5	16227.7
10°	14596.4	14570.4	14493.5	14531.5	14592.9
12.5°	12331.0	12247.1	12245.4	12366.5	12350.1
15°	9340.8	9228.4	9290.7	9260.4	9244.0
17.5°	6281.4	6238.2	6321.2	6296.1	6188.0
20°	4518.6	4529.9	4688.1	4608.6	4512.6
22.5°	3297.3	3337.9	3525.6	3320.6	3245.4
25°	2195.3	2278.3	2475.5	2220.4	2150.3
27.5°	1350.2	1388.3	1588.1	1332.9	1294.9
30°	839.9	820.9	915.1	785.4	731.8
32.5°	551.0	526.8	557.0	500.0	456.7
35°	368.5	376.3	352.9	350.3	295.8
37.5°	230.1	264.7	233.5	249.1	190.3
40°	148.8	192.0	165.2	182.5	140.1
42.5°	122.0	147.9	135.8	144.5	124.6
45°	96.9	120.2	120.2	120.2	97.7
47.5°	53.6	80.4	102.9	82.2	57.1
50°	30.3	40.7	79.6	42.4	32.0
52.5°	20.8	23.4	54.5	24.2	21.6
55°	15.6	16.4	29.4	17.3	16.4
57.5°	12.1	13.0	15.6	13.0	12.1
60°	9.5	9.5	11.2	10.4	9.5
62.5°	6.9	6.9	7.8	6.9	6.9
65°	5.2	5.2	5.2	5.2	5.2
67.5°	2.6	3.5	3.5	3.5	3.5
70°	2.6	1.7	1.7	1.7	2.6
72.5°	1.7	0.9	0.9	0.9	0.9
75°	0.0	0.0	0.9	0.0	0.0
77.5°	0.0	0.0	0.0	0.0	0.0
80°	0.0	0.0	0.0	0.0	0.0
82.5°	0.0	0.0	0.0	0.0	0.0
85°	0.0	0.0	0.0	0.0	0.0
87.5°	0.0	0.0	0.0	0.0	0.0
90°	0.0	0.0	0.0	0.0	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report





— 0°-180° - - 45°-225° - - - 90°-270°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)