

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P753207

Luminaire Tested: LD4D75BD010-EU4DR4070959050-4LBCSSQMMS

Issue Date: 1/30/2024

Test Information

Test Method: LM-79-2019
Report Number: P753207
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-28)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 1/30/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LD4D75BD010-EU4DR4070959050-4LBCSSQMMMS
Description: 4 INCH SQAURE SHALLOW CAST MATTE METALLIC SILVER TRIM, WITH 40° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 5000K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 7517.2 lumens
Efficiency: N/A
Efficacy: 103.8 lumens/watt
Spacing Criteria (0/90/45): 0.68 / 0.68 / 0.6
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct


Input Watts (W): 72.4
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT



TEST NUMBER: P753207

CATALOG NUMBER: LD4D75BD010-EU4DR4070959050-4LBCSSQMMS

Luminous Intensity Polar Plot

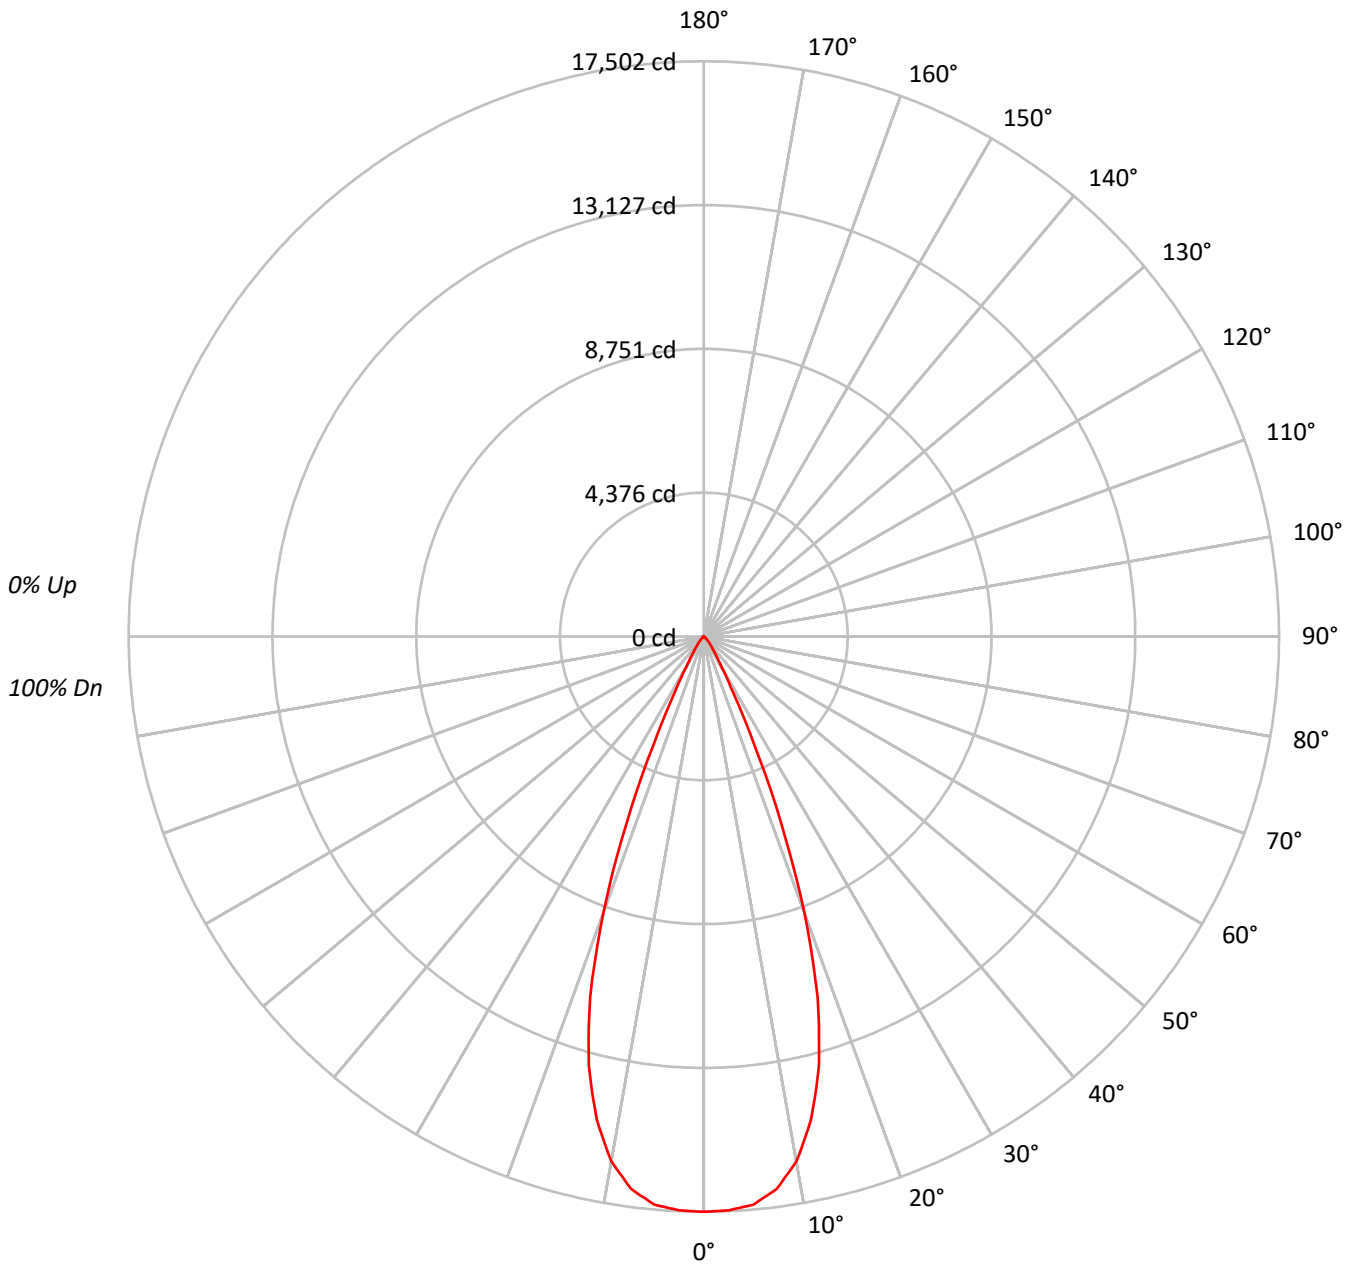



TEST NUMBER: P753207

CATALOG NUMBER: LD4D75BD010-EU4DR4070959050-4LBCSSQMMS

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			
1	115	112	110	108	112	110	108	107	106	105	103	103	101	100	99	98	97	96			
2	110	106	103	100	108	105	102	99	102	99	97	99	97	95	96	95	93	92			
3	106	101	97	94	104	100	96	93	97	94	92	95	93	90	93	91	89	88			
4	102	97	92	89	101	95	91	88	93	90	87	92	89	86	90	87	85	84			
5	99	92	88	84	97	91	87	84	90	86	83	88	85	83	87	84	82	81			
6	95	88	84	80	94	88	83	80	86	82	80	85	82	79	84	81	79	77			
7	92	85	80	77	91	84	80	77	83	79	76	82	79	76	81	78	76	74			
8	89	82	77	74	88	81	77	74	80	76	73	79	76	73	78	75	73	72			
9	86	79	74	71	85	78	74	71	77	73	71	76	73	70	76	72	70	69			
10	83	76	71	68	82	75	71	68	75	71	68	74	70	68	73	70	68	67			

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	1912304
5°	1903003
10°	1798761
15°	1529169
20°	1042235
25°	434869
30°	136736
35°	63557
40°	35144
45°	16116
50°	7819
55°	4286
60°	2229
65°	801
70°	319
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 16116 cd/sqm



TEST NUMBER: P753207

CATALOG NUMBER: LD4D75BD010-EU4DR4070959050-4LBCSSQMMS

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	1620.1	21.6
10°-20°	3629.5	48.3
20°-30°	1816.8	24.2
30°-40°	333.1	4.4
40°-50°	91.9	1.2
50°-60°	21.6	0.3
60°-70°	4.1	0.1
70°-80°	0.1	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	7066.5	94.0
0°-40°	7399.5	98.4
0°-60°	7513.0	99.9
0°-90°	7517.2	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	7517.2	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	17502	
5°	17351	###
15°	13519	3630
25°	3607	1817
35°	476	333
45°	104	92
55°	22	22
65°	3	4
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P753207

CATALOG NUMBER: LD4D75BD010-EU4DR4070959050-4LBCSSQMMS

CANDELA DISTRIBUTION (FULL):

	0°
0°	17502.2
2.5°	17476.6
5°	17350.8
7.5°	16950.0
10°	16212.9
12.5°	15063.6
15°	13518.7
17.5°	11509.6
20°	8963.7
22.5°	6111.1
25°	3607.2
27.5°	1906.9
30°	1083.8
32.5°	700.4
35°	476.5
37.5°	340.5
40°	246.4
42.5°	168.7
45°	104.3
47.5°	66.5
50°	46.0
52.5°	32.7
55°	22.5
57.5°	14.3
60°	10.2
62.5°	6.1
65°	3.1
67.5°	2.0
70°	1.0
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)