

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P740887

Luminaire Tested: LD4D08D010-EU4DR150210IC9030-4LBSQW1MW

Issue Date: 2/2/2024

Test Information

Test Method: LM-79-2019
Report Number: P740887
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2310-195-21)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/2/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LD4D08D010-EU4DR150210IC9030-4LBSQW1MW
Description: 4 INCH SQAURE DEEP 45° CUTOFF MATTE WHITE TRIM, WITH 15° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 3000K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 685.8 lumens
Efficiency: N/A
Efficacy: 77.1 lumens/watt
Spacing Criteria (0/90/45): 0.22 / 0.22 / 0.23
Luminous Opening: Vertical Cylinder (Dia: 0.35' x H: 0.35')
CIE Type: Direct

Input Watts (W): 8.9
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT




Downlight



TEST NUMBER: P740887

CATALOG NUMBER: LD4D08D010-EU4DR150210IC9030-4LBSQW1MW

Luminous Intensity Polar Plot

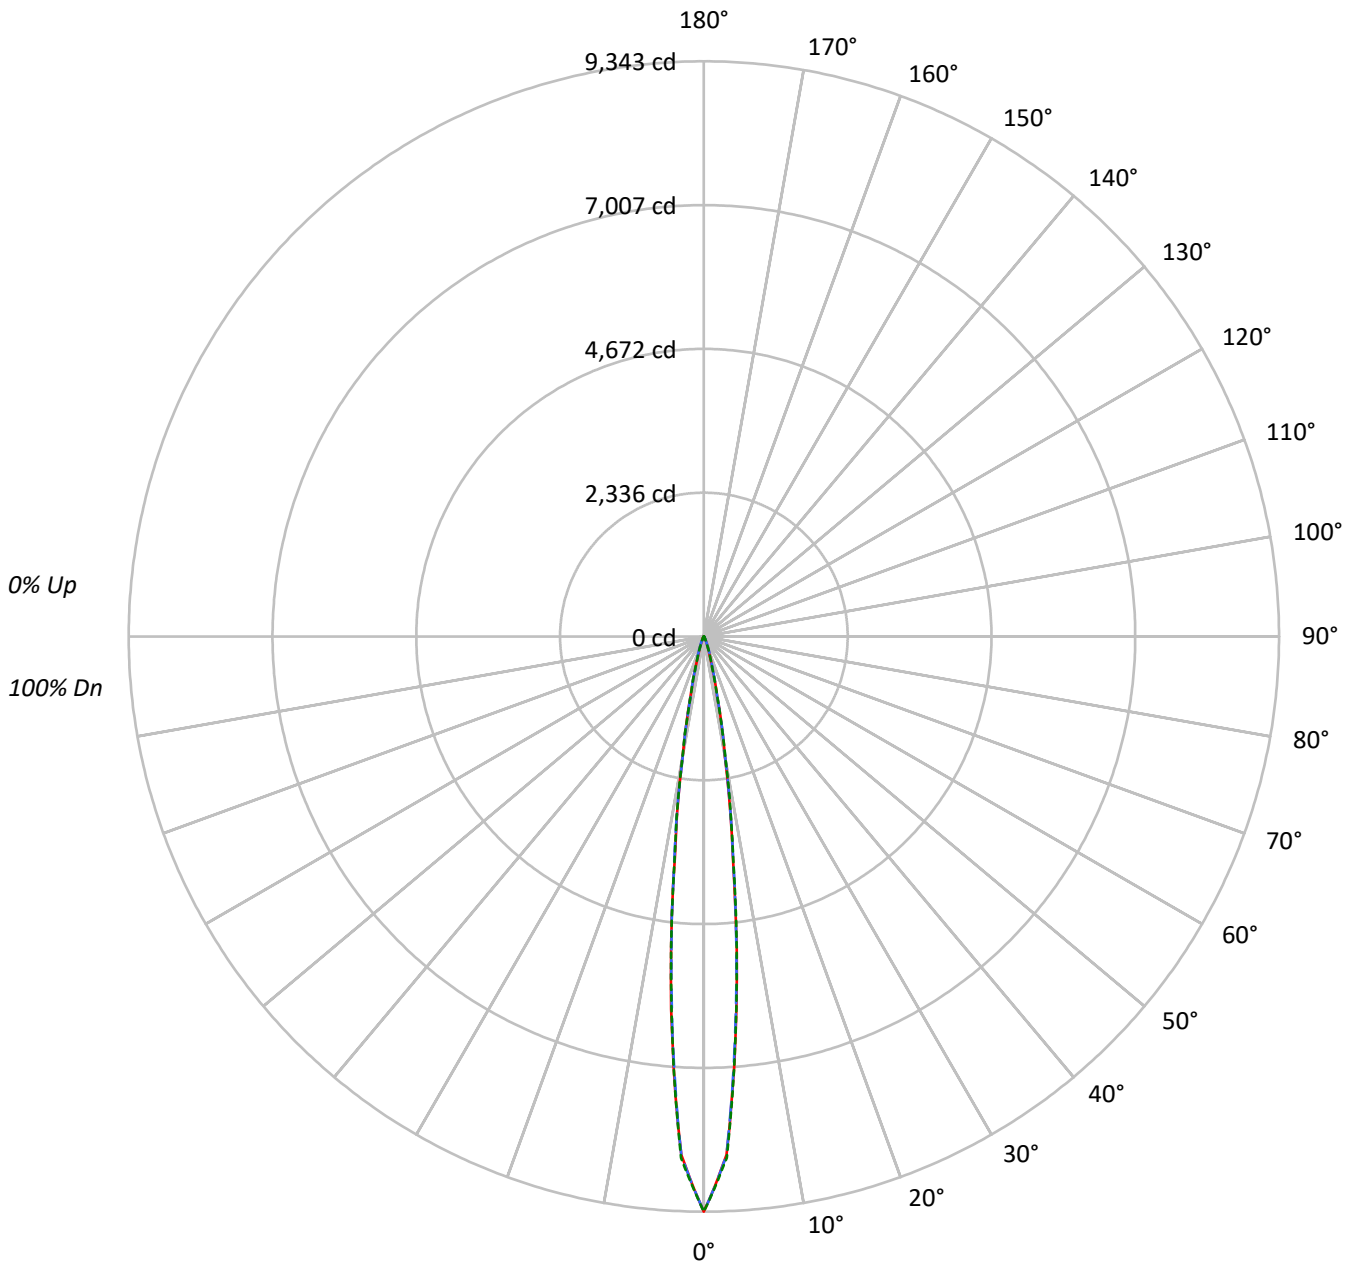



TEST NUMBER: P740887

CATALOG NUMBER: LD4D08D010-EU4DR150210IC9030-4LBSQW1MW

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20					20					20					20										
RC	80					70					50					30					10					0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0		
RCR																										
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100					100			
1	116	114	112	111	113	112	110	109	108	107	106	104	103	103	101	100	100	98					98			
2	113	110	107	105	111	108	106	104	105	103	102	102	101	100	100	98	98	96					96			
3	110	106	103	101	108	105	102	100	103	100	99	100	99	97	98	97	96	94					94			
4	108	103	100	98	106	102	99	97	100	98	96	99	97	95	97	95	94	93					93			
5	106	101	98	95	104	100	97	95	98	96	94	97	95	93	96	94	92	92					92			
6	104	99	95	93	102	98	95	93	97	94	92	96	93	92	95	93	91	90					90			
7	102	97	93	91	101	96	93	91	95	93	91	94	92	90	93	91	90	89					89			
8	100	95	92	90	99	95	92	90	94	91	89	93	91	89	92	90	89	88					88			
9	99	93	90	88	98	93	90	88	92	90	88	92	89	88	91	89	87	87					87			
10	97	92	89	87	96	92	89	87	91	89	87	91	88	87	90	88	86	86					86			

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1051308	1051308	1051308
5°	617802	609804	614621
10°	184385	185673	188519
15°	45860	46755	45313
20°	13722	15890	14016
25°	4838	6162	4900
30°	1775	2336	1805
35°	893	1002	864
40°	561	618	561
45°	413	441	413
50°	327	327	327
55°	278	278	278
60°	225	225	225
65°	171	171	171
70°	146	146	146
75°	91	91	121
80°	63	63	63
85°	33	33	33

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 45°

Vertical Angle: 45°

Luminance: 441 cd/sqm



TEST NUMBER: P740887

CATALOG NUMBER: LD4D08D010-EU4DR150210IC9030-4LBSQW1MW

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	444.8	64.9
10°-20°	182.9	26.7
20°-30°	36.3	5.3
30°-40°	9.1	1.3
40°-50°	4.7	0.7
50°-60°	3.6	0.5
60°-70°	2.5	0.4
70°-80°	1.4	0.2
80°-90°	0.4	0.1
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	664.0	96.8
0°-40°	673.1	98.1
0°-60°	681.4	99.4
0°-90°	685.8	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	685.8	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	9343	9343	9343	9343	9343	
5°	6079	6016	6000	6042	6048	444
15°	528	538	538	529	522	181
25°	62	70	79	70	63	33
35°	12	13	14	13	12	8
45°	6	6	6	6	6	5
55°	4	4	4	4	4	4
65°	2	2	2	2	2	3
75°	1	1	1	1	2	1
85°	0	0	0	0	0	0
90°	0	0	0	0	0	



TEST NUMBER: P740887

CATALOG NUMBER: LD4D08D010-EU4DR150210IC9030-4LBSQW1MW

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	9343.3	9343.3	9343.3	9343.3	9343.3
2.5°	8428.1	8435.2	8437.9	8446.2	8477.1
5°	6079.0	6016.5	6000.3	6041.8	6047.7
7.5°	3600.9	3613.6	3659.9	3670.2	3633.0
10°	1976.1	1992.3	1989.9	2004.2	2020.4
12.5°	1010.6	997.9	994.0	1010.2	987.7
15°	528.0	537.9	538.3	528.8	521.7
17.5°	284.0	295.5	314.5	299.0	275.3
20°	167.7	178.0	194.2	181.6	171.3
22.5°	103.6	111.9	123.4	113.5	105.2
25°	62.1	70.4	79.1	70.0	62.9
27.5°	36.8	43.9	49.4	43.5	36.4
30°	23.7	27.7	31.2	27.3	24.1
32.5°	16.6	18.2	19.8	18.2	16.6
35°	12.3	13.1	13.8	13.1	11.9
37.5°	9.5	10.3	10.7	9.9	9.1
40°	7.9	8.3	8.7	8.3	7.9
42.5°	6.7	7.1	7.1	7.1	6.7
45°	5.9	5.9	6.3	5.9	5.9
47.5°	5.1	5.1	5.5	5.1	5.1
50°	4.7	4.7	4.7	4.7	4.7
52.5°	4.4	4.4	4.4	4.4	4.4
55°	4.0	4.0	4.0	4.0	4.0
57.5°	3.6	3.6	3.6	3.6	3.6
60°	3.2	3.2	3.2	3.2	3.2
62.5°	2.8	2.8	2.8	2.8	2.8
65°	2.4	2.4	2.4	2.4	2.4
67.5°	2.4	2.4	2.4	2.4	2.4
70°	2.0	2.0	2.0	2.0	2.0
72.5°	1.6	1.6	1.6	1.6	1.6
75°	1.2	1.2	1.2	1.2	1.6
77.5°	1.2	1.2	1.2	1.2	1.2
80°	0.8	0.8	0.8	0.8	0.8
82.5°	0.8	0.8	0.8	0.8	0.8
85°	0.4	0.4	0.4	0.4	0.4
87.5°	0.0	0.0	0.0	0.0	0.0
90°	0.0	0.0	0.0	0.0	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report





— 0°-180° - - 45°-225° - - - - 90°-270°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)