

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P741510

Luminaire Tested: LD4D08D010-EU4DR550210IC9030-4LBSQW1B

Issue Date: 1/30/2024

Test Information

Test Method: LM-79-2019
Report Number: P741510
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-52)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 1/30/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LD4D08D010-EU4DR550210IC9030-4LBSQW1B
Description: 4 INCH SQAURE DEEP 45° CUTOFF SPECULAR BLACK TRIM, WITH 55° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 3000K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 621.7 lumens
Efficiency: N/A
Efficacy: 69.9 lumens/watt
Spacing Criteria (0/90/45): 0.89 / 0.89 / 0.87
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct

Input Watts (W): 8.9
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT




Downlight



TEST NUMBER: P741510
CATALOG NUMBER: LD4D08D010-EU4DR550210IC9030-4LBSQW1B

Luminous Intensity Polar Plot

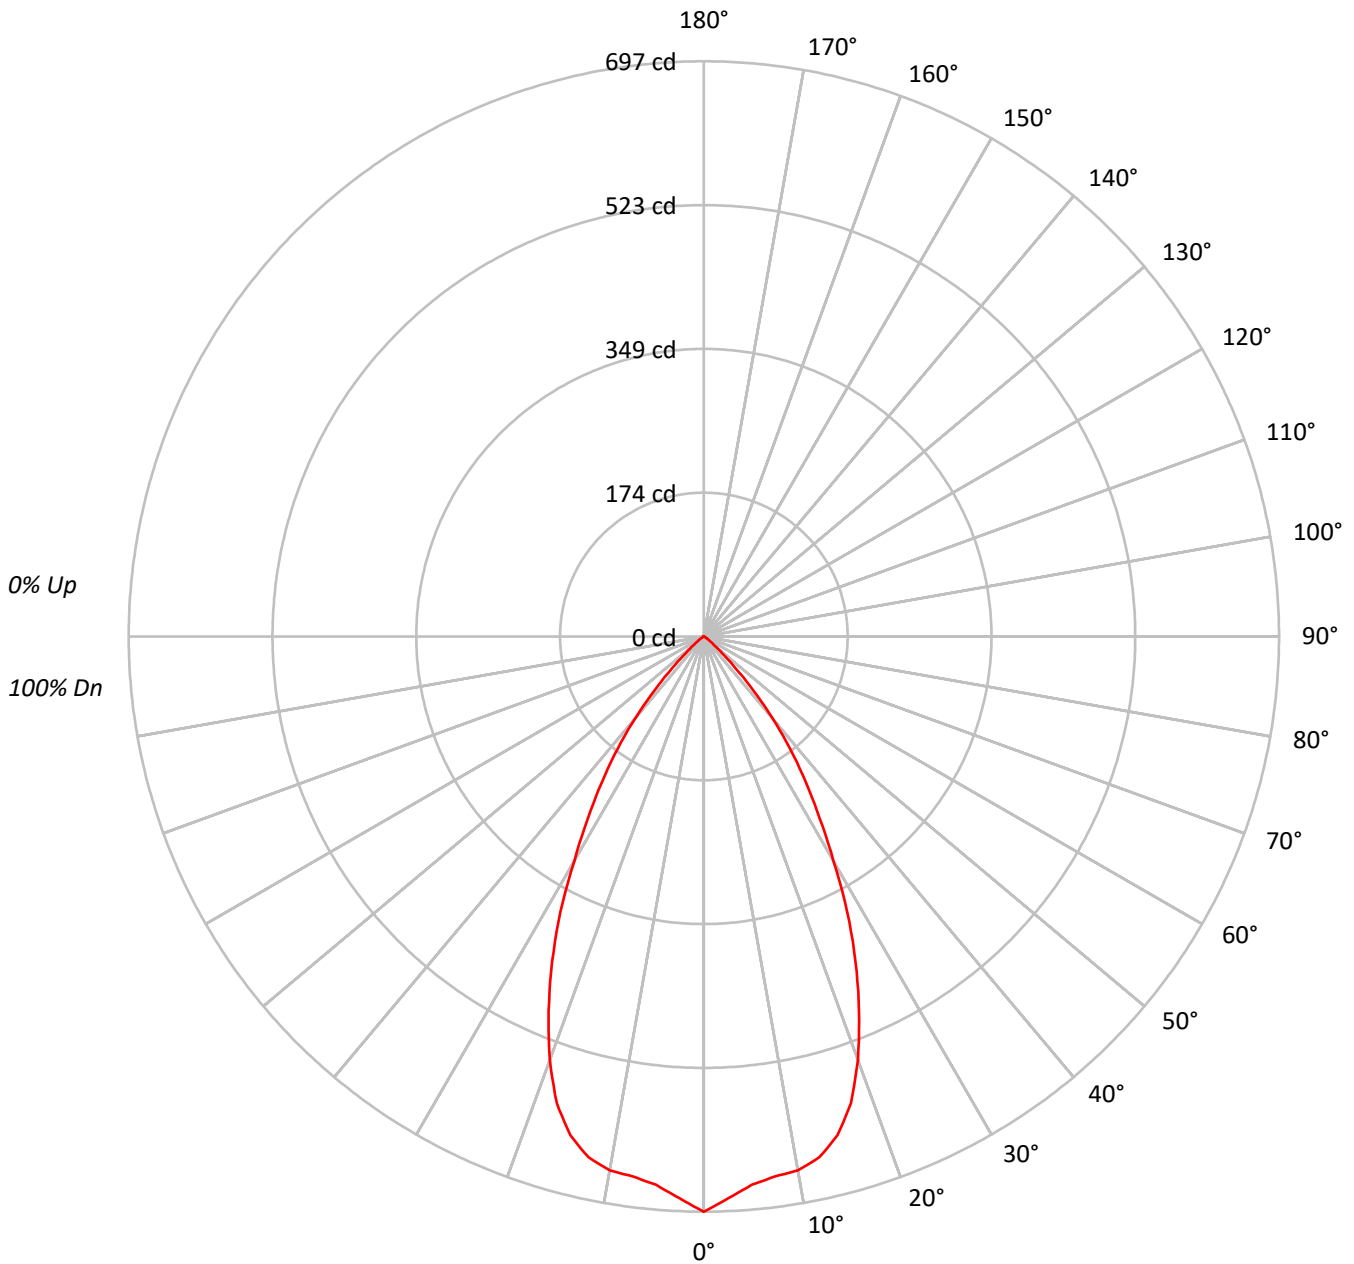



TEST NUMBER: P741510
 CATALOG NUMBER: LD4D08D010-EU4DR550210IC9030-4LBSQW1B

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20					20					20					20					20	
RC	80					70					50					30					10	0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0	
RCR																						
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100				
1	114	111	108	106	111	109	106	104	105	103	101	101	99	98	97	96	95	94				
2	108	103	99	96	106	101	98	95	98	95	92	95	93	90	92	90	89	87				
3	102	96	91	87	100	95	90	86	92	88	85	90	86	84	87	85	82	81				
4	97	90	84	80	95	88	83	79	86	82	78	84	81	78	82	79	77	75				
5	92	84	78	74	91	83	77	73	81	76	73	79	75	72	78	74	71	70				
6	88	79	73	68	86	78	72	68	76	71	68	75	70	67	74	70	67	65				
7	83	74	68	64	82	73	67	63	72	67	63	71	66	63	70	65	62	61				
8	79	69	63	59	78	69	63	59	68	63	59	67	62	59	66	62	58	57				
9	75	66	60	56	74	65	59	55	64	59	55	63	58	55	62	58	55	54				
10	72	62	56	52	71	61	56	52	61	56	52	60	55	52	59	55	52	50				

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	76177
5°	73144
10°	72870
15°	70776
20°	63462
25°	52442
30°	39615
35°	28731
40°	18385
45°	8390
50°	2754
55°	1181
60°	503
65°	78
70°	0
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 8390 cd/sqm



TEST NUMBER: P741510

CATALOG NUMBER: LD4D08D010-EU4DR550210IC9030-4LBSQW1B

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	63.5	10.2
10°-20°	173.2	27.9
20°-30°	197.4	31.7
30°-40°	134.4	21.6
40°-50°	46.3	7.4
50°-60°	6.4	1.0
60°-70°	0.6	0.1
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	434.0	69.8
0°-40°	568.4	91.4
0°-60°	621.1	99.9
0°-90°	621.7	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	621.7	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	697	
5°	667	63
15°	626	173
25°	435	197
35°	215	134
45°	54	46
55°	6	6
65°	0	1
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P741510

CATALOG NUMBER: LD4D08D010-EU4DR550210IC9030-4LBSQW1B

CANDELA DISTRIBUTION (FULL):

	0°
0°	697.2
2.5°	681.2
5°	666.9
7.5°	659.9
10°	656.8
12.5°	646.5
15°	625.7
17.5°	592.8
20°	545.8
22.5°	491.5
25°	435.0
27.5°	376.2
30°	314.0
32.5°	261.3
35°	215.4
37.5°	171.7
40°	128.9
42.5°	89.3
45°	54.3
47.5°	29.3
50°	16.2
52.5°	9.6
55°	6.2
57.5°	4.0
60°	2.3
62.5°	1.0
65°	0.3
67.5°	0.1
70°	0.0
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)