

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269



Scaled data based on original data using  
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-  
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P740889

Luminaire Tested: LD4D08D010-EU4DR150210IC9035-4LBCSSQMMS

Issue Date: 2/2/2024

**Test Information**

Test Method: LM-79-2019  
Report Number: P740889  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2310-195-21)  
Test Lab: COOPER LIGHTING SOLUTIONS  
Issue Date: 2/2/2024  
Manufacturer: COOPER LIGHTING SOLUTIONS  
Product Line: PORTFOLIO  
Catalog Number: LD4D08D010-EU4DR150210IC9035-4LBCSSQMMS  
Description: 4 INCH SQAURE SHALLOW CAST MATTE METALLIC SILVER TRIM, WITH 15° OPTIC  
Light Source: (1) HIGH LUMEN LED 90CRI / 3500K CCT  
Ballast/Driver: -

**Summary**

Lumens per Lamp: N/A  
Luminaire Lumens: 729.8 lumens  
Efficiency: N/A  
Efficacy: 82.0 lumens/watt  
Spacing Criteria (0/90/45): 0.22 / 0.22 / 0.23  
Luminous Opening: Vertical Cylinder (Dia: 0.35' x H: 0.35')  
CIE Type: Direct

Input Watts (W): 8.9  
Input Voltage (V): NR  
Input Current (Ain): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 24 FT




Downlight



TEST NUMBER: P740889  
CATALOG NUMBER: LD4D08D010-EU4DR150210IC9035-4LBCSSQMMS

### Luminous Intensity Polar Plot

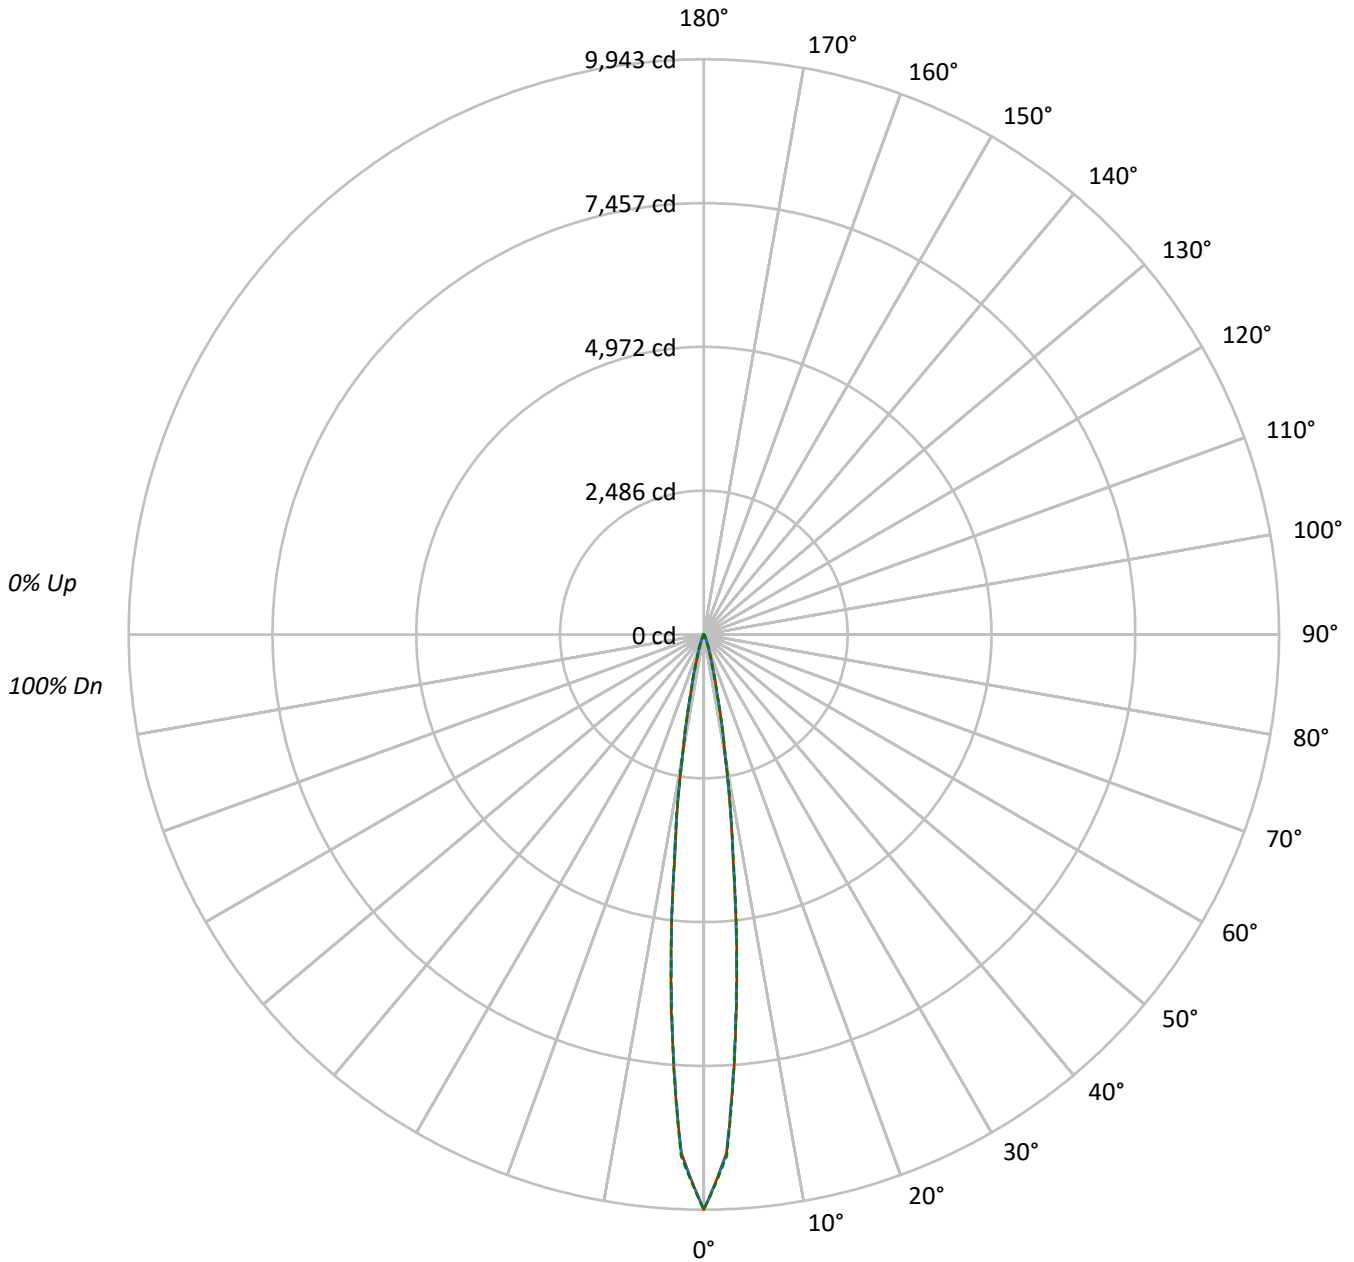



TEST NUMBER: P740889

CATALOG NUMBER: LD4D08D010-EU4DR150210IC9035-4LBCSSQMMS

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0													
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100						100													
1	116	114	112	111	113	112	110	109	108	107	106	104	103	103	101	100	100	98						98													
2	113	110	107	105	111	108	106	104	105	103	102	102	101	100	100	98	98	96						96													
3	110	106	103	101	108	105	102	100	103	100	99	100	99	97	98	97	96	94						94													
4	108	103	100	98	106	102	99	97	100	98	96	99	97	95	97	95	94	93						93													
5	106	101	98	95	104	100	97	95	98	96	94	97	95	93	96	94	92	92						92													
6	104	99	95	93	102	98	95	93	97	94	92	96	93	92	95	93	91	90						90													
7	102	97	94	91	101	96	93	91	95	93	91	94	92	90	93	91	90	89						89													
8	100	95	92	90	99	95	92	90	94	91	89	93	91	89	92	90	89	88						88													
9	99	93	90	88	98	93	90	88	92	90	88	92	89	88	91	89	88	87						87													
10	97	92	89	87	96	92	89	87	91	89	87	91	88	87	90	88	86	86						86													

**AVERAGE LUMINANCE (cd/sqm):**

	0°	45°	90°
0°	1118808	1118808	1118808
5°	657458	648951	654084
10°	196226	197597	200621
15°	48805	49760	48223
20°	14605	16913	14916
25°	5149	6559	5212
30°	1894	2494	1924
35°	944	1068	915
40°	597	660	597
45°	441	469	441
50°	355	355	355
55°	292	292	292
60°	239	239	239
65°	178	178	178
70°	154	154	154
75°	98	98	128
80°	63	63	63
85°	33	33	33

**MAXIMUM LUMINANCE 45°-90°:**

Horizontal Angle: 45°

Vertical Angle: 45°

Luminance: 469 cd/sqm



TEST NUMBER: P740889

CATALOG NUMBER: LD4D08D010-EU4DR150210IC9035-4LBCSSQMMS

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	473.3	64.9
10°-20°	194.7	26.7
20°-30°	38.7	5.3
30°-40°	9.6	1.3
40°-50°	5.1	0.7
50°-60°	3.8	0.5
60°-70°	2.6	0.4
70°-80°	1.5	0.2
80°-90°	0.4	0.1
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	706.7	96.8
0°-40°	716.3	98.2
0°-60°	725.2	99.4
0°-90°	729.8	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	729.8	100.0

**CANDELA DISTRIBUTION:**

	0°	22.5°	45°	67.5°	90°	Flux
0°	9943	9943	9943	9943	9943	
5°	6469	6403	6386	6430	6436	472
15°	562	572	573	563	555	193
25°	66	75	84	74	67	35
35°	13	14	15	14	13	9
45°	6	6	7	6	6	5
55°	4	4	4	4	4	4
65°	2	2	2	2	2	3
75°	1	1	1	1	2	2
85°	0	0	0	0	0	0
90°	0	0	0	0	0	



TEST NUMBER: P740889

CATALOG NUMBER: LD4D08D010-EU4DR150210IC9035-4LBCSSQMMS

**CANDELA DISTRIBUTION (FULL):**

	0°	22.5°	45°	67.5°	90°
0°	9943.2	9943.2	9943.2	9943.2	9943.2
2.5°	8969.1	8976.7	8979.7	8988.5	9021.3
5°	6469.2	6402.7	6385.5	6429.7	6436.0
7.5°	3832.1	3845.6	3894.8	3905.8	3866.2
10°	2103.0	2120.2	2117.7	2132.8	2150.1
12.5°	1075.5	1062.0	1057.8	1075.0	1051.1
15°	561.9	572.5	572.9	562.8	555.2
17.5°	302.2	314.4	334.6	318.2	293.0
20°	178.5	189.4	206.7	193.2	182.3
22.5°	110.3	119.1	131.3	120.8	112.0
25°	66.1	74.9	84.2	74.5	66.9
27.5°	39.1	46.7	52.6	46.3	38.7
30°	25.3	29.5	33.3	29.0	25.7
32.5°	17.7	19.4	21.0	19.4	17.7
35°	13.0	13.9	14.7	13.9	12.6
37.5°	10.1	10.9	11.4	10.5	9.7
40°	8.4	8.8	9.3	8.8	8.4
42.5°	7.2	7.6	7.6	7.6	7.2
45°	6.3	6.3	6.7	6.3	6.3
47.5°	5.5	5.5	5.9	5.5	5.5
50°	5.1	5.1	5.1	5.1	5.1
52.5°	4.6	4.6	4.6	4.6	4.6
55°	4.2	4.2	4.2	4.2	4.2
57.5°	3.8	3.8	3.8	3.8	3.8
60°	3.4	3.4	3.4	3.4	3.4
62.5°	2.9	2.9	2.9	2.9	2.9
65°	2.5	2.5	2.5	2.5	2.5
67.5°	2.5	2.5	2.5	2.5	2.5
70°	2.1	2.1	2.1	2.1	2.1
72.5°	1.7	1.7	1.7	1.7	1.7
75°	1.3	1.3	1.3	1.3	1.7
77.5°	1.3	1.3	1.3	1.3	1.3
80°	0.8	0.8	0.8	0.8	0.8
82.5°	0.8	0.8	0.8	0.8	0.8
85°	0.4	0.4	0.4	0.4	0.4
87.5°	0.0	0.0	0.0	0.0	0.0
90°	0.0	0.0	0.0	0.0	0.0

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report







— 0°-180°    - - 45°-225°    - - - 90°-270°

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)