

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P740900

Luminaire Tested: LD4D08D010-EU4DR150210IC9035-4LBSQW1MW

Issue Date: 2/2/2024

Test Information

Test Method: LM-79-2019
Report Number: P740900
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2310-195-21)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/2/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LD4D08D010-EU4DR150210IC9035-4LBSQW1MW
Description: 4 INCH SQAURE DEEP 45° CUTOFF MATTE WHITE TRIM, WITH 15° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 3500K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 723.9 lumens
Efficiency: N/A
Efficacy: 81.3 lumens/watt
Spacing Criteria (0/90/45): 0.22 / 0.22 / 0.23
Luminous Opening: Vertical Cylinder (Dia: 0.35' x H: 0.35')
CIE Type: Direct

Input Watts (W): 8.9
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT




Downlight



TEST NUMBER: P740900
CATALOG NUMBER: LD4D08D010-EU4DR150210IC9035-4LBSQW1MW

Luminous Intensity Polar Plot

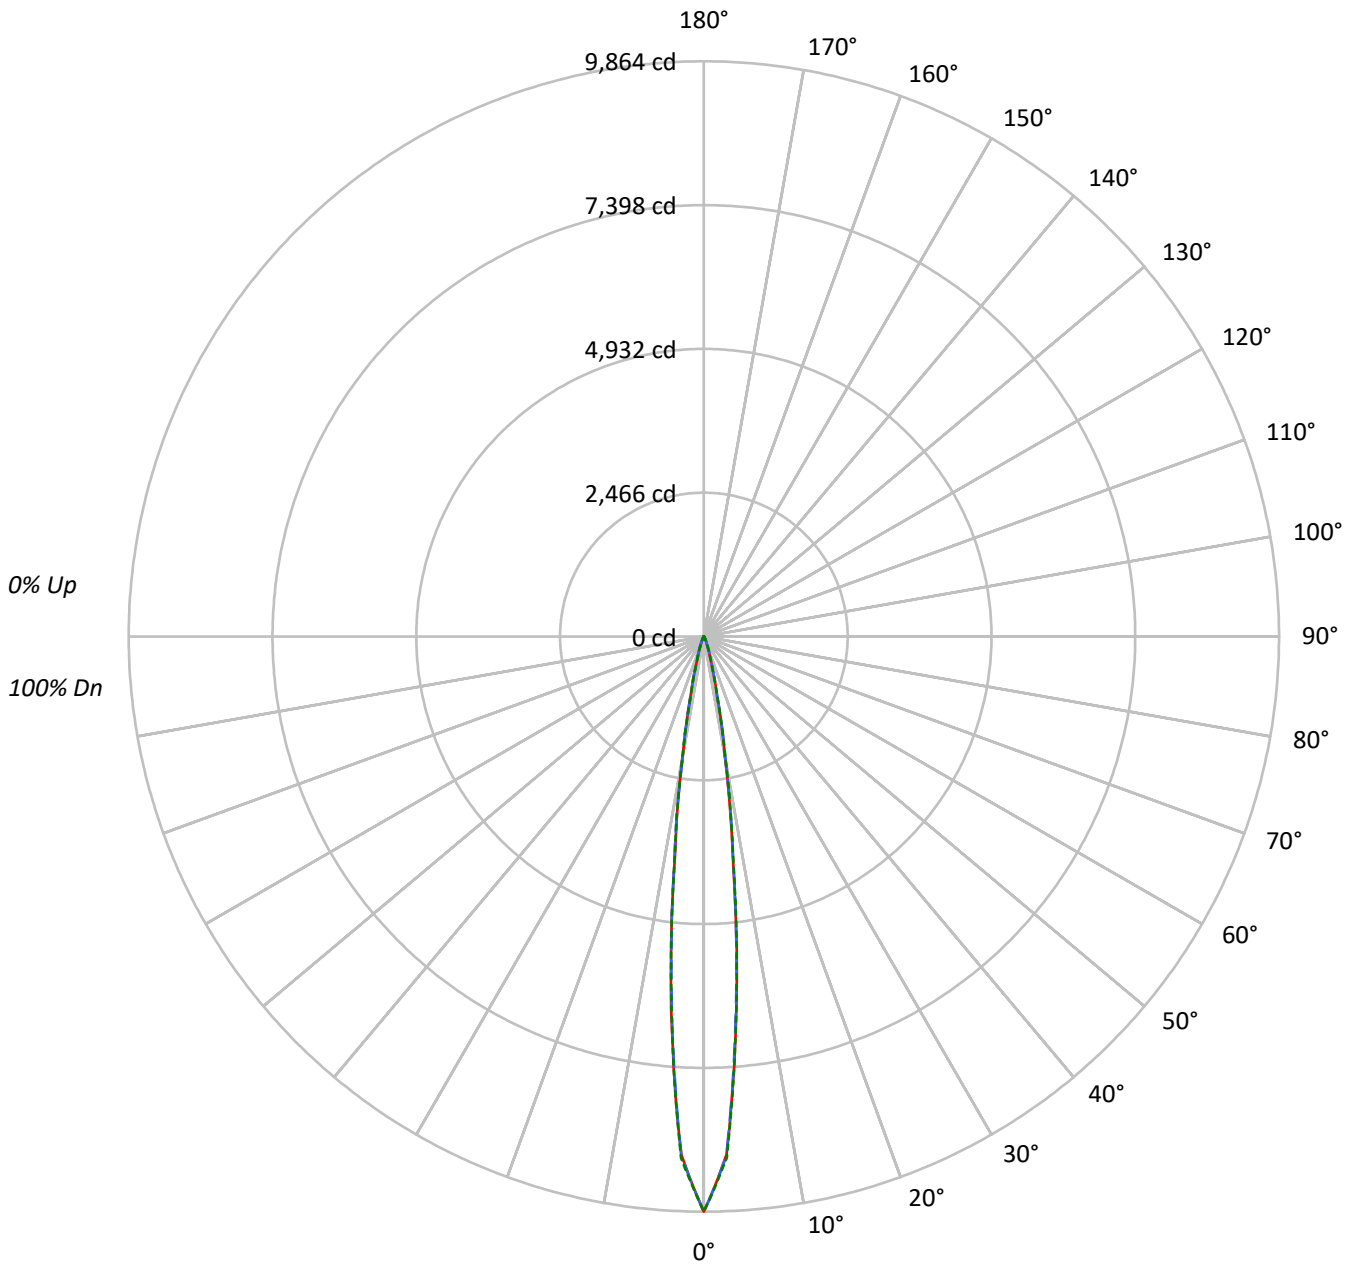



TEST NUMBER: P740900

CATALOG NUMBER: LD4D08D010-EU4DR150210IC9035-4LBSQW1MW

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0																
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100				100															
1	116	114	112	111	113	112	110	109	108	107	106	104	103	103	101	100	100	98				98															
2	113	110	107	105	111	108	106	104	105	103	102	102	101	100	100	98	98	96				96															
3	110	106	103	101	108	105	102	100	103	100	99	100	99	97	98	97	96	94				94															
4	108	103	100	98	106	102	99	97	100	98	96	99	97	95	97	95	94	93				93															
5	106	101	98	95	104	100	97	95	98	96	94	97	95	93	96	94	92	92				92															
6	104	99	95	93	102	98	95	93	97	94	92	96	93	92	95	93	91	90				90															
7	102	97	94	91	101	96	93	91	95	93	91	94	92	90	93	91	90	89				89															
8	100	95	92	90	99	95	92	90	94	91	89	93	91	89	92	90	89	88				88															
9	99	93	90	88	98	93	90	88	92	90	88	92	89	88	91	89	88	87				87															
10	97	92	89	87	96	92	89	87	91	89	87	91	88	87	90	88	86	86				86															

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1109841	1109841	1109841
5°	652193	643748	648840
10°	194649	196011	199016
15°	48414	49361	47841
20°	14483	16774	14794
25°	5110	6505	5173
30°	1880	2471	1909
35°	937	1060	908
40°	597	653	597
45°	441	469	441
50°	348	348	348
55°	292	292	292
60°	232	232	232
65°	178	178	178
70°	154	154	154
75°	98	98	128
80°	63	63	63
85°	33	33	33

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 45°

Vertical Angle: 45°

Luminance: 469 cd/sqm



TEST NUMBER: P740900

CATALOG NUMBER: LD4D08D010-EU4DR150210IC9035-4LBSQW1MW

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	469.5	64.9
10°-20°	193.1	26.7
20°-30°	38.4	5.3
30°-40°	9.6	1.3
40°-50°	5.0	0.7
50°-60°	3.7	0.5
60°-70°	2.6	0.4
70°-80°	1.5	0.2
80°-90°	0.4	0.1
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	701.0	96.8
0°-40°	710.6	98.2
0°-60°	719.4	99.4
0°-90°	723.9	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	723.9	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	9864	9864	9864	9864	9864	
5°	6417	6352	6334	6378	6384	469
15°	557	568	568	558	551	191
25°	66	74	84	74	66	34
35°	13	14	15	14	12	9
45°	6	6	7	6	6	5
55°	4	4	4	4	4	4
65°	2	2	2	2	2	3
75°	1	1	1	1	2	2
85°	0	0	0	0	0	0
90°	0	0	0	0	0	



TEST NUMBER: P740900

CATALOG NUMBER: LD4D08D010-EU4DR150210IC9035-4LBSQW1MW

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	9863.5	9863.5	9863.5	9863.5	9863.5
2.5°	8897.3	8904.8	8907.7	8916.5	8949.1
5°	6417.4	6351.5	6334.3	6378.2	6384.4
7.5°	3801.4	3814.8	3863.6	3874.5	3835.3
10°	2086.1	2103.2	2100.7	2115.8	2132.9
12.5°	1066.9	1053.5	1049.3	1066.4	1042.6
15°	557.4	567.9	568.3	558.3	550.8
17.5°	299.8	311.9	332.0	315.7	290.6
20°	177.0	187.9	205.0	191.7	180.8
22.5°	109.4	118.2	130.3	119.8	111.1
25°	65.6	74.3	83.5	73.9	66.4
27.5°	38.8	46.3	52.2	45.9	38.4
30°	25.1	29.2	33.0	28.8	25.5
32.5°	17.5	19.2	20.9	19.2	17.5
35°	12.9	13.8	14.6	13.8	12.5
37.5°	10.0	10.9	11.3	10.4	9.6
40°	8.4	8.8	9.2	8.8	8.4
42.5°	7.1	7.5	7.5	7.5	7.1
45°	6.3	6.3	6.7	6.3	6.3
47.5°	5.4	5.4	5.8	5.4	5.4
50°	5.0	5.0	5.0	5.0	5.0
52.5°	4.6	4.6	4.6	4.6	4.6
55°	4.2	4.2	4.2	4.2	4.2
57.5°	3.8	3.8	3.8	3.8	3.8
60°	3.3	3.3	3.3	3.3	3.3
62.5°	2.9	2.9	2.9	2.9	2.9
65°	2.5	2.5	2.5	2.5	2.5
67.5°	2.5	2.5	2.5	2.5	2.5
70°	2.1	2.1	2.1	2.1	2.1
72.5°	1.7	1.7	1.7	1.7	1.7
75°	1.3	1.3	1.3	1.3	1.7
77.5°	1.3	1.3	1.3	1.3	1.3
80°	0.8	0.8	0.8	0.8	0.8
82.5°	0.8	0.8	0.8	0.8	0.8
85°	0.4	0.4	0.4	0.4	0.4
87.5°	0.0	0.0	0.0	0.0	0.0
90°	0.0	0.0	0.0	0.0	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report





— 0°-180° - - 45°-225° - - - - 90°-270°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)