

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P741133

Luminaire Tested: LD4D08D010-EU4DR300210IC9035-4LBSQW1B

Issue Date: 1/30/2024

Test Information

Test Method: LM-79-2019
Report Number: P741133
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-16)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 1/30/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LD4D08D010-EU4DR300210IC9035-4LBSQW1B
Description: 4 INCH SQAURE DEEP 45° CUTOFF SPECULAR BLACK TRIM, WITH 30° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 3500K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 585.2 lumens
Efficiency: N/A
Efficacy: 65.8 lumens/watt
Spacing Criteria (0/90/45): 0.52 / 0.52 / 0.49
Luminous Opening: Rectangular (W 0.38' x L: 0.38' x H: 0')
CIE Type: Direct

Input Watts (W): 8.9
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT




Downlight



TEST NUMBER: P741133
CATALOG NUMBER: LD4D08D010-EU4DR300210IC9035-4LBSQW1B

Luminous Intensity Polar Plot

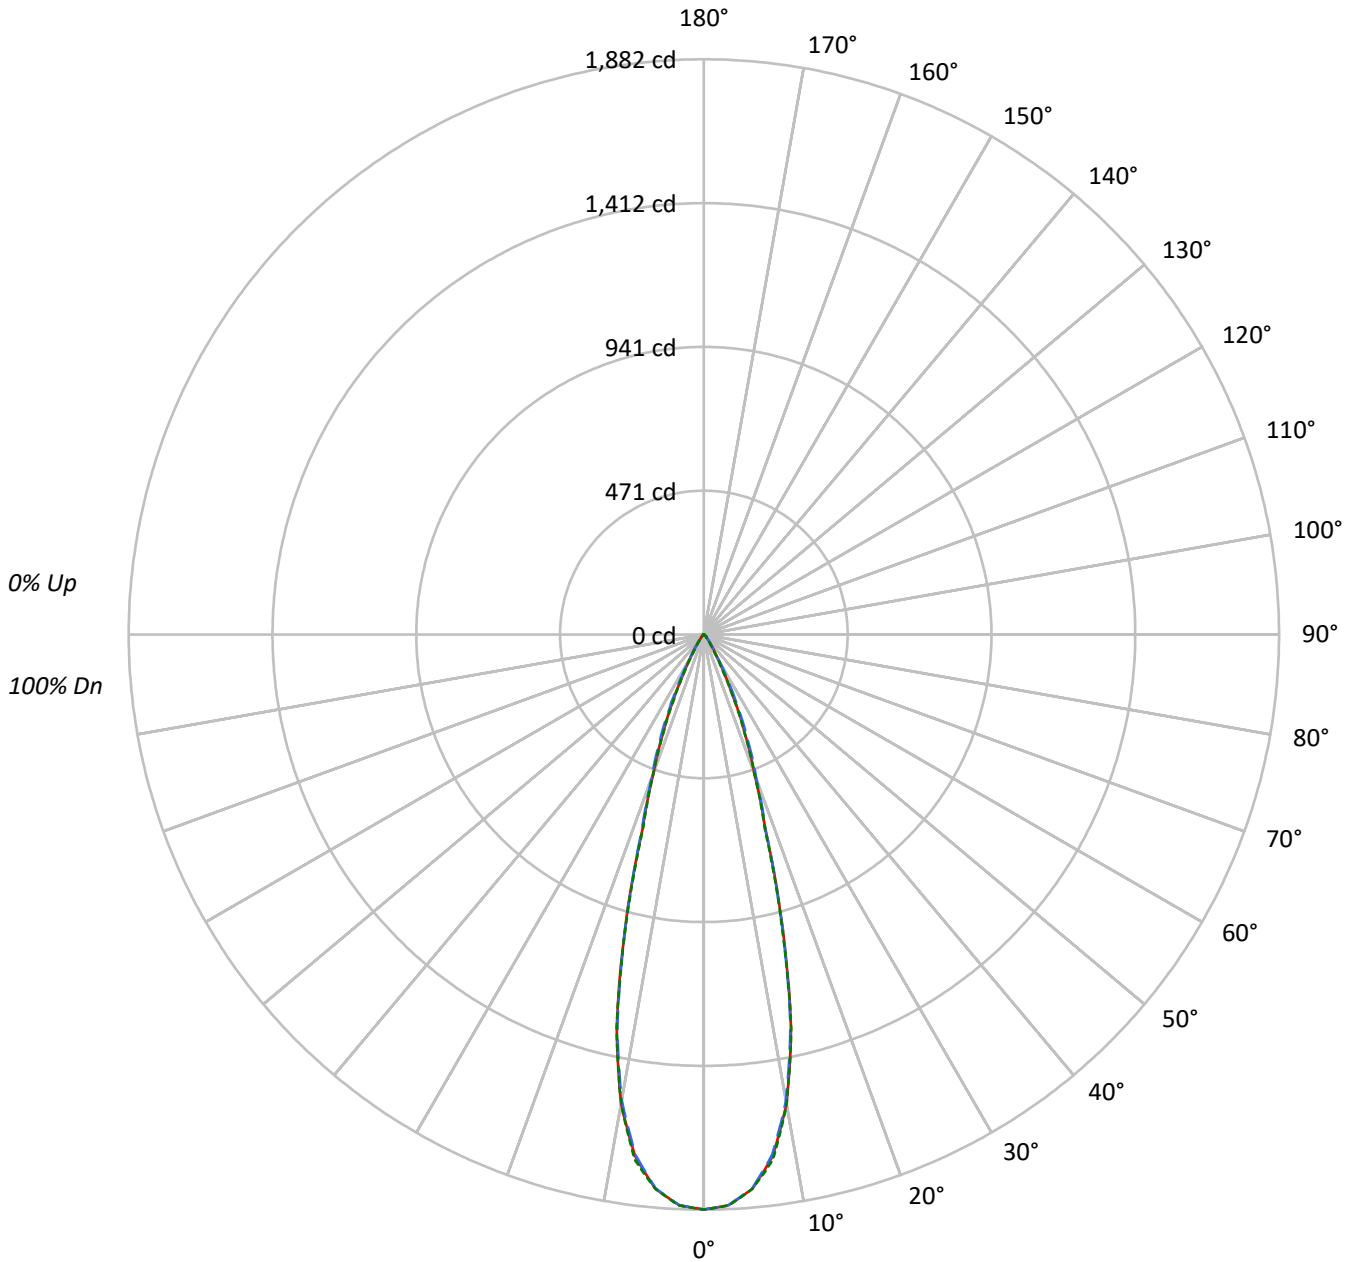



TEST NUMBER: P741133

CATALOG NUMBER: LD4D08D010-EU4DR300210IC9035-4LBSQW1B

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0													
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100																			
1	115	113	111	109	112	110	109	107	106	105	104	103	102	101	99	99	98	96																			
2	111	107	104	101	109	105	102	100	102	100	98	99	97	96	97	95	94	92																			
3	107	102	98	95	105	101	97	94	98	95	93	96	93	91	94	92	90	89																			
4	103	98	93	90	102	96	93	90	94	91	89	93	90	88	91	89	87	85																			
5	100	94	89	86	98	93	89	86	91	88	85	90	86	84	88	86	83	82																			
6	97	90	85	82	95	89	85	82	88	84	81	87	83	81	85	83	80	79																			
7	94	87	82	79	92	86	82	79	85	81	78	84	81	78	83	80	78	77																			
8	91	84	79	76	90	83	79	76	82	78	76	81	78	75	80	77	75	74																			
9	88	81	76	73	87	80	76	73	80	76	73	79	75	73	78	75	73	72																			
10	85	78	74	71	85	78	74	71	77	73	71	76	73	71	76	73	70	69																			

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	144032	144032	144032
5°	139895	139734	139903
10°	121172	120317	121149
15°	79061	78633	78237
20°	39311	40793	39262
25°	19805	22330	19400
30°	7928	8635	6912
35°	3682	3523	2953
40°	1589	1759	1499
45°	1126	1386	1126
50°	381	1012	405
55°	227	427	240
60°	153	184	153
65°	109	109	109
70°	67	45	67
75°	0	30	0
80°	0	0	0
85°	0	0	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 22.5°
 Vertical Angle: 45°
 Luminance: 1386 cd/sqm



TEST NUMBER: P741133

CATALOG NUMBER: LD4D08D010-EU4DR300210IC9035-4LBSQW1B

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	165.5	28.3
10°-20°	266.5	45.5
20°-30°	115.2	19.7
30°-40°	26.2	4.5
40°-50°	9.0	1.5
50°-60°	2.2	0.4
60°-70°	0.6	0.1
70°-80°	0.1	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	547.1	93.5
0°-40°	573.4	98.0
0°-60°	584.6	99.9
0°-90°	585.2	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	585.2	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1882	1882	1882	1882	1882	
5°	1821	1819	1819	1822	1821	166
15°	998	986	992	989	987	267
25°	234	243	264	237	230	112
35°	39	40	38	37	32	27
45°	10	13	13	13	10	7
55°	2	2	3	2	2	2
65°	1	1	1	1	1	1
75°	0	0	0	0	0	0
85°	0	0	0	0	0	0
90°	0	0	0	0	0	



TEST NUMBER: P741133

CATALOG NUMBER: LD4D08D010-EU4DR300210IC9035-4LBSQW1B

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1881.7	1881.7	1881.7	1881.7	1881.7
2.5°	1869.3	1867.9	1868.7	1869.6	1870.0
5°	1820.7	1819.0	1818.6	1822.4	1820.8
7.5°	1722.9	1720.4	1716.6	1725.2	1733.2
10°	1559.0	1556.2	1548.0	1552.1	1558.7
12.5°	1317.0	1308.1	1307.9	1320.8	1319.1
15°	997.7	985.6	992.3	989.1	987.3
17.5°	670.9	666.3	675.2	672.5	661.0
20°	482.6	483.8	500.8	492.2	482.0
22.5°	352.2	356.5	376.5	354.7	346.6
25°	234.5	243.3	264.4	237.1	229.7
27.5°	144.2	148.3	169.6	142.4	138.3
30°	89.7	87.7	97.7	83.9	78.2
32.5°	58.8	56.3	59.5	53.4	48.8
35°	39.4	40.2	37.7	37.4	31.6
37.5°	24.6	28.2	24.9	26.6	20.3
40°	15.9	20.5	17.6	19.5	15.0
42.5°	13.0	15.8	14.5	15.4	13.3
45°	10.4	12.8	12.8	12.8	10.4
47.5°	5.7	8.6	11.0	8.8	6.1
50°	3.2	4.4	8.5	4.5	3.4
52.5°	2.2	2.5	5.8	2.6	2.3
55°	1.7	1.8	3.2	1.8	1.8
57.5°	1.3	1.4	1.7	1.4	1.3
60°	1.0	1.0	1.2	1.1	1.0
62.5°	0.7	0.7	0.9	0.7	0.7
65°	0.6	0.6	0.6	0.6	0.6
67.5°	0.3	0.3	0.3	0.3	0.3
70°	0.3	0.2	0.2	0.2	0.3
72.5°	0.2	0.1	0.1	0.1	0.1
75°	0.0	0.0	0.1	0.0	0.0
77.5°	0.0	0.0	0.0	0.0	0.0
80°	0.0	0.0	0.0	0.0	0.0
82.5°	0.0	0.0	0.0	0.0	0.0
85°	0.0	0.0	0.0	0.0	0.0
87.5°	0.0	0.0	0.0	0.0	0.0
90°	0.0	0.0	0.0	0.0	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report





— 0°-180° - - 45°-225° - - - - 90°-270°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)