

Scaled data based on original data using  
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-  
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P741368

Luminaire Tested: LD4D08D010-EU4DR450210IC9035-4LBSQW1MW

Issue Date: 1/30/2024

**Test Information**

Test Method: LM-79-2019  
Report Number: P741368  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-36)  
Test Lab: COOPER LIGHTING SOLUTIONS  
Issue Date: 1/30/2024  
Manufacturer: COOPER LIGHTING SOLUTIONS  
Product Line: PORTFOLIO  
Catalog Number: LD4D08D010-EU4DR450210IC9035-4LBSQW1MW  
Description: 4 INCH SQAURE DEEP 45° CUTOFF MATTE WHITE TRIM, WITH 45° OPTIC  
Light Source: (1) HIGH LUMEN LED 90CRI / 3500K CCT  
Ballast/Driver: -

**Summary**

Lumens per Lamp: N/A  
Luminaire Lumens: 743.1 lumens  
Efficiency: N/A  
Efficacy: 83.5 lumens/watt  
Spacing Criteria (0/90/45): 0.75 / 0.75 / 0.69  
Luminous Opening: Circular (Dia: 0.35' x H: 0')  
CIE Type: Direct

Input Watts (W): 8.9  
Input Voltage (V): NR  
Input Current (Ain): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 24 FT




Downlight



TEST NUMBER: P741368

CATALOG NUMBER: LD4D08D010-EU4DR450210IC9035-4LBSQW1MW

### Luminous Intensity Polar Plot

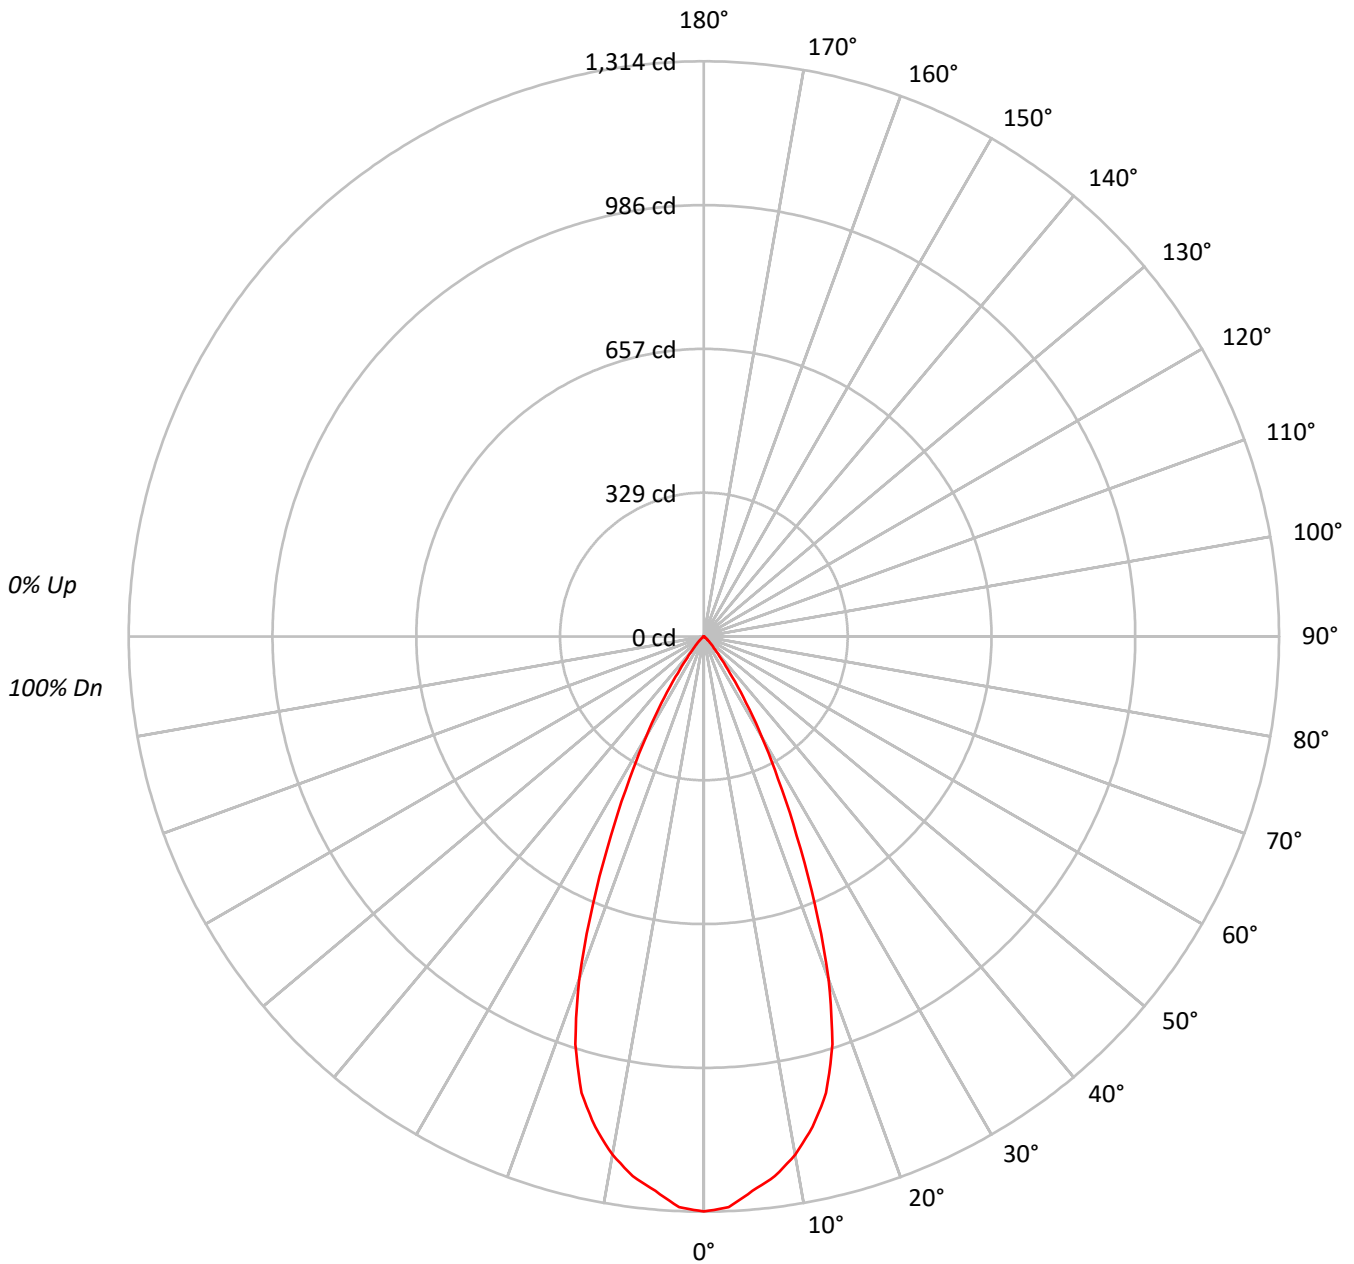



TEST NUMBER: P741368

CATALOG NUMBER: LD4D08D010-EU4DR450210IC9035-4LBSQW1MW

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20				20				20				20				20			
RC	80				70				50				30				10		0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10
RCR																				
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100		
1	114	112	110	108	112	110	108	106	106	104	103	102	101	100	98	98	97	95		
2	109	105	102	99	107	103	100	98	100	98	95	97	95	93	95	93	91	90		
3	105	99	95	91	103	98	94	91	95	92	89	93	90	88	91	89	87	85		
4	100	94	89	85	99	93	88	85	91	87	84	89	86	83	87	84	82	81		
5	96	89	84	80	95	88	83	80	86	82	79	85	81	79	83	80	78	77		
6	92	85	80	76	91	84	79	76	83	78	75	81	77	75	80	77	74	73		
7	89	81	75	72	87	80	75	72	79	74	71	78	74	71	77	73	71	69		
8	85	77	72	68	84	76	71	68	75	71	68	74	70	67	73	70	67	66		
9	82	73	68	65	81	73	68	65	72	68	65	71	67	64	71	67	64	63		
10	79	70	65	62	78	70	65	62	69	65	62	68	64	61	68	64	61	60		

**AVERAGE LUMINANCE (cd/sqm):**

	0°
0°	143514
5°	139434
10°	133402
15°	122085
20°	96855
25°	60471
30°	33332
35°	14966
40°	5891
45°	2781
50°	1309
55°	686
60°	328
65°	78
70°	32
75°	0
80°	0
85°	0

**MAXIMUM LUMINANCE 45°-90°:**

Horizontal Angle: 0°  
 Vertical Angle: 45°  
 Luminance: 2781 cd/sqm



TEST NUMBER: P741368

CATALOG NUMBER: LD4D08D010-EU4DR450210IC9035-4LBSQW1MW

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	119.5	16.1
10°-20°	294.0	39.6
20°-30°	232.8	31.3
30°-40°	77.5	10.4
40°-50°	15.4	2.1
50°-60°	3.5	0.5
60°-70°	0.5	0.1
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	646.2	87.0
0°-40°	723.8	97.4
0°-60°	742.6	99.9
0°-90°	743.1	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	743.1	100.0

**CANDELA DISTRIBUTION:**

	0°	Flux
0°	1314	
5°	1271	119
15°	1079	294
25°	502	233
35°	112	78
45°	18	15
55°	4	3
65°	0	0
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P741368

CATALOG NUMBER: LD4D08D010-EU4DR450210IC9035-4LBSQW1MW

**CANDELA DISTRIBUTION (FULL):**

	0°
0°	1313.5
2.5°	1305.0
5°	1271.3
7.5°	1243.5
10°	1202.4
12.5°	1147.6
15°	1079.3
17.5°	976.7
20°	833.0
22.5°	661.9
25°	501.6
27.5°	367.3
30°	264.2
32.5°	179.7
35°	112.2
37.5°	66.5
40°	41.3
42.5°	27.2
45°	18.0
47.5°	11.6
50°	7.7
52.5°	5.2
55°	3.6
57.5°	2.3
60°	1.5
62.5°	0.8
65°	0.3
67.5°	0.1
70°	0.1
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report





Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)