

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P740993

Luminaire Tested: LD4D08D010-EU4DR200210IC9050-4LBCSSQMMS

Issue Date: 2/2/2024

Test Information

Test Method: LM-79-2019
Report Number: P740993
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2310-195-36)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/2/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LD4D08D010-EU4DR200210IC9050-4LBCSSQMMS
Description: 4 INCH SQAURE SHALLOW CAST MATTE METALLIC SILVER TRIM, WITH 20° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 5000K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 793.7 lumens
Efficiency: N/A
Efficacy: 89.2 lumens/watt
Spacing Criteria (0/90/45): 0.34 / 0.34 / 0.36
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct

Input Watts (W): 8.9
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT




Downlight



TEST NUMBER: P740993

CATALOG NUMBER: LD4D08D010-EU4DR200210IC9050-4LBCSSQMMS

Luminous Intensity Polar Plot

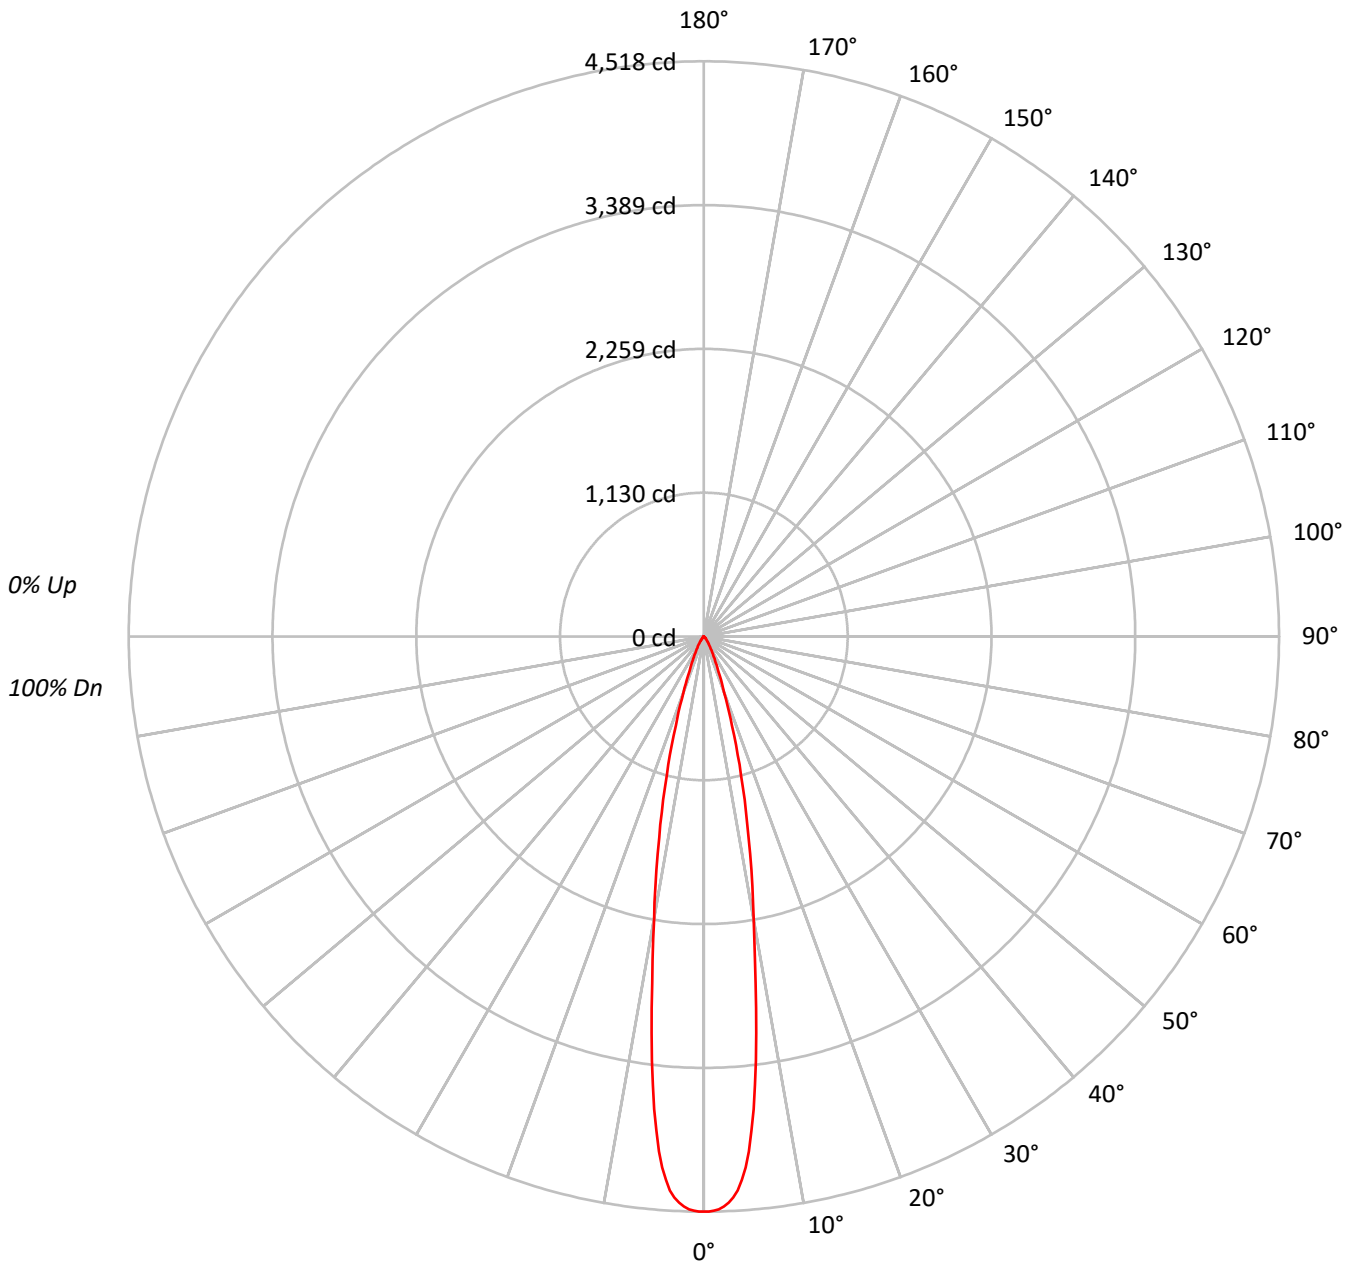



TEST NUMBER: P740993

CATALOG NUMBER: LD4D08D010-EU4DR200210IC9050-4LBCSSQMMS

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0													
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100						100													
1	115	113	111	109	113	111	109	108	107	106	104	103	102	101	100	99	98	100	99	98	97	98	96	95	94												
2	111	108	105	102	109	106	104	101	103	101	99	100	99	97	98	96	95	98	96	95	94	93	92	91	94												
3	108	103	100	97	106	102	99	96	100	97	95	97	95	93	95	93	92	98	96	95	94	93	92	91	94												
4	105	99	96	93	103	98	95	92	96	93	91	95	92	90	93	91	89	98	96	95	94	93	92	91	88												
5	102	96	92	89	100	95	91	89	94	90	88	92	89	87	91	88	86	98	96	95	94	93	92	91	85												
6	99	93	89	86	98	92	88	86	91	87	85	90	87	84	88	86	84	98	96	95	94	93	92	91	83												
7	96	90	86	83	95	89	86	83	88	85	82	87	84	82	86	84	82	98	96	95	94	93	92	91	81												
8	94	87	83	81	93	87	83	80	86	83	80	85	82	80	84	82	80	98	96	95	94	93	92	91	79												
9	91	85	81	78	91	85	81	78	84	80	78	83	80	78	82	80	78	98	96	95	94	93	92	91	77												
10	89	83	79	76	88	82	79	76	82	78	76	81	78	76	81	78	76	98	96	95	94	93	92	91	75												

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	493585
5°	445304
10°	249929
15°	127040
20°	53788
25°	24835
30°	13146
35°	7083
40°	3780
45°	2241
50°	1292
55°	686
60°	437
65°	310
70°	128
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 2241 cd/sqm



TEST NUMBER: P740993

CATALOG NUMBER: LD4D08D010-EU4DR200210IC9050-4LBCSSQMMS

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	321.6	40.5
10°-20°	316.7	39.9
20°-30°	103.5	13.0
30°-40°	35.2	4.4
40°-50°	11.8	1.5
50°-60°	3.5	0.4
60°-70°	1.2	0.1
70°-80°	0.1	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	741.8	93.5
0°-40°	777.0	97.9
0°-60°	792.4	99.8
0°-90°	793.7	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	793.7	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	4518	
5°	4060	322
15°	1123	317
25°	206	103
35°	53	35
45°	14	12
55°	4	4
65°	1	1
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P740993

CATALOG NUMBER: LD4D08D010-EU4DR200210IC9050-4LBCSSQMMS

CANDELA DISTRIBUTION (FULL):

	0°
0°	4517.5
0.5°	4517.5
1°	4511.9
1.5°	4500.6
2°	4480.1
2.5°	4452.7
3°	4414.1
3.5°	4360.2
4°	4280.2
4.5°	4182.8
5°	4060.1
5.5°	3898.8
6°	3733.5
6.5°	3544.0
7°	3358.6
7.5°	3141.3
8°	2947.4
8.5°	2752.3
9°	2572.1
9.5°	2406.8
10°	2252.7
12.5°	1617.5
15°	1123.1
17.5°	733.7
20°	462.6
22.5°	299.7
25°	206.0
27.5°	144.8
30°	104.2
32.5°	74.8
35°	53.1
37.5°	37.0
40°	26.5
42.5°	19.3
45°	14.5
47.5°	11.3
50°	7.6
52.5°	4.8
55°	3.6
57.5°	2.8
60°	2.0
62.5°	1.6
65°	1.2



TEST NUMBER: P740993
CATALOG NUMBER: LD4D08D010-EU4DR200210IC9050-4LBCSSQMMS

CANDELA DISTRIBUTION (continued):

	0°
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report





67.5°		0.8
70°		0.4

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)